


Project Specific Water Quality Management Plan

A Template for Projects located within the **Santa Ana Watershed** Region of Riverside County

Project Title: FIR Wilson 3

Development No: P22-00017

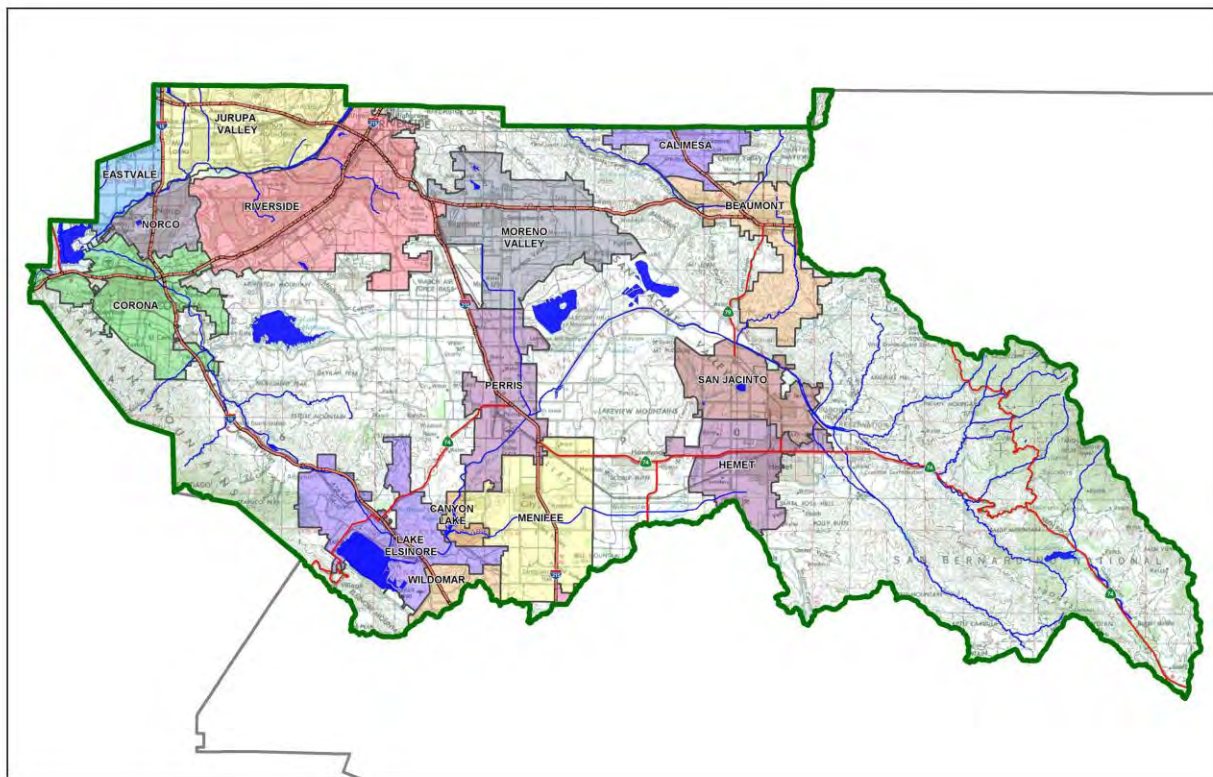

- Preliminary
- Final

Original Date Prepared: June 2022

Revision Date(s):

*Prepared for Compliance with
Regional Board Order No. **R8-2013-0024***

Template revised June 30, 2016

Contact Information:

Prepared for:


First Industrial Realty Trust
Attn: Paul Loubet
898 N Pacific Coast Highway, Suite 175
El Segundo, CA 90245
(909) 230-3892

Prepared by:

Albert A. Webb Associates
Attn: Sarah Kowalski
3788 McCray Street
Riverside, CA 92506
(951) 686-1070

A Brief Introduction

This Project-Specific WQMP Template for the **Santa Ana Region** has been prepared to help guide you in documenting compliance for your project. Because this document has been designed to specifically document compliance, you will need to utilize the WQMP Guidance Document as your “how-to” manual to help guide you through this process. Both the Template and Guidance Document go hand-in-hand, and will help facilitate a well prepared Project-Specific WQMP. Below is a flowchart for the layout of this Template that will provide the steps required to document compliance.

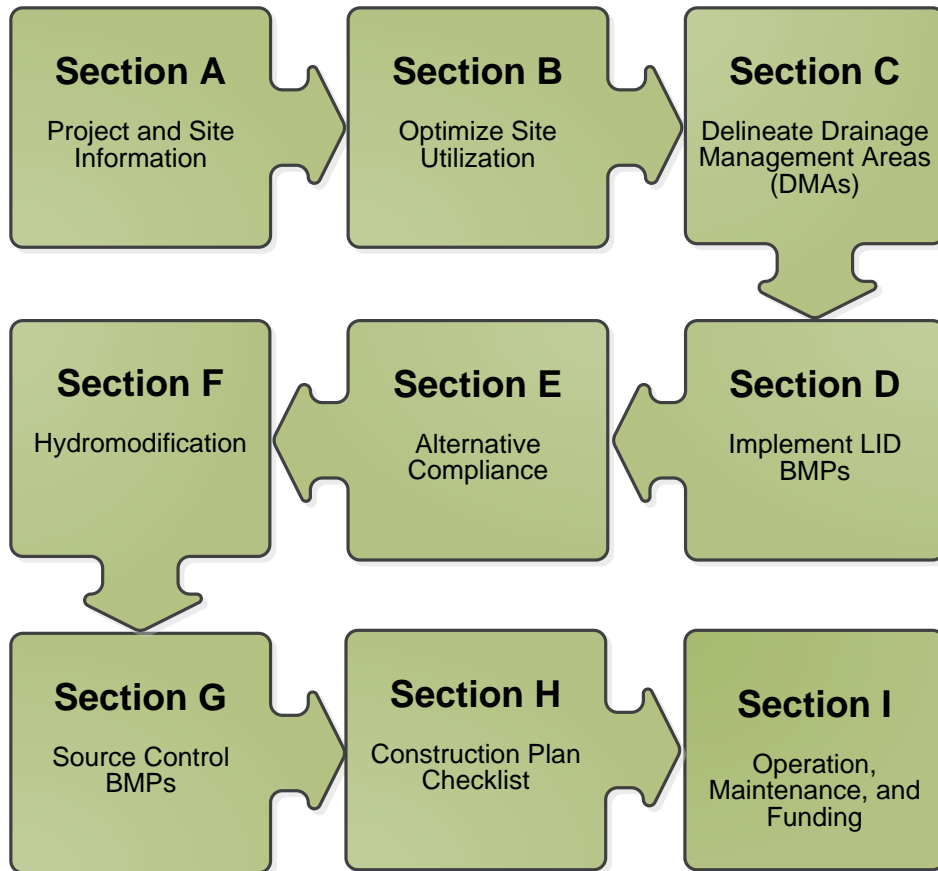

OWNER'S CERTIFICATION

This Project-Specific Water Quality Management Plan (WQMP) has been prepared for First Industrial Realty Trust by Albert A. Webb Associates for the FIR Wilson 3 project (P22-00017).

This WQMP is intended to comply with the requirements of City of Perris for Water Quality Ordinance No. 1194 which includes the requirement for the preparation and implementation of a Project-Specific WQMP.

The undersigned, while owning the property/project described in the preceding paragraph, shall be responsible for the implementation and funding of this WQMP and will ensure that this WQMP is amended as appropriate to reflect up-to-date conditions on the site. In addition, the property owner accepts responsibility for interim operation and maintenance of Stormwater BMPs until such time as this responsibility is formally transferred to a subsequent owner. This WQMP will be reviewed with the facility operator, facility supervisors, employees, tenants, maintenance and service contractors, or any other party (or parties) having responsibility for implementing portions of this WQMP. At least one copy of this WQMP will be maintained at the project site or project office in perpetuity. The undersigned is authorized to certify and to approve implementation of this WQMP. The undersigned is aware that implementation of this WQMP is enforceable under City of Perris Water Quality Ordinance (Municipal Code Section 1194).

"I, the undersigned, certify under penalty of law that the provisions of this WQMP have been reviewed and accepted and that the WQMP will be transferred to future successors in interest."

Owner's Signature

Date

Owner's Printed Name

Owner's Title/Position

PREPARER'S CERTIFICATION

"The selection, sizing and design of stormwater treatment and other stormwater quality and quantity control measures in this plan meet the requirements of Regional Water Quality Control Board Order No. **R8-2013-0024** and any subsequent amendments thereto."

Preparer's Signature

Date

Preparer's Printed Name

Preparer's Title/Position

Preparer's Licensure:

Table of Contents

Section A: Project and Site Information.....	6
A.1 Maps and Site Plans.....	6
A.2 Identify Receiving Waters.....	7
A.3 Additional Permits/Approvals required for the Project:	8
Section B: Optimize Site Utilization (LID Principles)	9
Section C: Delineate Drainage Management Areas (DMAs).....	11
Section D: Implement LID BMPs	13
D.1 Infiltration Applicability	13
D.2 Harvest and Use Assessment.....	14
D.3 Bioretention and Biotreatment Assessment	16
D.4 Feasibility Assessment Summaries	17
D.5 LID BMP Sizing	18
Section E: Alternative Compliance (LID Waiver Program)	19
E.1 Identify Pollutants of Concern	20
E.2 Stormwater Credits	21
E.3 Sizing Criteria.....	21
E.4 Treatment Control BMP Selection	22
Section F: Hydromodification	23
F.1 Hydrologic Conditions of Concern (HCOC) Analysis.....	23
F.2 HCOC Mitigation.....	24
Section G: Source Control BMPs.....	25
Section H: Construction Plan Checklist	29
Section I: Operation, Maintenance and Funding.....	30

List of Tables

Table A.1 Identification of Receiving Waters.....	7
Table A.2 Other Applicable Permits.....	8
Table C.1 DMA Classifications.....	11
Table C.2 Type 'A', Self-Treating Areas.....	11
Table C.3 Type 'B', Self-Retaining Areas.....	11
Table C.4 Type 'C', Areas that Drain to Self-Retaining Areas.....	12
Table C.5 Type 'D', Areas Draining to BMPs.....	12
Table D.1 Infiltration Feasibility.....	13
Table D.2 LID Prioritization Summary Matrix.....	17
Table D.3 DCV Calculations for LID BMPs.....	18
Table E.1 Potential Pollutants by Land Use Type.....	20
Table E.2 Water Quality Credits.....	21
Table E.3 Treatment Control BMP Sizing.....	21
Table E.4 Treatment Control BMP Selection.....	22
Table F.1 Hydrologic Conditions of Concern Summary.....	23
Table G.1 Permanent and Operational Source Control Measures.....	25
Table H.1 Construction Plan Cross-reference.....	29

List of Appendices

Appendix 1: Maps and Site Plans.....	31
Appendix 2: Construction Plans.....	32
Appendix 3: Soils Information.....	33
Appendix 4: Historical Site Conditions.....	34
Appendix 5: LID Infeasibility.....	35
Appendix 6: BMP Design Details.....	36
Appendix 7: Hydromodification.....	37
Appendix 8: Source Control.....	38
Appendix 9: O&M.....	39
Appendix 10: Educational Materials.....	- 6 -

Section A: Project and Site Information

PROJECT INFORMATION	
Type of Project:	Commercial/Industrial
Planning Area:	Mead Valley Area Plan
Community Name:	Perris Valley Commerce Center (PVCC) Specific Plan
Development Name:	FIR Wilson 3
PROJECT LOCATION	
Latitude & Longitude (DMS): 33°49'37.24", -117°12'50.84"	
Project Watershed and Sub-Watershed: Santa Ana, San Jacinto Valley	
Gross Acres: 9.9 acres	
APN(s): 300-210-014, 300-210-015, 300-210-023, 300-210-024	
Map Book and Page No.: Thomas Brothers Map: Page 777, Grid H4, J4	
PROJECT CHARACTERISTICS	
Proposed or Potential Land Use(s)	Commercial/Industrial
Proposed or Potential SIC Code(s)- 1541 (General Contractors-Industrial Building), 4225 (General Warehousing & Storage)	
Area of Impervious Project Footprint (SF)	363,850
Total Area of <u>proposed</u> Impervious Surfaces within the Project Footprint (SF)/or Replacement	363,850
Does the project consist of offsite road improvements?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Does the project propose to construct unpaved roads?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Is the project part of a larger common plan of development (phased project)?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
EXISTING SITE CHARACTERISTICS	
Total area of <u>existing</u> Impervious Surfaces within the Project limits Footprint (SF)	21,500
Is the project located within any MSHCP Criteria Cell?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
If so, identify the Cell number:	N/A
Are there any natural hydrologic features on the project site?	<input type="checkbox"/> Y <input checked="" type="checkbox"/> N
Is a Geotechnical Report attached?	<input checked="" type="checkbox"/> Y <input type="checkbox"/> N
If no Geotech. Report, list the NRCS soils type(s) present on the site (A, B, C and/or D)	N/A
What is the Water Quality Design Storm Depth for the project?	0.65

A.1 Project Description

The FIR Wilson 3 project site is located south of Rider Street, north of Placentia Avenue and situated between Wilson Avenue and Redlands Avenue. The existing land use is mostly vacant and barren with minimal vegetative scrub. There are existing developments on the northeast and southeast corners of the project site that will be demolished prior to the construction of this project; they total approximately 22,000 square feet. Existing elevations across the site vary from 1446 at the northwest corner to 1439 at the southeast corner (NAVD88 datum). The site currently slopes down at approximately 1-2% grade to the southeast. The existing drainage pattern for the site and the general area is characterized by sheet flows that follow the slope to the southeast towards Wilson Avenue.

The project proposes to build a commercial/industrial building (approximately 188,000 square feet) on approximately 9.9 gross acres. The project proposes about 179,000 square feet of roadway/truck and auto parking as well as about 46,000 square feet of landscaped area. The site totals to be approximately 88.9% impervious and 11.1% pervious.

All on-site flows generated from the project will drain to the westerly truck court area or to the easterly auto parking area through curb and gutter and ribbon gutter and directed to a proposed underground detention chamber via storm drains. The storage chamber is located in the north drive aisle of the site. The detention chamber is designed to hold the water quality design capture volume for DMA-A; high flows will be forced out of the chambers at an outlet above the chamber soffit and gravity flow to an onsite pump and thence pumped offsite via Line AC-3 to connect to Line A-C. Water quality runoff will be pumped from the chambers into a Contech Filterra unit.

The project contains some amount of self-retaining/self-treating areas and all trash enclosures will be covered.

The proposed project is within the Hydromodification exemption area based on Riverside County WAP geodatabase approved April 20, 2017. The site is in a blue area which means it is exempt from HCOC design criterion. Proposed land use flowrates will not be required to match existing land use flowrates.

The project is located within the Perris Valley Commerce Center (PVCC) specific plan and is also within the Perris Valley Master Drainage Plan (PVM DP) adopted July 1987 and revised June 1991. This project is tabled to discharge into existing MDP Line A-C. Line A-C will be built with FIR Wilson 1 (P19-00007) and designed per guidelines listed in the Line A-B, Line A-C Flow Reallocation Memo (See Wilson 3 drainage report for more information).

A.2 Maps and Site Plans

When completing your Project-Specific WQMP, include a map of the local vicinity and existing site. In addition, include all grading, drainage, landscape/plant palette and other pertinent construction plans in Appendix 2. At a **minimum**, your WQMP Site Plan should include the following:

- Drainage Management Areas
- Proposed Structural BMPs
- Drainage Path
- Drainage Infrastructure, Inlets, Overflows
- Source Control BMPs
- Buildings, Roof Lines, Downspouts
- Impervious Surfaces
- Standard Labeling
- BMP Locations (Lat/Long)

Use your discretion on whether or not you may need to create multiple sheets or can appropriately accommodate these features on one or two sheets. Keep in mind that the Co-Permittee plan reviewer must be able to easily analyze your project utilizing this template and its associated site plans and maps.

A.3 Identify Receiving Waters

Using Table A.1 below, list in order of upstream to downstream, the receiving waters that the project site is tributary to. Continue to fill each row with the Receiving Water’s 303(d) listed impairments (if any), designated beneficial uses, and proximity, if any, to a RARE beneficial use. Include a map of the receiving waters in Appendix 1.

Table A.1 Identification of Receiving Waters

Receiving Waters	EPA Approved 303(d) List Impairments	Designated Beneficial Uses	Proximity to RARE Beneficial Use
Perris Valley Storm Drain Channel	None	None	Not a water body classified as RARE

San Jacinto River (Reach 3) (HU# 802.11)	None	Intermittent: MUN, AGR, GWR, REC1, REC2, WARM, WILD	Not a water body classified as RARE
San Jacinto River (Reach 2) (HU# 802.11)	None	Intermittent: MUN, AGR, GWR, REC1, REC2, WARM, WILD	Not a water body classified as RARE
Canyon Lake (HU# 802.11, 802.12)	Nutrients, Pathogens	MUN, AGR, GWR, REC1, REC2, WARM, WILD	Not a water body classified as RARE
San Jacinto River (Reach 1) (HU# 802.31, 802.32)	None	MUN, AGR, GWR, REC1, REC2, WARM, WILD	Not a water body classified as RARE
Lake Elsinore (HU# 802.31)	PCBs, (Organic Compound), Nutrients, Organic Enrichment (Low DO), Sediment Toxicity, Unknown Toxicity	REC1, REC2, WARM, WILD	Not a water body classified as RARE

A.4 Additional Permits/Approvals required for the Project:

Table A.2 Other Applicable Permits

Agency	Permit Required	
State Department of Fish and Game, 1602 Streambed Alteration Agreement	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
State Water Resources Control Board, Clean Water Act (CWA) Section 401 Water Quality Cert.	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
US Army Corps of Engineers, CWA Section 404 Permit	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
US Fish and Wildlife, Endangered Species Act Section 7 Biological Opinion	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
Statewide Construction General Permit Coverage	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
Statewide Industrial General Permit Coverage (dependent on tenant)	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N
Western Riverside MSHCP Consistency Approval (e.g., JPR, DBESP)	<input type="checkbox"/> Y	<input checked="" type="checkbox"/> N
Other (please list in the space below as required) Grading Permit	<input checked="" type="checkbox"/> Y	<input type="checkbox"/> N

If yes is answered to any of the questions above, the Co-Permittee may require proof of approval/coverage from those agencies as applicable including documentation of any associated requirements that may affect this Project-Specific WQMP.

Section B: Optimize Site Utilization (LID Principles)

Review of the information collected in Section 'A' will aid in identifying the principal constraints on site design and selection of LID BMPs as well as opportunities to reduce imperviousness and incorporate LID Principles into the site and landscape design. For example, **constraints** might include impermeable soils, high groundwater, groundwater pollution or contaminated soils, steep slopes, geotechnical instability, high-intensity land use, heavy pedestrian or vehicular traffic, utility locations or safety concerns. **Opportunities** might include existing natural areas, low areas, oddly configured or otherwise unbuildable parcels, easements and landscape amenities including open space and buffers (which can double as locations for bioretention BMPs), and differences in elevation (which can provide hydraulic head). Prepare a brief narrative for each of the site optimization strategies described below. This narrative will help you as you proceed with your LID design and explain your design decisions to others.

The 2010 Santa Ana MS4 Permit further requires that LID Retention BMPs (Infiltration Only or Harvest and Use) be used unless it can be shown that those BMPs are infeasible. Therefore, it is important that your narrative identify and justify if there are any constraints that would prevent the use of those categories of LID BMPs. Similarly, you should also note opportunities that exist which will be utilized during project design. Upon completion of identifying Constraints and Opportunities, include these on your WQMP Site plan in Appendix 1.

Consideration of "highest and best use" of the discharge should also be considered. For example, Lake Elsinore is evaporating faster than runoff from natural precipitation can recharge it. Requiring infiltration of 85% of runoff events for projects tributary to Lake Elsinore would only exacerbate current water quality problems associated with Pollutant concentration due to lake water evaporation. In cases where rainfall events have low potential to recharge Lake Elsinore (i.e. no hydraulic connection between groundwater to Lake Elsinore, or other factors), requiring infiltration of Urban Runoff from projects is counterproductive to the overall watershed goals. Project proponents, in these cases, would be allowed to discharge Urban Runoff, provided they used equally effective filtration-based BMPs.

Site Optimization

The following questions are based upon Section 3.2 of the WQMP Guidance Document. Review of the WQMP Guidance Document will help you determine how best to optimize your site and subsequently identify opportunities and/or constraints, and document compliance.

Did you identify and preserve existing drainage patterns? If so, how? If not, why?

The natural drainage patterns have generally been preserved where possible. The proposed site conveys surface flows to inlets on the east and west sides of the project site, then to a detention chamber on the north end of the site, where it will then connect to the storm drain in Wilson Avenue.

Did you identify and protect existing vegetation? If so, how? If not, why?

No, most of the site is vacant. Existing buildings and vegetation associated with the existing buildings will be removed. There are no dense areas of vegetation.

Did you identify and preserve natural infiltration capacity? If so, how? If not, why?

Per the attached infiltration and geotechnical reports, the recommended design infiltration rate is 0.8 in/hr. This is below the recommended 1.6 in/hr for infiltration BMPs; therefore infiltration is not feasible for this site.

Did you identify and minimize impervious area? If so, how? If not, why?

The site contains the standard impervious area per code for the given land use. The minimum required landscape area is 10% per PVCC-SP Section 13.2.7, this project provides a 10% pervious area including self-retaining/self-treating and media area.

Did you identify and disperse runoff to adjacent pervious areas? If so, how? If not, why?

Runoff for both DMAs A and B is directed towards the underground chamber.

Section C: Delineate Drainage Management Areas (DMAs)

Utilizing the procedure in Section 3.3 of the WQMP Guidance Document which discusses the methods of delineating and mapping your project site into individual DMAs, complete Table C.1 below to appropriately categorize the types of classification (e.g., Type A, Type B, etc.) per DMA for your project site. Upon completion of this table, this information will then be used to populate and tabulate the corresponding tables for their respective DMA classifications.

Table C.1 DMA Classifications

DMA Name or ID	Surface Type(s) ¹²	Area (Sq. Ft.)	DMA Type
L-A	LANDSCAPE	28,055	D
R-A	ROOF	188,337	D
H-A	HARDSCAPE	179,185	D
SR-A	LANDSCAPE	18,039	B

¹Reference Table 2-1 in the WQMP Guidance Document to populate this column

²If multi-surface provide back-up

Table C.2 Type 'A', Self-Treating Areas

DMA Name or ID	Area (Sq. Ft.)	Stabilization Type	Irrigation Type (if any)
N/A	N/A	N/A	N/A

Table C.3 Type 'B', Self-Retaining Areas

Self-Retaining Area				Type 'C' DMAs that are draining to the Self-Retaining Area		
DMA Name/ ID	Post-project surface type	Area (square feet)	Storm Depth (inches)	DMA Name ID	[C] from Table C.4 = [C]	Required Retention Depth (inches)
		[A]	[B]			[D]
SR-A	LANDSCAPE	18,039	0.65	N/A	N/A	0.65

$$[D] = [B] + \frac{[B] \cdot [C]}{[A]}$$

Table C.4 Type 'C', Areas that Drain to Self-Retaining Areas

DMA					Receiving Self-Retaining DMA		
DMA Name/ ID	Area (square feet)	Post-project surface type	Impervious fraction	Product	DMA name /ID	Area (square feet)	Ratio
	[A]		[B]			[C] = [A] x [B]	
N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A

Table C.5 Type 'D', Areas Draining to BMPs

DMA Name or ID	BMP Name or ID
L-A	BMP-A (Contech Filterra Unit)
R-A	
H-A	

Note: More than one drainage management area can drain to a single LID BMP, however, one drainage management area may not drain to more than one BMP.

Section D: Implement LID BMPs

D.1 Infiltration Applicability

Is there an approved downstream ‘Highest and Best Use’ for stormwater runoff (see discussion in Chapter 2.4.4 of the WQMP Guidance Document for further details)? Y N

If yes has been checked, Infiltration BMPs shall not be used for the site; proceed to section D.3

If no, continue working through this section to implement your LID BMPs. It is recommended that you contact your Co-Permittee to verify whether or not your project discharges to an approved downstream ‘Highest and Best Use’ feature.

Geotechnical Report

A Geotechnical Report or Phase I Environmental Site Assessment may be required by the Copermitee to confirm present and past site characteristics that may affect the use of Infiltration BMPs. In addition, the Co-Permittee, at their discretion, may not require a geotechnical report for small projects as described in Chapter 2 of the WQMP Guidance Document. If a geotechnical report has been prepared, include it in Appendix 3. In addition, if a Phase I Environmental Site Assessment has been prepared, include it in Appendix 4.

Is this project classified as a small project consistent with the requirements of Chapter 2 of the WQMP Guidance Document? Y N

Infiltration Feasibility

Table D.1 below is meant to provide a simple means of assessing which DMAs on your site support Infiltration BMPs and is discussed in the WQMP Guidance Document in Chapter 2.4.5. Check the appropriate box for each question and then list affected DMAs as applicable. If additional space is needed, add a row below the corresponding answer.

Table D.1 Infiltration Feasibility

Does the project site...	YES	NO
...have any DMAs with a seasonal high groundwater mark shallower than 10 feet? If Yes, list affected DMAs:		X
...have any DMAs located within 100 feet of a water supply well? If Yes, list affected DMAs:		X
...have any areas identified by the geotechnical report as posing a public safety risk where infiltration of stormwater could have a negative impact? If Yes, list affected DMAs: DMA-A	X	
...have measured in-situ infiltration rates of less than 1.6 inches / hour? If Yes, list affected DMAs: DMA-A: 0.8 in/hr	X	
...have significant cut and/or fill conditions that would preclude in-situ testing of infiltration rates at the final infiltration surface? If Yes, list affected DMAs:		X
...geotechnical report identify other site-specific factors that would preclude effective and safe infiltration? Describe here: Potential for collapse when exposed to moisture infiltration and increased load	X	

If you answered “Yes” to any of the questions above for any DMA, Infiltration BMPs should not be used for those DMAs and you should proceed to the assessment for Harvest and Use below.

D.2 Harvest and Use Assessment

Please check what applies:

- Reclaimed water will be used for the non-potable water demands for the project.
- Downstream water rights may be impacted by Harvest and Use as approved by the Regional Board (verify with the Copermittee).
- The Design Capture Volume will be addressed using Infiltration Only BMPs. In such a case, Harvest and Use BMPs are still encouraged, but it would not be required if the Design Capture Volume will be infiltrated or evapotranspired.

If any of the above boxes have been checked, Harvest and Use BMPs need not be assessed for the site. If none of the above criteria applies, follow the steps below to assess the feasibility of irrigation use, toilet use and other non-potable uses (e.g., industrial use).

Irrigation Use Feasibility

Complete the following steps to determine the feasibility of harvesting stormwater runoff for Irrigation Use BMPs on your site:

Step 1: Identify the total area of irrigated landscape on the site, and the type of landscaping used.

Total Area of Irrigated Landscape: N/A

Type of Landscaping (Conservation Design or Active Turf): N/A

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for irrigation use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: N/A

Step 3: Cross reference the Design Storm depth for the project site (see Exhibit A of the WQMP Guidance Document) with the left column of Table 2-3 in Chapter 2 to determine the minimum area of Effective Irrigated Area per Tributary Impervious Area (EIATIA).

Enter your EIATIA factor: N/A

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum irrigated area that would be required.

Minimum required irrigated area: N/A

Step 5: Determine if harvesting stormwater runoff for irrigation use is feasible for the project by comparing the total area of irrigated landscape (Step 1) to the minimum required irrigated area (Step 4).

Minimum required irrigated area (Step 4)	Available Irrigated Landscape (Step 1)
N/A	N/A

Toilet Use Feasibility

Complete the following steps to determine the feasibility of harvesting stormwater runoff for toilet flushing uses on your site:

Step 1: Identify the projected total number of daily toilet users during the wet season, and account for any periodic shut downs or other lapses in occupancy:

Projected Number of Daily Toilet Users: N/A

Project Type: N/A

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for toilet use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: N/A

Step 3: Enter the Design Storm depth for the project site (see Exhibit A) into the left column of Table 2-2 in Chapter 2 to determine the minimum number of toilet users per tributary impervious acre (TUTIA).

Enter your TUTIA factor: N/A

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum number of toilet users that would be required.

Minimum number of toilet users: N/A

Step 5: Determine if harvesting stormwater runoff for toilet flushing use is feasible for the project by comparing the Number of Daily Toilet Users (Step 1) to the minimum required number of toilet users (Step 4).

Minimum required Toilet Users (Step 4)	Projected number of toilet users (Step 1)
N/A	N/A

Other Non-Potable Use Feasibility

Are there other non-potable uses for stormwater runoff on the site (e.g. industrial use)? See Chapter 2 of the Guidance for further information. If yes, describe below. If no, write N/A.

N/A

Step 1: Identify the projected average daily non-potable demand, in gallons per day, during the wet season and accounting for any periodic shut downs or other lapses in occupancy or operation.

Average Daily Demand: N/A

Step 2: Identify the planned total of all impervious areas on the proposed project from which runoff might be feasibly captured and stored for the identified non-potable use. Depending on the configuration of buildings and other impervious areas on the site, you may consider the site as a whole, or parts of the site, to evaluate reasonable scenarios for capturing and storing runoff and directing the stored runoff to the potential use(s) identified in Step 1 above.

Total Area of Impervious Surfaces: N/A

Step 3: Enter the Design Storm depth for the project site (see Exhibit A) into the left column of Table 2-4 in Chapter 2 to determine the minimum demand for non-potable uses per tributary impervious acre.

Enter the factor from Table 2-4: N/A

Step 4: Multiply the unit value obtained from Step 3 by the total of impervious areas from Step 2 to develop the minimum number of gallons per day of non-potable use that would be required.

Minimum required use: N/A

Step 5: Determine if harvesting stormwater runoff for other non-potable use is feasible for the project by comparing the projected average daily use (Step 1) to the minimum required non-potable use (Step 4).

Minimum required non-potable use (Step 4)	Projected average daily use (Step 1)
N/A	N/A

If Irrigation, Toilet and Other Use feasibility anticipated demands are less than the applicable minimum values, Harvest and Use BMPs are not required and you should proceed to utilize LID Bioretention and Biotreatment per Section 3.4.2 of the WQMP Guidance Document.

D.3 Bioretention and Biotreatment Assessment

Other LID Bioretention and Biotreatment BMPs as described in Chapter 2.4.7 of the WQMP Guidance Document are feasible on nearly all development sites with sufficient advance planning.

Select one of the following:

- LID Bioretention/Biotreatment BMPs will be used for some or all DMAs of the project as noted below in Section D.4 (note the requirements of Section 3.4.2 in the WQMP Guidance Document).
- A site-specific analysis demonstrating the technical infeasibility of all LID BMPs has been performed and is included in Appendix 5. If you plan to submit an analysis demonstrating the technical infeasibility of LID BMPs, request a pre-submittal meeting with the Copermittee to discuss this option. Proceed to Section E to document your alternative compliance measures.

D.4 Feasibility Assessment Summaries

From the Infiltration, Harvest and Use, Bioretention and Biotreatment Sections above, complete Table D.2 below to summarize which LID BMPs are technically feasible, and which are not, based upon the established hierarchy.

Table D.2 LID Prioritization Summary Matrix

DMA Name/ID	LID BMP Hierarchy				No LID (Alternative Compliance)
	1. Infiltration	2. Harvest and use	3. Bioretention	4. Biotreatment	
DMA-A	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>

For those DMAs where LID BMPs are not feasible, provide a brief narrative below summarizing why they are not feasible, include your technical infeasibility criteria in Appendix 5, and proceed to Section E below to document Alternative Compliance measures for those DMAs. Recall that each proposed DMA must pass through the LID BMP hierarchy before alternative compliance measures may be considered.

Based on the LID BMP Hierarchy, the project will utilize bioretention and biotreatment for water quality requirements. Infiltration based BMPs are not feasible due to the inadequate infiltration rates on the site as determined by the geotechnical investigation. Harvest and use BMPs are not feasible as reclaimed water will be used for the non-potable water demands.

Based on the functionality and composition of the Contech Bioscape Filterra system, it operates as a biotreatment facility and is proposed as the water quality treatment method for DMA D. Due to the system being proprietary, it is being classified as "Alternative Compliance" in Table D.2. Sizing information can be found in Table D.3.

D.5 LID BMP Sizing

Each LID BMP must be designed to ensure that the Design Capture Volume will be addressed by the selected BMPs. First, calculate the Design Capture Volume for each LID BMP using the V_{BMP} worksheet in Appendix F of the LID BMP Design Handbook. Second, design the LID BMP to meet the required V_{BMP} using a method approved by the Copermittee. Utilize the worksheets found in the LID BMP Design Handbook or consult with your Copermittee to assist you in correctly sizing your LID BMPs. Complete Table D.3 below to document the Design Capture Volume and the Proposed Volume for each LID BMP. Provide the completed design procedure sheets for each LID BMP in Appendix 6. You may add additional rows to the table below as needed.

Table D.3 DCV Calculations for LID BMPs

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	<i>BMP-A – Contech BioScape Filterra System</i>		
	[A]							
<i>L-A</i>	28,055	<i>Landscape</i>	0.1	0.11	4,181.9	<i>Design Storm Depth (in)</i>	<i>Design Capture Volume, V_{BMP} (cubic feet)</i>	<i>Proposed Volume on Plans (cubic feet)</i>
<i>H-A</i>	179,185	<i>Hardscape</i>	1	0.89	161,255.8			
<i>R-A</i>	188,337	<i>Roofs</i>	1	0.89	162,085.3			
<i>SR-A</i>	18,039	<i>Landscape</i>	0.1	0.11	1,392.9			
	413,616				332,921.1	0.65	18,033.2	18,064

[B], [C] is obtained as described in Section 2.3.1 of the WQMP Guidance Document

[E] is obtained from Exhibit A in the WQMP Guidance Document

[G] is obtained from a design procedure sheet, such as in LID BMP Design Handbook and placed in Appendix 6

Section E: Alternative Compliance (LID Waiver Program)

LID BMPs are expected to be feasible on virtually all projects. Where LID BMPs have been demonstrated to be infeasible as documented in Section D, other Treatment Control BMPs must be used (subject to LID waiver approval by the Copermittee). Check one of the following Boxes:

LID Principles and LID BMPs have been incorporated into the site design to fully address all Drainage Management Areas. No alternative compliance measures are required for this project and thus this Section is not required to be completed.

- Or -

The following Drainage Management Areas are unable to be addressed using LID BMPs. A site-specific analysis demonstrating technical infeasibility of LID BMPs has been approved by the Co-Permittee and included in Appendix 5. Additionally, no downstream regional and/or sub-regional LID BMPs exist or are available for use by the project. The following alternative compliance measures on the following pages are being implemented to ensure that any pollutant loads expected to be discharged by not incorporating LID BMPs, are fully mitigated.

E.1 Identify Pollutants of Concern

Utilizing Table A.1 from Section A above which noted your project's receiving waters and their associated EPA approved 303(d) listed impairments, cross reference this information with that of your selected Priority Development Project Category in Table E.1 below. If the identified General Pollutant Categories are the same as those listed for your receiving waters, then these will be your Pollutants of Concern and the appropriate box or boxes will be checked on the last row. The purpose of this is to document compliance and to help you appropriately plan for mitigating your Pollutants of Concern in lieu of implementing LID BMPs.

Table E.1 Potential Pollutants by Land Use Type

Priority Development Project Categories and/or Project Features (check those that apply)	General Pollutant Categories							
	Bacterial Indicators	Metals	Nutrients	Pesticides	Toxic Organic Compounds	Sediments	Trash & Debris	Oil & Grease
<input type="checkbox"/> Detached Residential Development	P	N	P	P	N	P	P	P
<input type="checkbox"/> Attached Residential Development	P	N	P	P	N	P	P	P ⁽²⁾
<input checked="" type="checkbox"/> Commercial/Industrial Development	P ⁽³⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁵⁾	P ⁽¹⁾	P	P
<input type="checkbox"/> Automotive Repair Shops	N	P	N	N	P ^(4, 5)	N	P	P
<input type="checkbox"/> Restaurants (>5,000 ft ²)	P	N	N	N	N	N	P	P
<input type="checkbox"/> Hillside Development (>5,000 ft ²)	P	N	P	P	N	P	P	P
<input checked="" type="checkbox"/> Parking Lots (>5,000 ft ²)	P ⁽⁶⁾	P	P ⁽¹⁾	P ⁽¹⁾	P ⁽⁴⁾	P ⁽¹⁾	P	P
<input type="checkbox"/> Retail Gasoline Outlets	N	P	N	N	P	N	P	P
Project Priority Pollutant(s) of Concern	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>

P = Potential

N = Not Potential

⁽¹⁾ A potential Pollutant if non-native landscaping exists or is proposed onsite; otherwise not expected

⁽²⁾ A potential Pollutant if the project includes uncovered parking areas; otherwise not expected

⁽³⁾ A potential Pollutant is land use involving animal waste

⁽⁴⁾ Specifically petroleum hydrocarbons

⁽⁵⁾ Specifically solvents

⁽⁶⁾ Bacterial indicators are routinely detected in pavement runoff

E.2 Stormwater Credits

Projects that cannot implement LID BMPs but nevertheless implement smart growth principles are potentially eligible for Stormwater Credits. Utilize Table 3-8 within the WQMP Guidance Document to identify your Project Category and its associated Water Quality Credit. If not applicable, write N/A.

Table E.2 Water Quality Credits

Qualifying Project Categories	Credit Percentage ²
N/A	
Total Credit Percentage ¹	

¹Cannot Exceed 50%

²Obtain corresponding data from Table 3-8 in the WQMP Guidance Document

E.3 Sizing Criteria

After you appropriately considered Stormwater Credits for your project, utilize Table E.3 below to appropriately size them to the DCV, or Design Flow Rate, as applicable. Please reference Chapter 3.5.2 of the WQMP Guidance Document for further information.

Table E.3 Treatment Control BMP Sizing

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Impervious Fraction, I _f	DMA Runoff Factor	DMA Area x Runoff Factor	BMP-A – Contech BioScape Filterra System			
	[A]		[B]	[C]	[A] x [C]				
N/A									
						Design Storm Depth (in)	Minimum Design Capture Volume or Design Flow Rate (cubic feet or cfs)	Total Storm Water Credit % Reduction	Proposed Volume or Flow on Plans (cubic feet or cfs)
	$A_T = \Sigma[A]$				$\Sigma = [D]$	[E]	$[F] = \frac{[D] \times [E]}{[G]}$	$[F] \times (1 - [H])$	[I]

[B], [C] is obtained as described in Section 2.3.1 from the WQMP Guidance Document

[E] is for Flow-Based Treatment Control BMPs [E] = .2, for Volume-Based Control Treatment BMPs, [E] obtained from Exhibit A in the WQMP Guidance Document

[G] is for Flow-Based Treatment Control BMPs [G] = 43,560, for Volume-Based Control Treatment BMPs, [G] = 12

[H] is from the Total Credit Percentage as Calculated from Table E.2 above

[I] as obtained from a design procedure sheet from the BMP manufacturer and should be included in Appendix 6

E.4 Treatment Control BMP Selection

Treatment Control BMPs typically provide proprietary treatment mechanisms to treat potential pollutants in runoff, but do not sustain significant biological processes. Treatment Control BMPs must have a removal efficiency of a medium or high effectiveness as quantified below:

- **High:** equal to or greater than 80% removal efficiency
- **Medium:** between 40% and 80% removal efficiency

Such removal efficiency documentation (e.g., studies, reports, etc.) as further discussed in Chapter 3.5.2 of the WQMP Guidance Document, must be included in Appendix 6. In addition, ensure that proposed Treatment Control BMPs are properly identified on the WQMP Site Plan in Appendix 1.

Table E.4 Treatment Control BMP Selection

Selected Treatment Control BMP Name or ID ¹	Priority Pollutant(s) of Concern to Mitigate ²	Removal Efficiency Percentage ³
Contech Filterra BioScape (BMP-A)	TSS/TOC	66%-85%
	Nutrients	73%

¹ Treatment Control BMPs must not be constructed within Receiving Waters. In addition, a proposed Treatment Control BMP may be listed more than once if they possess more than one qualifying pollutant removal efficiency.

² Cross Reference Table E.1 above to populate this column.

³ As documented in a Co-Permittee Approved Study and provided in Appendix 6.

Section F: Hydromodification

F.1 Hydrologic Conditions of Concern (HCOC) Analysis

Once you have determined that the LID design is adequate to address water quality requirements, you will need to assess if the proposed LID Design may still create a HCOC. Review Chapters 2 and 3 (including Figure 3-7) of the WQMP Guidance Document to determine if your project must mitigate for Hydromodification impacts. If your project meets one of the following criteria which will be indicated by the check boxes below, you do not need to address Hydromodification at this time. However, if the project does not qualify for Exemptions 1, 2 or 3, then additional measures must be added to the design to comply with HCOC criteria. This is discussed in further detail below in Section F.2.

HCOC EXEMPTION 1: The Priority Development Project disturbs less than one acre. The Copermitttee has the discretion to require a Project-Specific WQMP to address HCOCs on projects less than one acre on a case by case basis. The disturbed area calculation should include all disturbances associated with larger common plans of development.

Does the project qualify for this HCOC Exemption? Y N

If Yes, HCOC criteria do not apply.

HCOC EXEMPTION 2: The volume and time of concentration¹ of storm water runoff for the post-development condition is not significantly different from the pre-development condition for a 2-year return frequency storm (a difference of 5% or less is considered insignificant) using one of the following methods to calculate:

- Riverside County Hydrology Manual
- Technical Release 55 (TR-55): Urban Hydrology for Small Watersheds (NRCS 1986), or derivatives thereof, such as the Santa Barbara Urban Hydrograph Method
- Other methods acceptable to the Co-Permittee

Does the project qualify for this HCOC Exemption? Y N

If Yes, report results in Table F.1 below and provide your substantiated hydrologic analysis in Appendix 7.

Table F.1 Hydrologic Conditions of Concern Summary

	2 year – 24 hour		
	Pre-condition	Post-condition	% Difference
Time of Concentration	INSERT VALUE	INSERT VALUE	INSERT VALUE
Volume (Cubic Feet)	INSERT VALUE	INSERT VALUE	INSERT VALUE

¹ Time of concentration is defined as the time after the beginning of the rainfall when all portions of the drainage basin are contributing to flow at the outlet.

HCOC EXEMPTION 3: All downstream conveyance channels to an adequate sump (for example, Prado Dam, Lake Elsinore, Canyon Lake, Santa Ana River, or other lake, reservoir or naturally erosion resistant feature) that will receive runoff from the project are engineered and regularly maintained to ensure design flow capacity; no sensitive stream habitat areas will be adversely affected; or are not identified on the Co-Permittees Hydromodification Susceptibility Maps.

Does the project qualify for this HCOC Exemption? Y N

If Yes, HCOC criteria do not apply and note below which adequate sump applies to this HCOC qualifier:

F.2 HCOC Mitigation

If none of the above HCOC Exemption Criteria are applicable, HCOC criteria is considered mitigated if they meet one of the following conditions:

- a. Additional LID BMPS are implemented onsite or offsite to mitigate potential erosion or habitat impacts as a result of HCOCs. This can be conducted by an evaluation of site-specific conditions utilizing accepted professional methodologies published by entities such as the California Stormwater Quality Association (CASQA), the Southern California Coastal Water Research Project (SCCRWP), or other Co-Permittee approved methodologies for site-specific HCOC analysis.
- b. The project is developed consistent with an approved Watershed Action Plan that addresses HCOC in Receiving Waters.
- c. Mimicking the pre-development hydrograph with the post-development hydrograph, for a 2-year return frequency storm. Generally, the hydrologic conditions of concern are not significant, if the post-development hydrograph is no more than 10% greater than pre-development hydrograph. In cases where excess volume cannot be infiltrated or captured and reused, discharge from the site must be limited to a flow rate no greater than 110% of the pre-development 2-year peak flow.

Be sure to include all pertinent documentation used in your analysis of the items a, b or c in Appendix 7.

The project is located within the HCOC Exemption area as found in the approved Riverside County HCOC Applicability Map dated April 20, 2017. See Appendix 7 for approved HCOC Applicability Map.

Section G: Source Control BMPs

Source control BMPs include permanent, structural features that may be required in your project plans — such as roofs over and berms around trash and recycling areas — and Operational BMPs, such as regular sweeping and “housekeeping”, that must be implemented by the site’s occupant or user. The MEP standard typically requires both types of BMPs. In general, Operational BMPs cannot be substituted for a feasible and effective permanent BMP. Using the Pollutant Sources/Source Control Checklist in Appendix 8, review the following procedure to specify Source Control BMPs for your site:

1. **Identify Pollutant Sources:** Review Column 1 in the Pollutant Sources/Source Control Checklist. Check off the potential sources of Pollutants that apply to your site.
2. **Note Locations on Project-Specific WQMP Exhibit:** Note the corresponding requirements listed in Column 2 of the Pollutant Sources/Source Control Checklist. Show the location of each Pollutant source and each permanent Source Control BMP in your Project-Specific WQMP Exhibit located in Appendix 1.
3. **Prepare a Table and Narrative:** Check off the corresponding requirements listed in Column 3 in the Pollutant Sources/Source Control Checklist. In the left column of Table G.1 below, list each potential source of runoff Pollutants on your site (from those that you checked in the Pollutant Sources/Source Control Checklist). In the middle column, list the corresponding permanent, Structural Source Control BMPs (from Columns 2 and 3 of the Pollutant Sources/Source Control Checklist) used to prevent Pollutants from entering runoff. **Add additional narrative** in this column that explains any special features, materials or methods of construction that will be used to implement these permanent, Structural Source Control BMPs.
4. **Identify Operational Source Control BMPs:** To complete your table, refer once again to the Pollutant Sources/Source Control Checklist. List in the right column of your table the Operational BMPs that should be implemented as long as the anticipated activities continue at the site. Copermittee stormwater ordinances require that applicable Source Control BMPs be implemented; the same BMPs may also be required as a condition of a use permit or other revocable Discretionary Approval for use of the site.

Table G.1 Permanent and Operational Source Control Measures

Potential Sources of Runoff pollutants	Permanent Structural Source Control BMPs	Operational Source Control BMPs
A. On-site storm drain inlets	Mark all inlets with the works “Only Rain Down the Storm Drain” or similar. Catch Basin Markers may be available from the Riverside County Flood Control and Water Conservation District, call 951-955-1200 to verify.	Maintain and periodically repaint or replace inlet markings. Provide stormwater pollution prevention information to new site owners, lessees, or operators. See applicable operational BMPs in Fact Sheet SC-44, “Drainage System Maintenance,” in Appendix 10 (CASQA Stormwater Quality Handbook at www.cabmphandbooks.com)

	<p><i>On-site drainage structures, including all storm drain clean outs, area drains, inlets, catch basins, inlet & outlet structures, forebays, & water treatment control basins shall be inspected and maintained on a regular basis to insure their operational adequacy.</i></p>	<p><i>Include the following in lessee agreements: "Tenants shall not allow anyone to discharge anything to storm drains or to store or deposit materials so as to create a potential discharge to storm drains"</i></p> <p><i>Maintenance should include removal of trash, debris, & sediment and the repair of any deficiencies or damage that may impact water quality.</i></p>
<p><i>B. Interior floor drains and elevator shaft sump</i></p>	<p><i>The interior floor drains and elevator shaft sump pumps will be plumbed to sanitary sewer</i></p>	<p><i>Inspect and maintain drains to prevent blockages and overflow.</i></p>
<p><i>C. Need for future indoor & structural pest control</i></p>	<p><i>Note building design features that discourage entry of pests.</i></p>	<p><i>Provide Integrated Pest Management information to owners, lessees, and operators.</i></p>
<p><i>D. Landscape/Outdoor Pesticide Use</i></p>	<p><i>The final landscape shall be designed to accomplish all of the following:</i></p> <p><i>Preserve existing native trees, shrubs and ground cover to the maximum extent possible.</i></p> <p><i>Design landscape to minimize irrigation and runoff, to promote surface infiltration where appropriate and to minimize the use of fertilizers and pesticides that can contribute to stormwater pollution.</i></p> <p><i>Where landscaped areas are used to retain or detain stormwater, specify plants that are tolerant of saturated soil conditions.</i></p> <p><i>Consider using pest-resistant plants, especially adjacent to hardscape.</i></p> <p><i>To insure successful establishments, select plants appropriate to site, soils, slopes, climate, sun, wind, rain, land use, air movement, ecological consistency and plant interactions.</i></p> <p><i>Pesticide usage should be at a necessary minimum and be consistent with the instructions contained on product labels and with the regulations administered by</i></p>	

	<p><i>the State Department of Pesticide Regulation. Pesticides should be used at an absolute minimum or not at all in the retention/infiltration basin. If used, it should not be applied in close proximity to the rainy season.</i></p>	
<p><i>E. Refuse Trash Storage areas</i></p>	<p><i>Trash container storage areas shall be paved with an impervious surface, designed not to allow run-on from adjoining areas, designed to divert drainage from adjoining roofs and pavements from the surrounding area, and screened or walled to prevent off-site transport of trash.</i></p> <p><i>Trash dumpsters (containers) shall be leak proof and have attached covers or lids.</i></p> <p><i>Trash enclosures shall be roofed per City standards and the details on the PWQMP Exhibit in Appendix 1.</i></p> <p><i>Trash compactors shall be roofed and set on a concrete pad per City standards. The pad shall be a minimum of one foot larger all around than the trash compactor and sloped to drain to a sanitary sewer line. Connection of trash area drains to the MS4 is prohibited.</i></p> <p><i>See CASQA SD-32 BMP Fact Sheets in Appendix 10 for additional information.</i></p> <p><i>Signs shall be posted on or near dumpsters with the words "Do not dump hazardous materials here" or similar.</i></p>	<p><i>Adequate number of receptacles shall be provided. Inspect receptacles regularly; repair or replace leaky receptacles. Keep receptacles covered. Prohibit/prevent dumping of liquid or hazardous wastes. Post "no hazardous materials" signs. Inspect and pick up litter daily and clean up spills immediately. Keep spill control materials available on-site. See Fact Sheet SC-34, in Appendix 10, "Waste Handling and Disposal" in the CASQA Stormwater Quality Handbook</i></p> <p><i>at www.cabmphandbooks.com</i></p>
<p><i>F. Loading Docks</i></p>	<p><i>Loading docks will not be covered and are 4 feet above finished pavement surface.</i></p> <p><i>Spill kits are to be kept on-site at all times per SC-11</i></p>	<p><i>Move loaded and unloaded items indoors as soon as possible.</i></p> <p><i>Inspect for accumulated trash and debris. Implement good housekeeping procedures on a regular basis. Sweep areas clean instead of using wash water. Loading docks will be kept in a clean and orderly condition, through a regular program of sweeping and litter control, and immediate clean up of any spills or broken containers. Property owner will ensure that loading docks will be swept as</i></p>

		<p><i>needed. Cleanup procedures will not include the use of wash-down water. Property owner will be responsible for implementation of loading dock housekeeping procedures</i></p> <p><i>See the Fact Sheet SC-30, in Appendix 10, "Outdoor Loading and Unloading" in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i></p>
G. Fire Sprinkler Test Water	<p><i>Provide a means to drain fire sprinkler test water to the sanitary sewer.</i></p>	<p><i>See the note in the Fact Sheet SC-41, in Appendix 10, "Building and Grounds Maintenance", in the CASQA Stormwater Quality Handbooks at www.cabmphandbooks.com</i></p>
<p>H. Miscellaneous Drain or Wash Water or Other Sources</p> <p><i>Boiler drain lines</i></p> <p><i>Condensate drain lines</i></p> <p><i>Rooftop equipment</i></p> <p><i>Drainage sumps</i></p> <p><i>Roofing, gutters and trim</i></p> <p><i>Other sources</i></p>	<p><i>Boiler drain lines shall be directly or indirectly connected to the sanitary sewer system and may not discharge to the storm drain system</i></p> <p><i>Condensate drain lines may discharge to landscaped areas if the flow is small enough that runoff will not occur.</i></p> <p><i>Condensate drain lines may not discharge to the storm drain system.</i></p> <p><i>Rooftop equipment with potential to produce pollutants shall be roofed and/or have secondary containment.</i></p> <p><i>Any drainage sumps on-site shall feature a sediment sump to reduce the quantity of sediment in pumped water.</i></p> <p><i>Avoid roofing, gutters and trim made of copper or other unprotected metals that may leach into runoff.</i></p> <p><i>Include controls for other sources as specified by local reviewer.</i></p>	
I. Plazas, sidewalks, and parking lots	<p><i>Spill kits are to be kept on-site at all times per SC-11</i></p>	<p><i>Sweep plazas, sidewalks, and parking lots regularly to prevent accumulation of litter and debris. Collect debris from pressure washing to prevent entry into the storm drain system. Collect washwater containing any cleaning agent or degreaser and discharge to the sanitary sewer not to a storm drain.</i></p>

Section H: Construction Plan Checklist

Populate Table H.1 below to assist the plan checker in an expeditious review of your project. The first two columns will contain information that was prepared in previous steps, while the last column will be populated with the corresponding plan sheets. This table is to be completed with the submittal of your final Project-Specific WQMP.

Table H.1 Construction Plan Cross-reference

BMP No. or ID	BMP Identifier and Description	Corresponding Plan Sheet(s)	BMP Location (Lat/Long)
*	*	*	*

Note that the updated table — or Construction Plan WQMP Checklist — is **only a reference tool** to facilitate an easy comparison of the construction plans to your Project-Specific WQMP. Co-Permittee staff can advise you regarding the process required to propose changes to the approved Project-Specific WQMP.

*This section will be completed in FWQMP

Section I: Operation, Maintenance and Funding

The Copermittee will periodically verify that Stormwater BMPs on your site are maintained and continue to operate as designed. To make this possible, your Copermittee will require that you include in Appendix 9 of this Project-Specific WQMP:

1. A means to finance and implement facility maintenance in perpetuity, including replacement cost.
2. Acceptance of responsibility for maintenance from the time the BMPs are constructed until responsibility for operation and maintenance is legally transferred. A warranty covering a period following construction may also be required.
3. An outline of general maintenance requirements for the Stormwater BMPs you have selected.
4. Figures delineating and designating pervious and impervious areas, location, and type of Stormwater BMP, and tables of pervious and impervious areas served by each facility. Geo-locating the BMPs using a coordinate system of latitude and longitude is recommended to help facilitate a future statewide database system.
5. A separate list and location of self-retaining areas or areas addressed by LID Principles that do not require specialized O&M or inspections but will require typical landscape maintenance as noted in Chapter 5, pages 85-86, in the WQMP Guidance. Include a brief description of typical landscape maintenance for these areas.

Your local Co-Permittee will also require that you prepare and submit a detailed Stormwater BMP Operation and Maintenance Plan that sets forth a maintenance schedule for each of the Stormwater BMPs built on your site. An agreement assigning responsibility for maintenance and providing for inspections and certification may also be required.

Details of these requirements and instructions for preparing a Stormwater BMP Operation and Maintenance Plan are in Chapter 5 of the WQMP Guidance Document.

Maintenance Mechanism: WQMP Covenant and Agreement

Will the proposed BMPs be maintained by a Home Owners' Association (HOA) or Property Owners Association (POA)?

Y


N

Include your Operation and Maintenance Plan and Maintenance Mechanism in Appendix 9. Additionally, include all pertinent forms of educational materials for those personnel that will be maintaining the proposed BMPs within this Project-Specific WQMP in Appendix 10.

***To be completed in FWQMP**

Appendix 1: Maps and Site Plans

Location Map, WQMP Site Plan and Receiving Waters Map

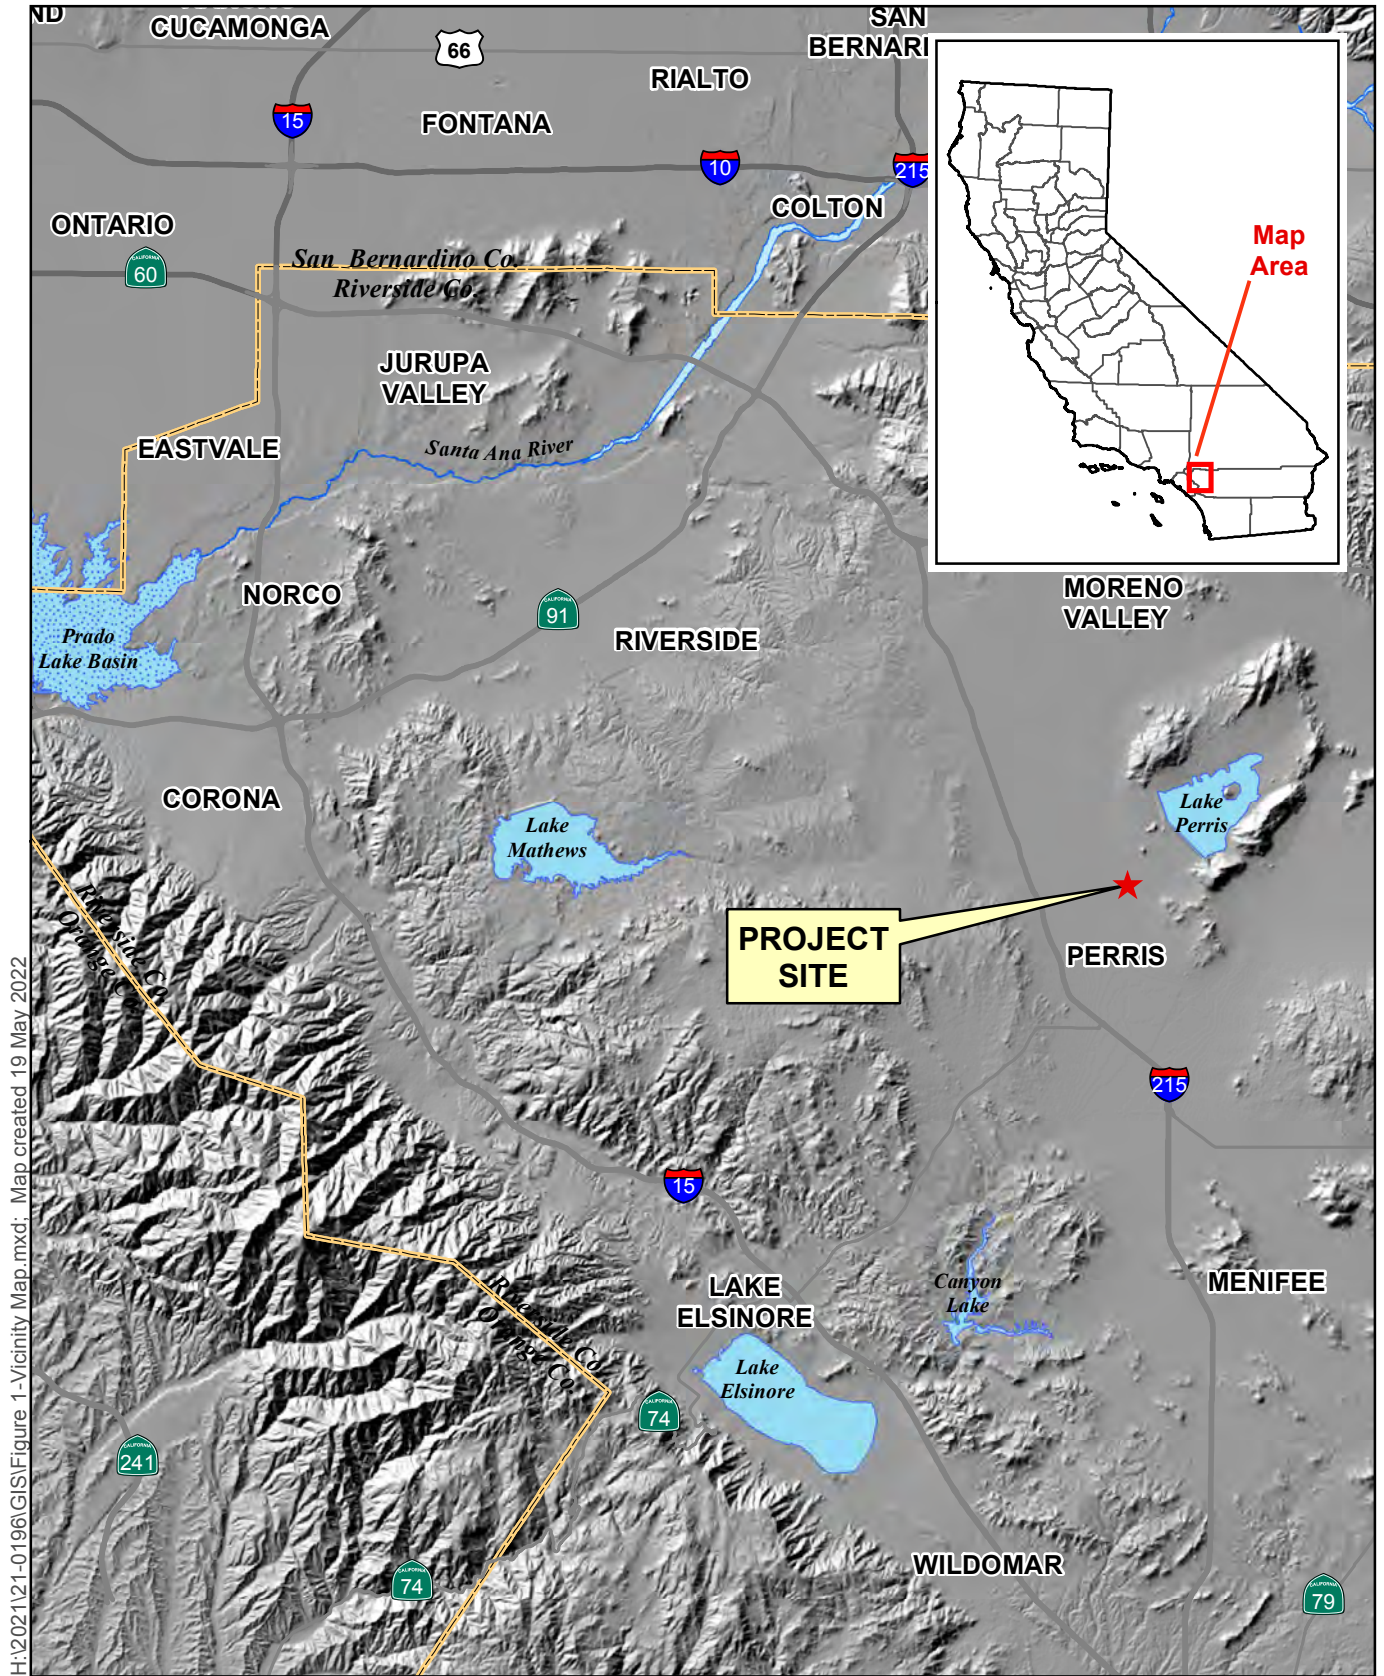


H:\2021\21-0196\GIS\Figure 1-Vicinity Map.mxd; Map created 19 May 2022


Source: Riverside County GIS, 2020

Figure 1 – Vicinity Map

FIR Wilson 3

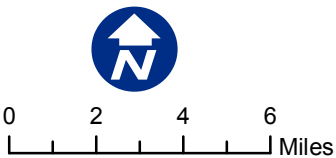

H:\2021\21-01196\GIS\Figure 2-USGS Map.mxd; Map created 27 May 2022; rebeccab

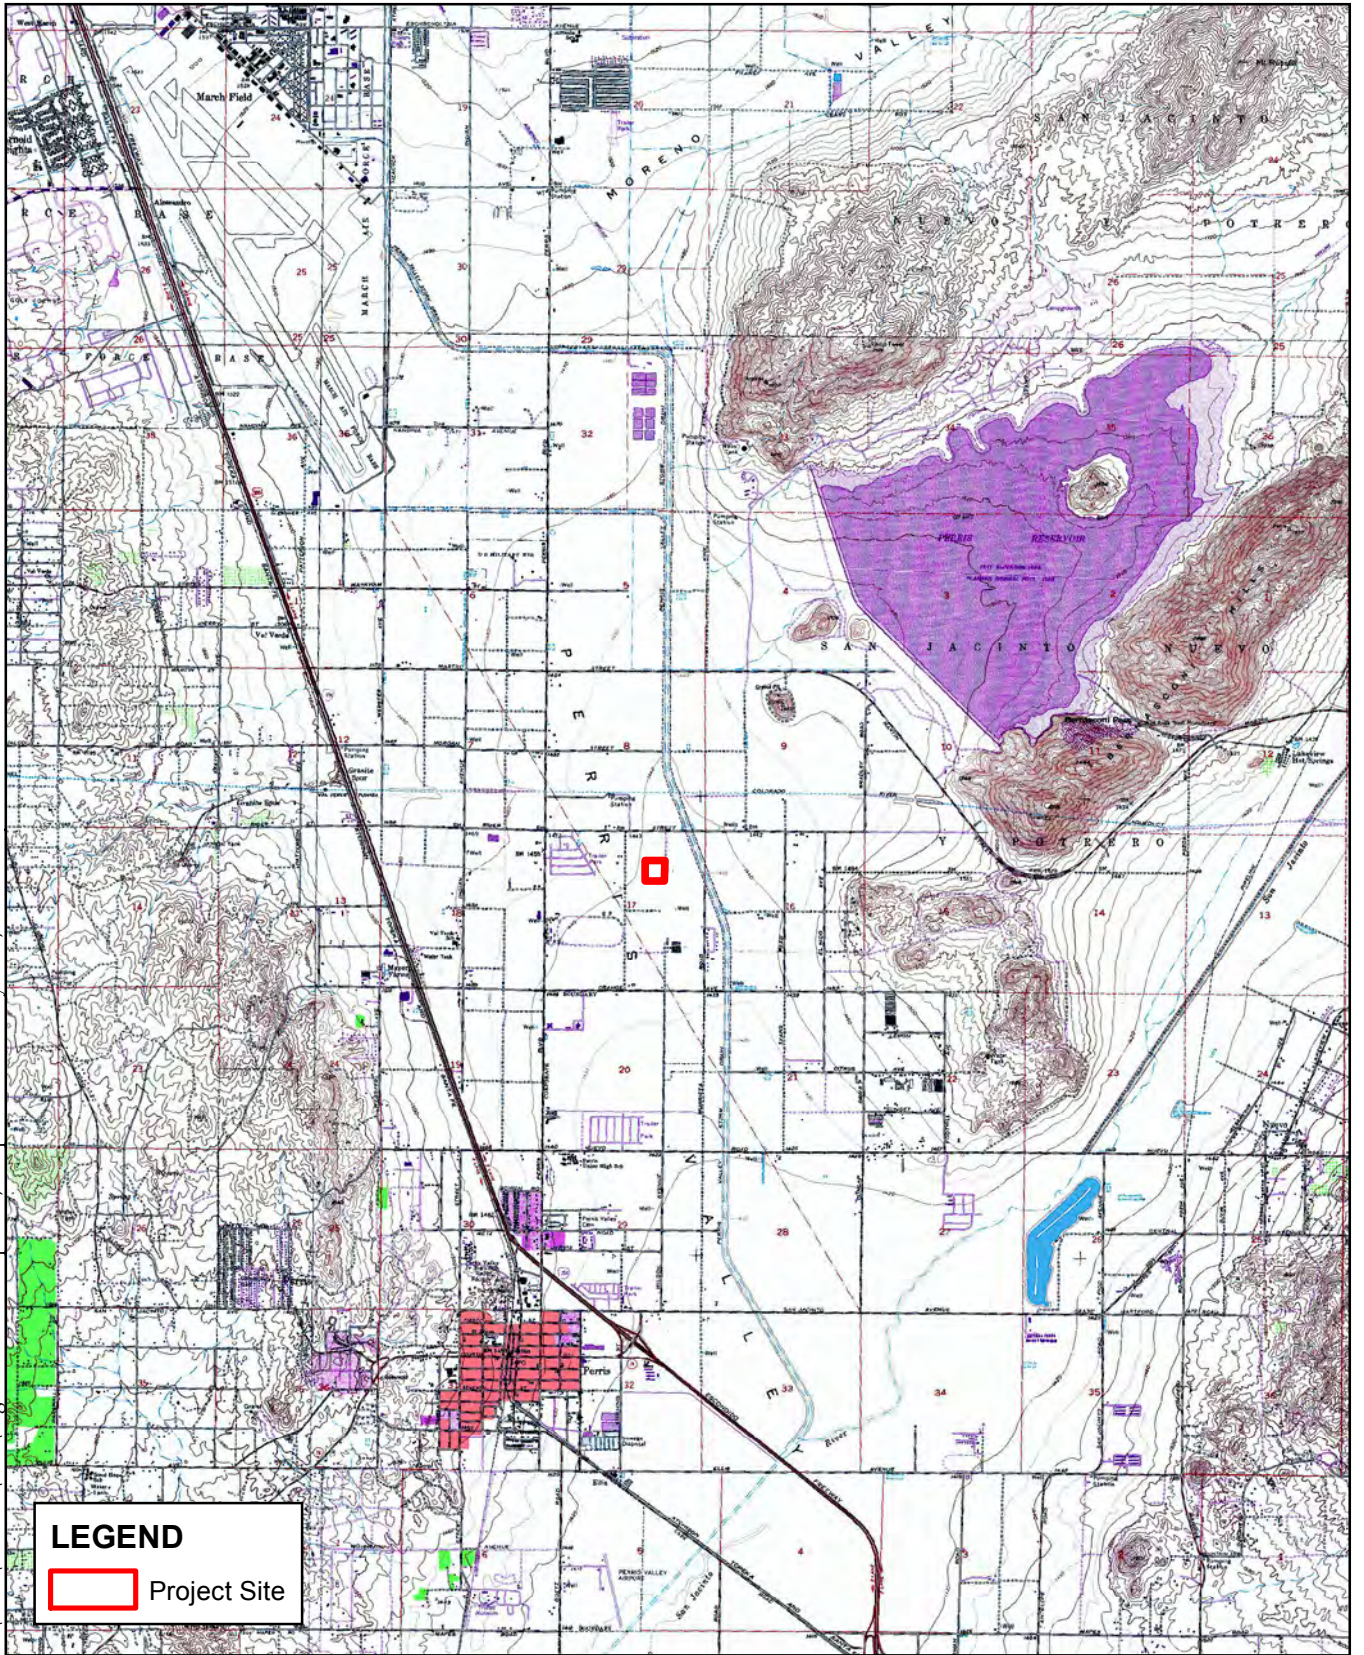

Sources: ESRI / USGS 7.5min Quads: CUCAMONGA PEAK, DEVORE, GUASTI, FONTANA

Figure 2 - USGS Map
FIR Wilson 3



0 4,000 8,000 12,000
 |-----|-----|-----|
 Feet



H:\2021\21-0196\GIS\Figure 3-Aerial Map.mxd; Map created 31 May 2022



Sources: Riverside Co. GIS, 2021 (streets) and 2020 (imagery).


Figure 3 - Aerial Map

FIR Wilson 3



0 500 1,000 1,500 Feet



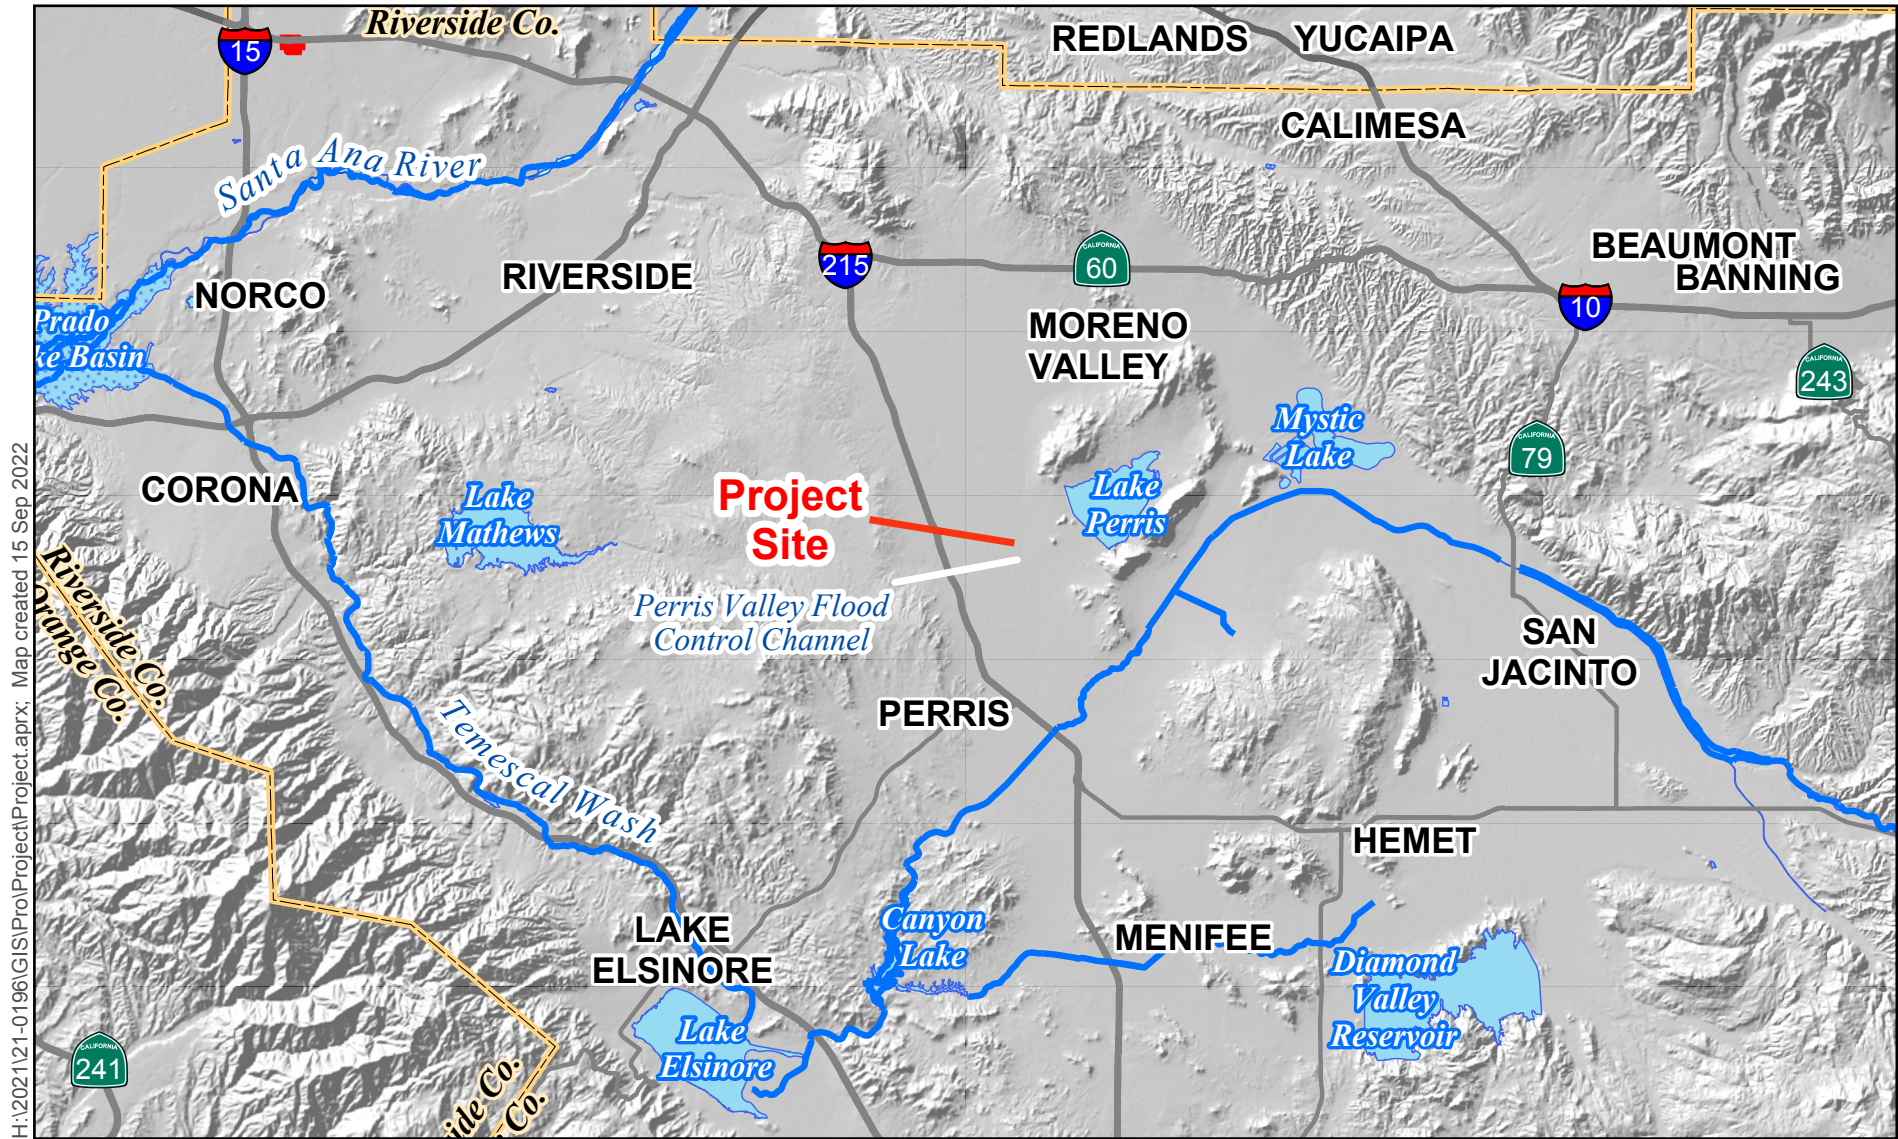

H:\2021\121-0196\GIS\Pro\Project\Project.aprx: Map created 15 Sep 2022

Sources: US NHD; USGS 30 Meter DEM


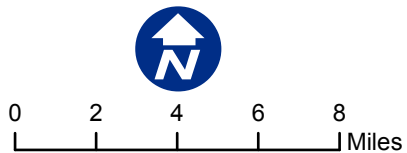


Figure 4 – Receiving Waterbodies

FIR Wilson 3

- AoC Arlington fine sandy loam, deep, 2-8% slopes
- GyC2 Greenfield sandy loam, 2-8% slopes, eroded
- GtC Greenfield sandy loam, 2-9% slopes
- HaC Hanford coarse sandy loam, 2-9% slopes
- HaD Hanford coarse sandy loam, 9-15% slopes
- HcH Hanford coarse sandy loam, 2-8% slopes
- MmB Monserate sandy loam, 0-5% slopes
- MoC Monserate sandy loam, 2-9% slopes
- PaC2 Pachappa fine sandy loam, 2-8% slopes
- RmC Ramona sandy loam, 2-9% slopes
- ScA San Emigdio fine sandy loam, 0-2% slopes
- ShF Saugus sandy loam, 30-50% slopes
- TvC Tujunga gravelly loamy sand, 0-9% slopes
- Vr Vista-Rock outcrop complex

Map created 27 May 2022. H:\2021\21-0196\GIS\Figure 5-Soils.mxd

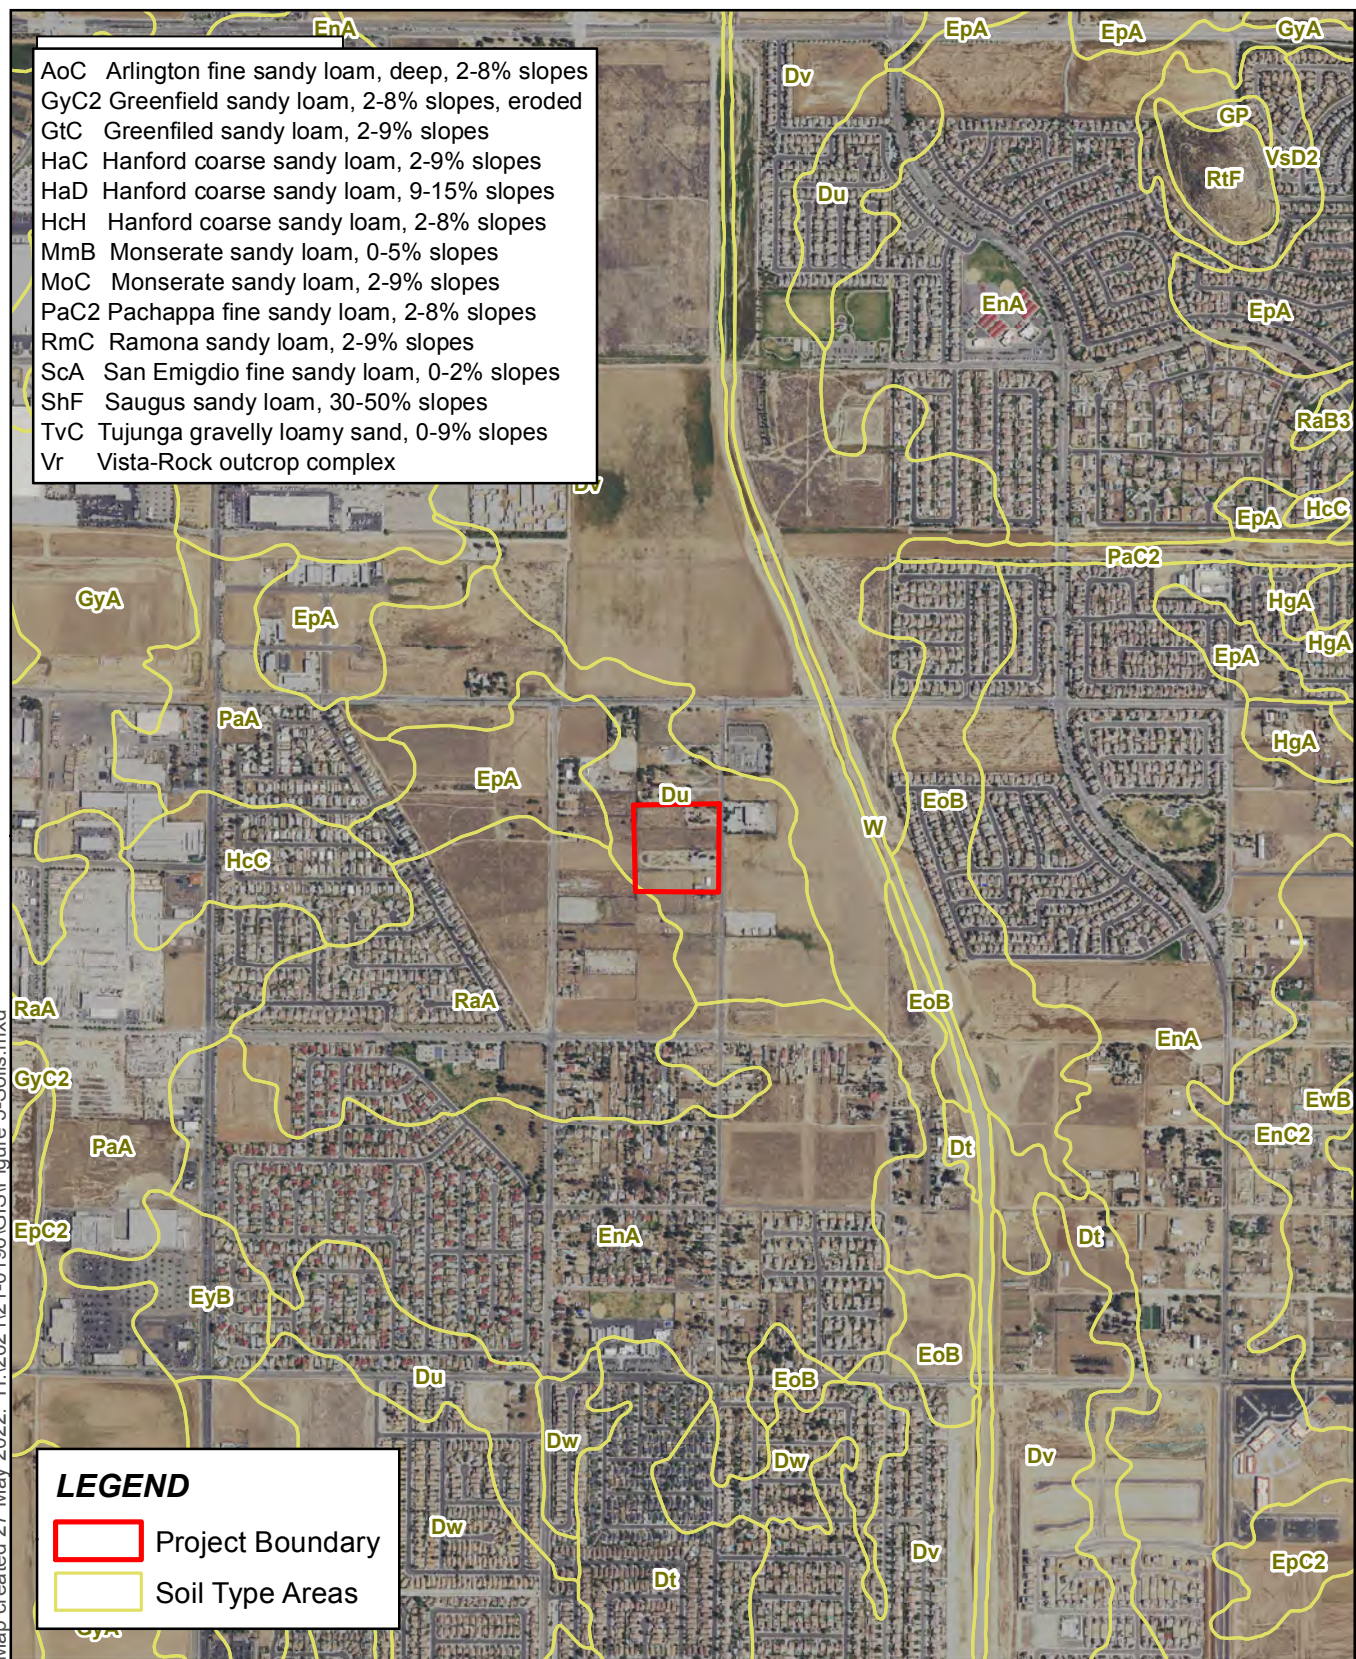

LEGEND

- Project Boundary
- Soil Type Areas

Sources: USDA NRCS SSURGO, 2015;
Riverside Co. GIS, 2020; USDA NAIP, 2016.


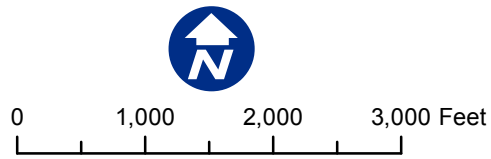


Figure 5 – Soils Map
FIR Wilson 3



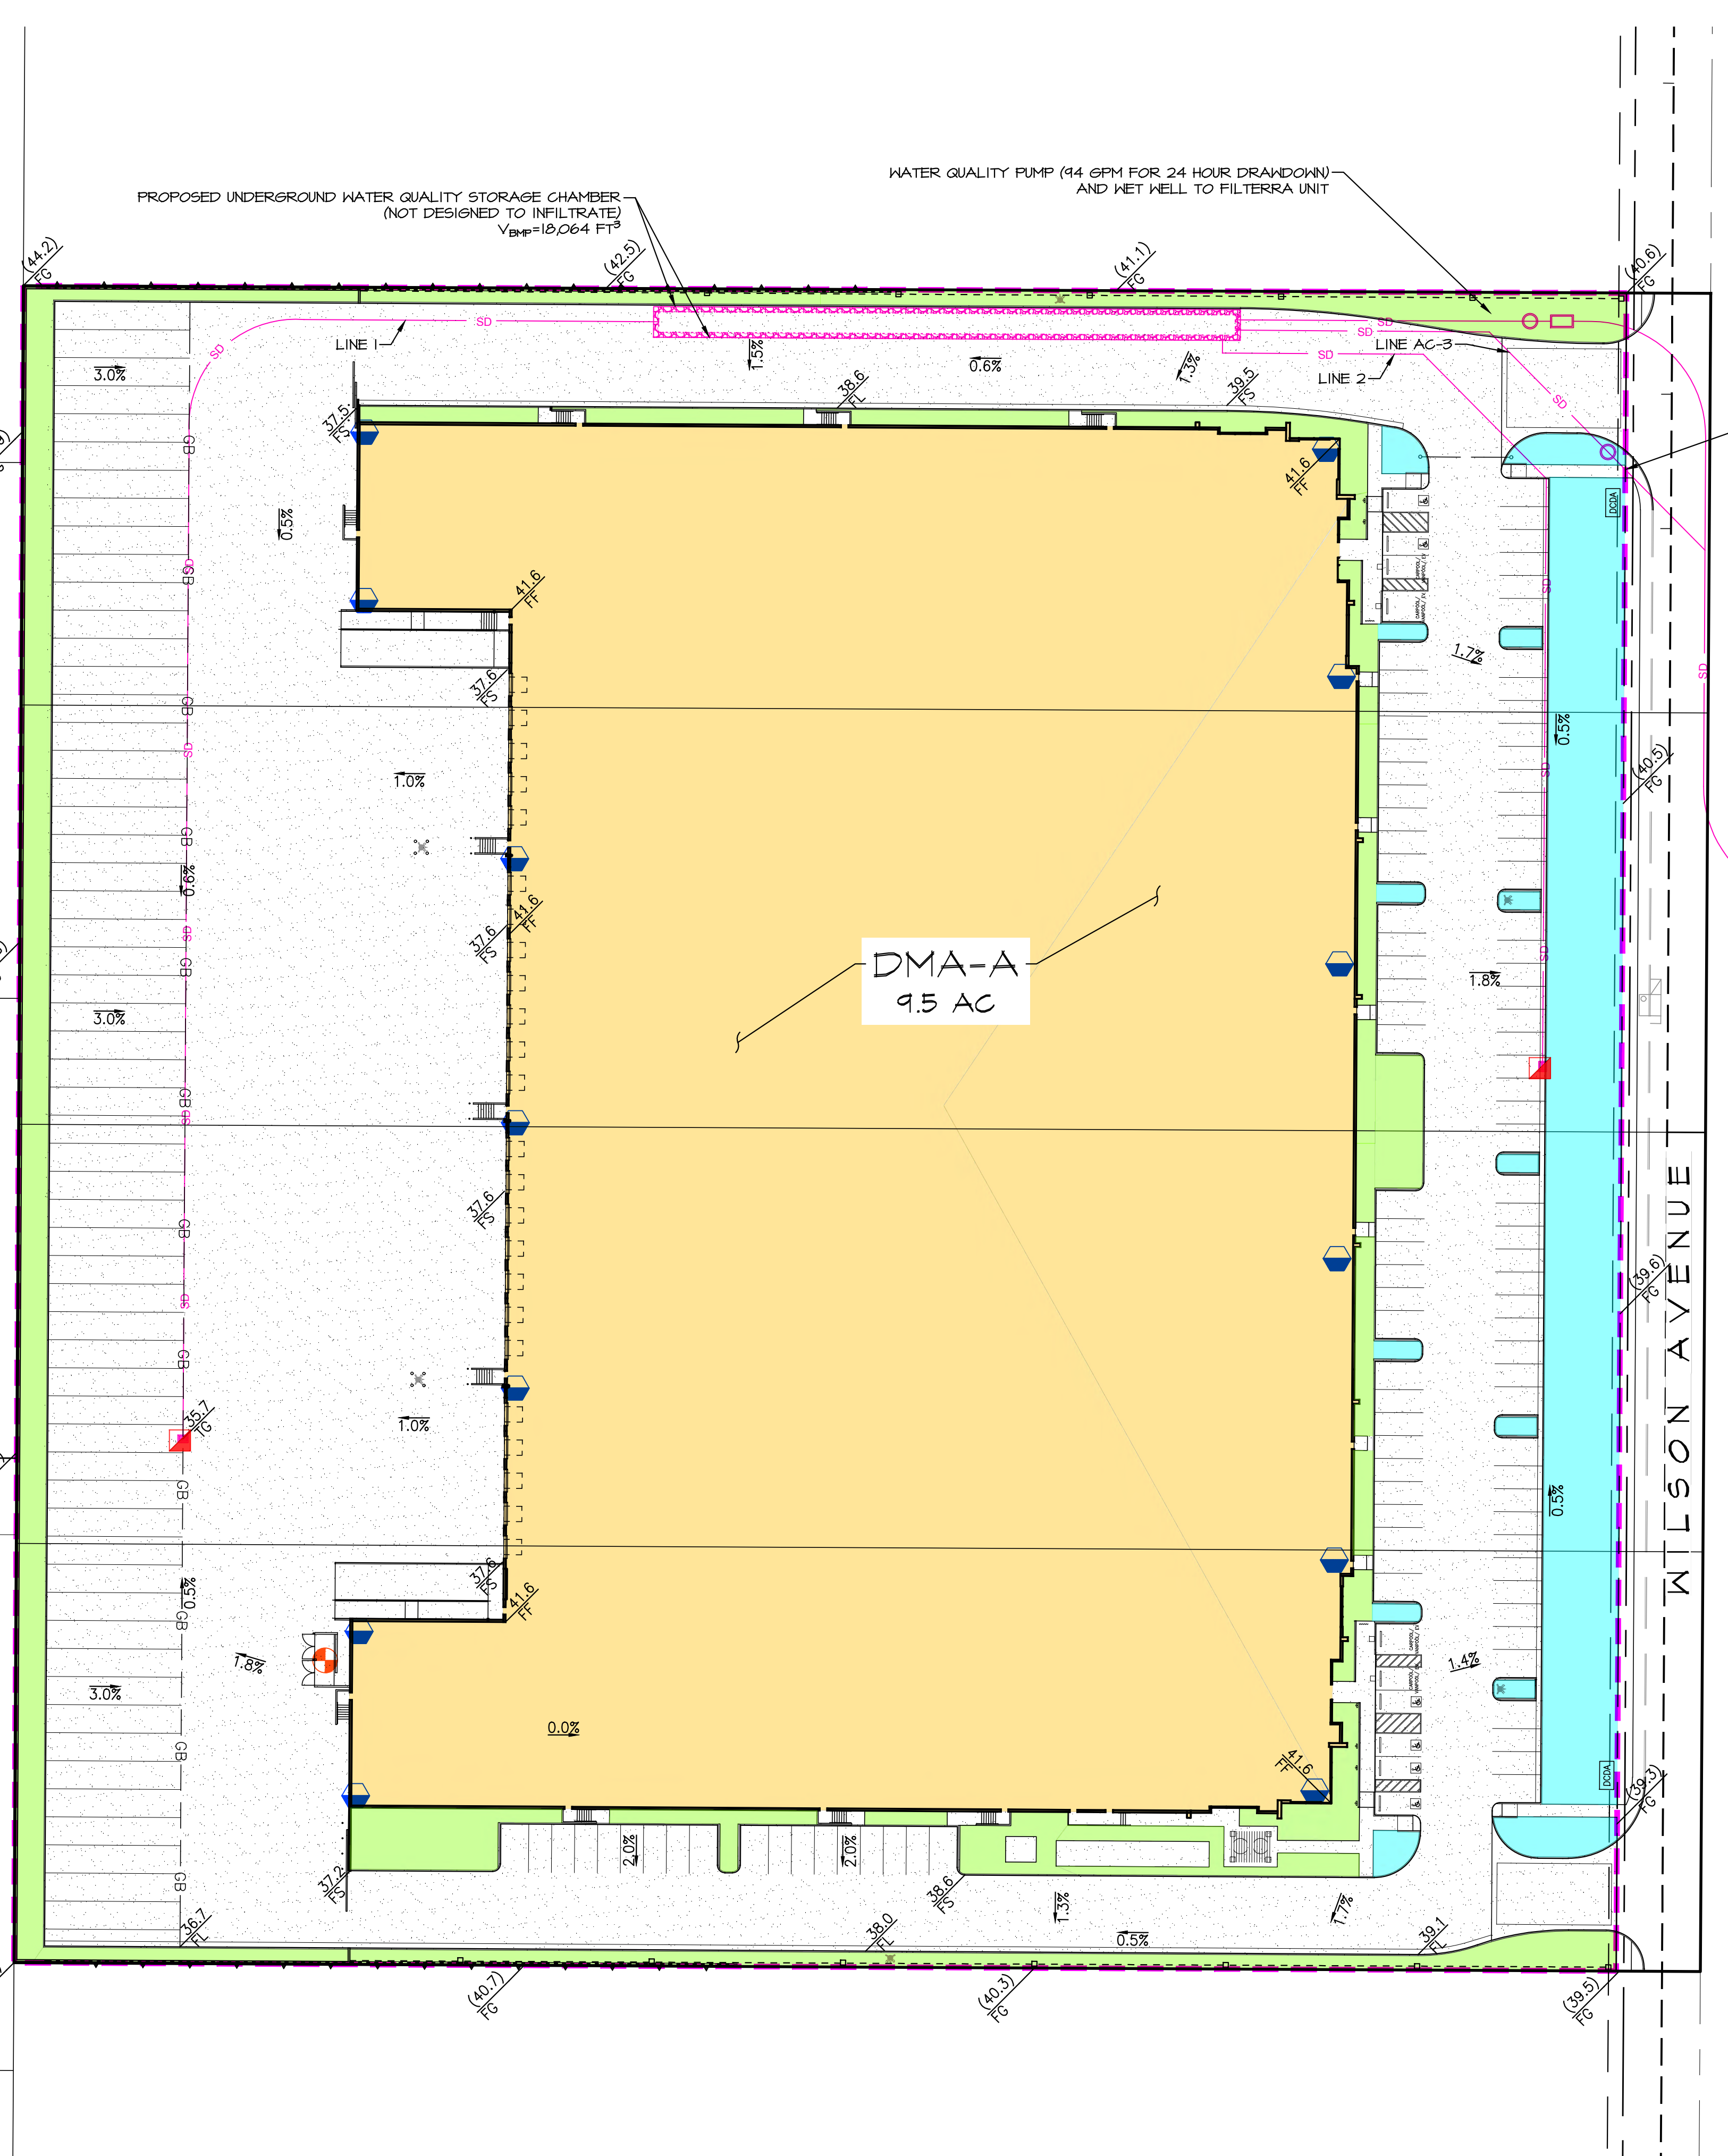

PROPOSED UNDERGROUND WATER QUALITY STORAGE CHAMBER (NOT DESIGNED TO INFILTRATE)
 $V_{BMP} = 10,064 \text{ FT}^3$

WATER QUALITY PUMP (94 GPM FOR 24 HOUR DRANDOWN) AND WET WELL TO FILTERRA UNIT

DMA-A DISCHARGE POINT
 $Q_{10} = 13.0 \text{ CFS}$
 $Q_{100} = 20.0 \text{ CFS}$

DMA-A
 9.5 AC

LEGEND

	DRAINAGE MANAGEMENT BOUNDARY
	LANDSCAPING
	ROOF
	CONCRETE OR ASPHALT
	SELF RETAINING
	FLOW DIRECTION
	STORM DRAIN PIPE
	STORM INLET
	TRASH ENCLOSURE
	ROOF DRAIN DOWNSPOUT


*NOTE: ADD 1400 TO ALL ELEVATIONS

ADDITIONAL NOTE
 THE PROJECT IS NOT AFFECTED BY OFF-SITE RUNOFF

DRAINAGE MANAGEMENT AREAS

LEGEND	DMA-ID	TYPE	AREA (SF)
	L-A	LANDSCAPE	28055
	R-A	ROOF	188331
	H-A	HARDSCAPE	174185
	SR-A	SELF-RETAINING	18034


% IMPERVIOUS = $(188331 + 174185) / 413616 = 88.4\%$

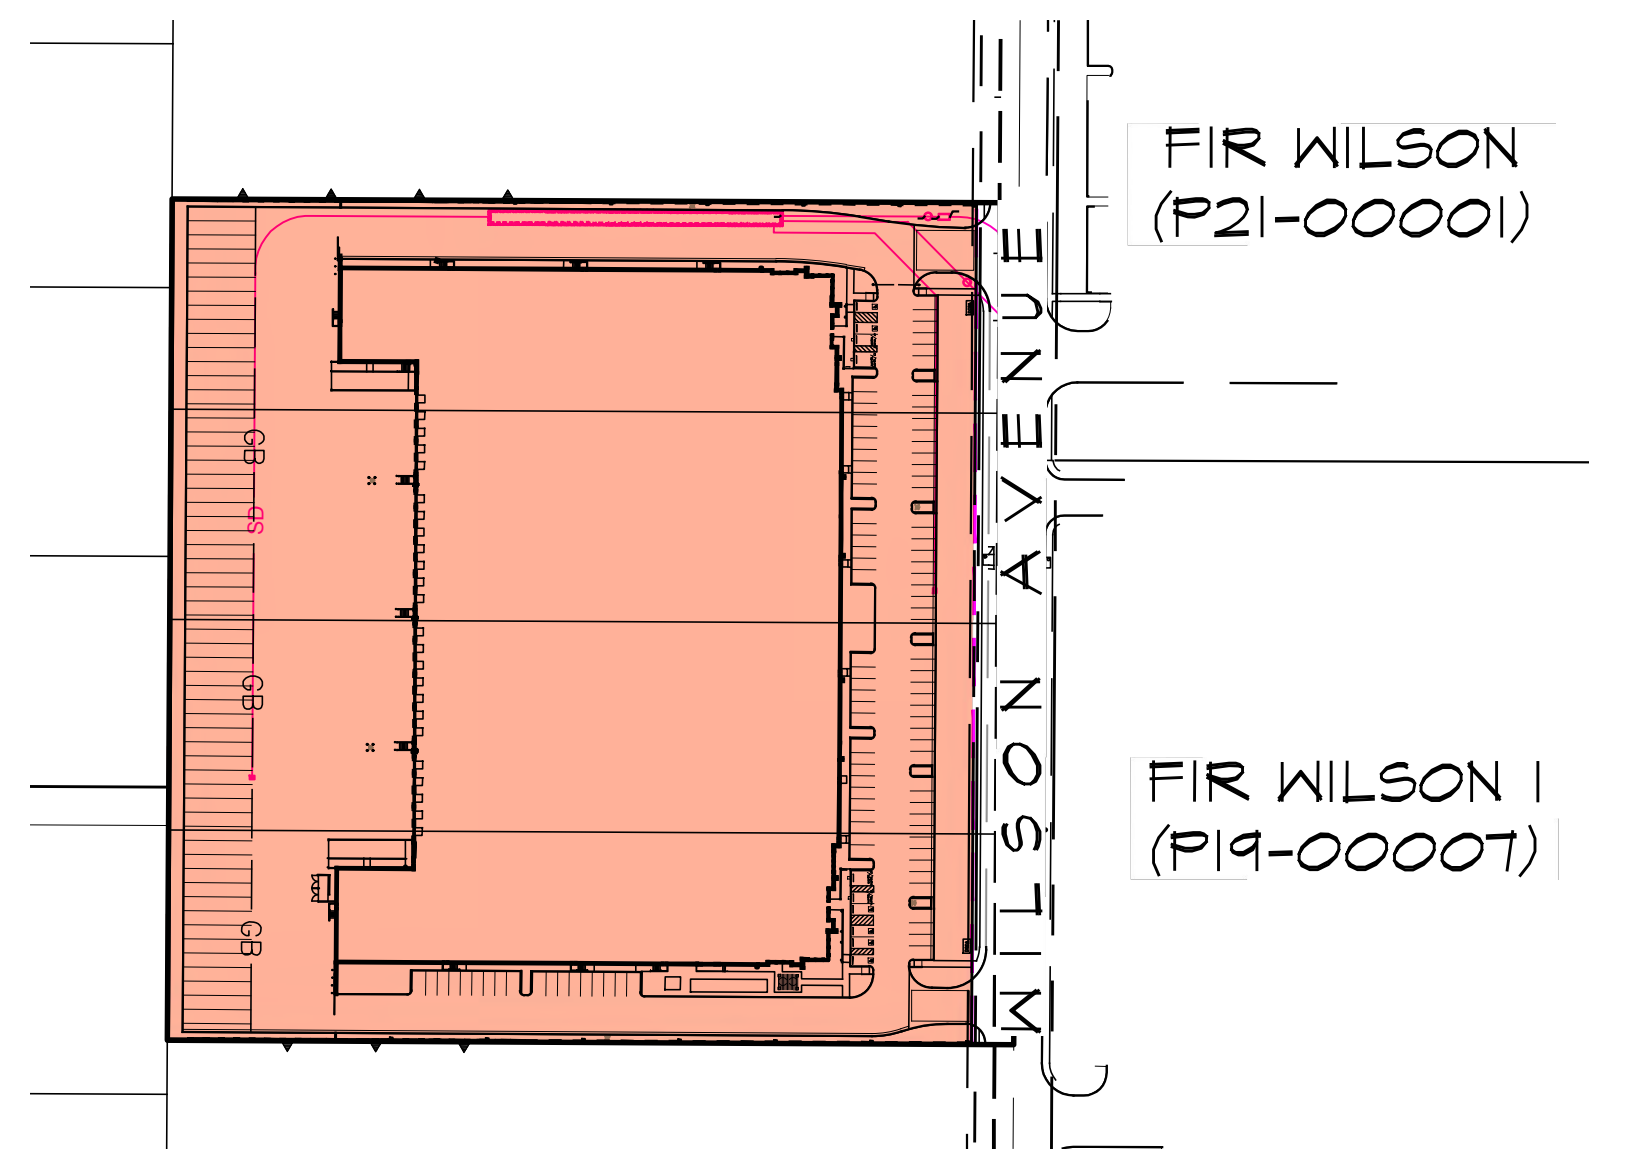

DMA SITE MAP
 DMA-A


DRAINAGE MANAGEMENT AREAS (DMA) SUMMARY

DMA ID	TOTAL AREA (SF)	LANDSCAPE (I=0.12)	SELF-RETAINING	HARDSCAPE (I=1.0)	ROOF (I=1.0)	V_{BMP} REQUIRED (CFS)	V_{BMP} PROVIDED (CFS)
DMA A	412,461	28,055	18,034	174,185	188,331	18,033	18,064

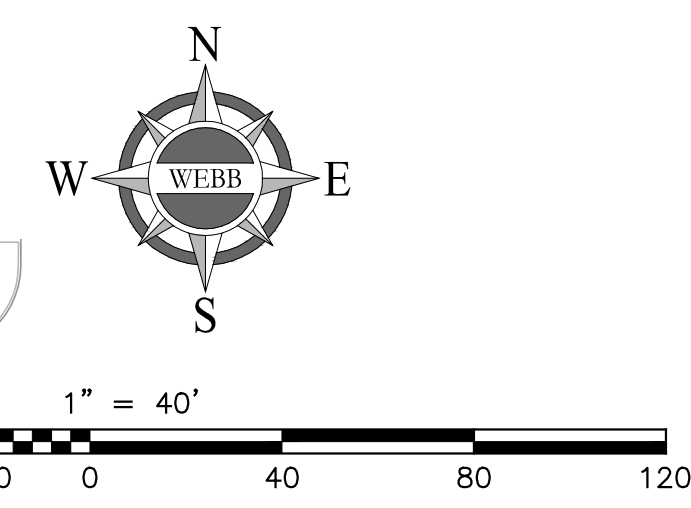


CITY OF PERRIS
 POST-CONSTRUCTION BMP SITE PLAN
 FIR WILSON 3
 WILSON AVENUE, PERRIS
 P22-00017


SCALE: 1"=40'	ALBERTA ENGINEERING CONSULTANTS 3788 MCCRAY STREET RIVERSIDE CA 92506 PH. (951) 686-1070 FAX (951) 788-1256	W.O. 21-0196 SHEET 1 OF 2 SHEETS DWG. NO.
DATE: 4/15/2022	WEBB ASSOCIATES	
DESIGNED: RSB		
CHECKED: SKK		
PLN CK REF:		
F.B.		

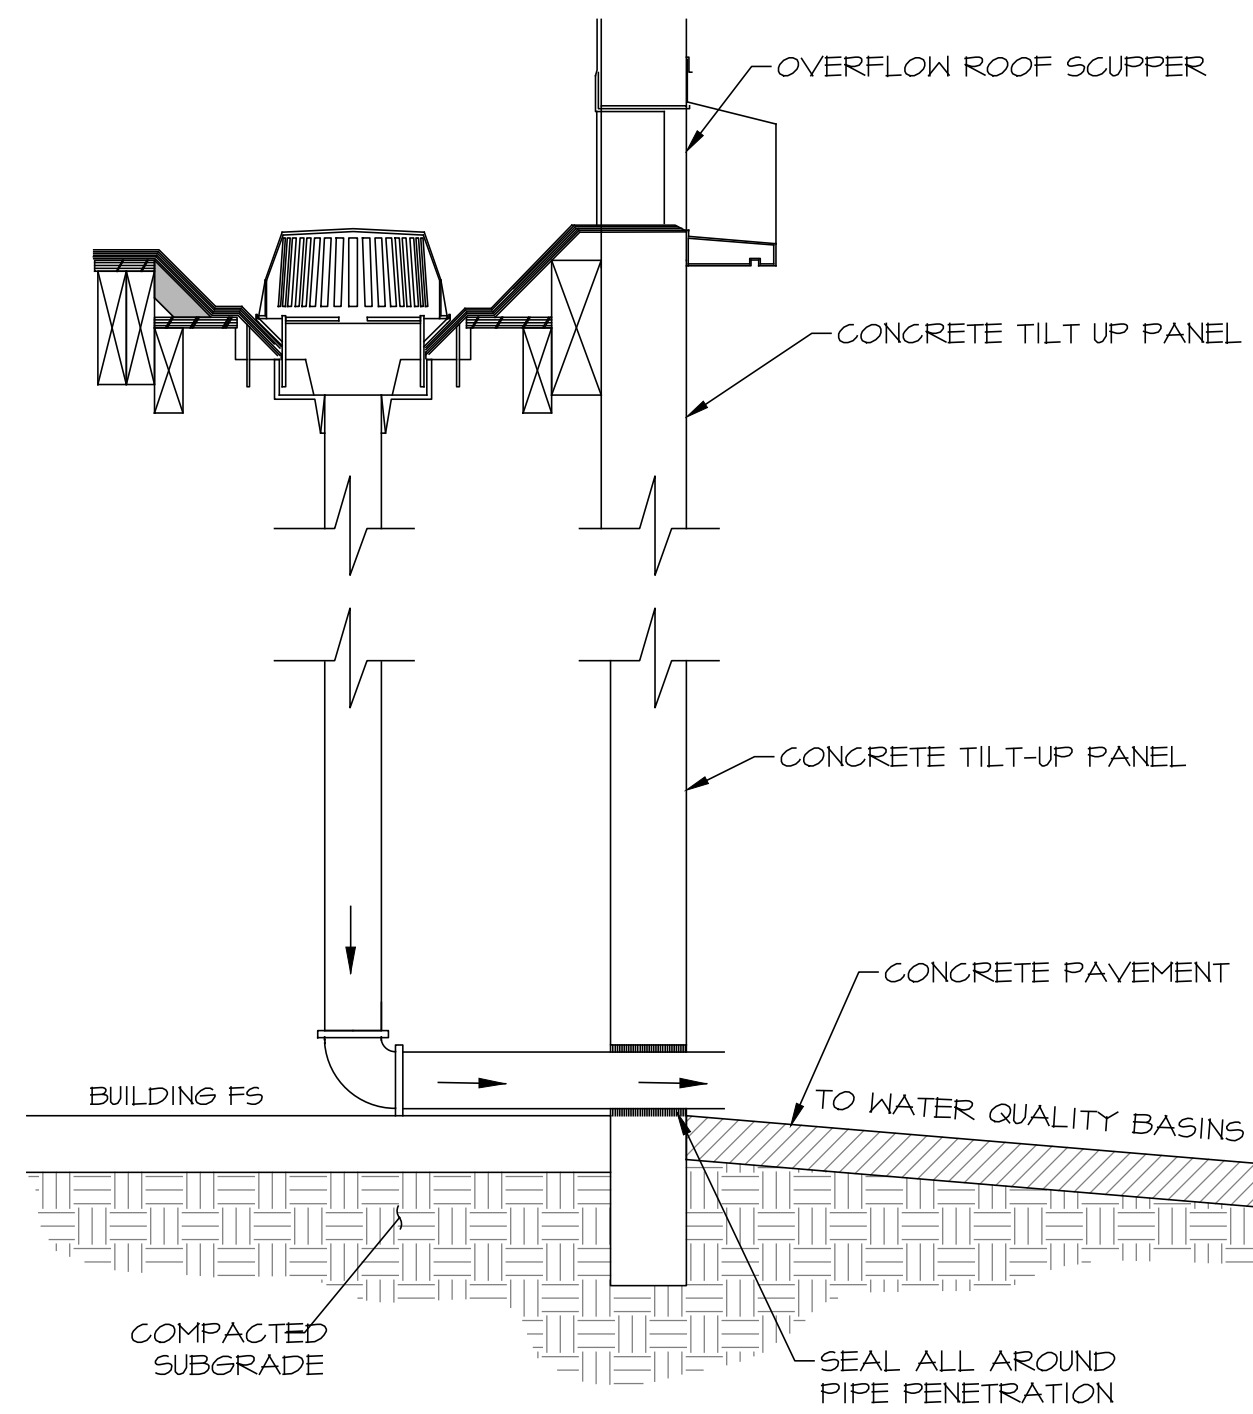


ROOF DRAIN DETAIL
N.T.S.

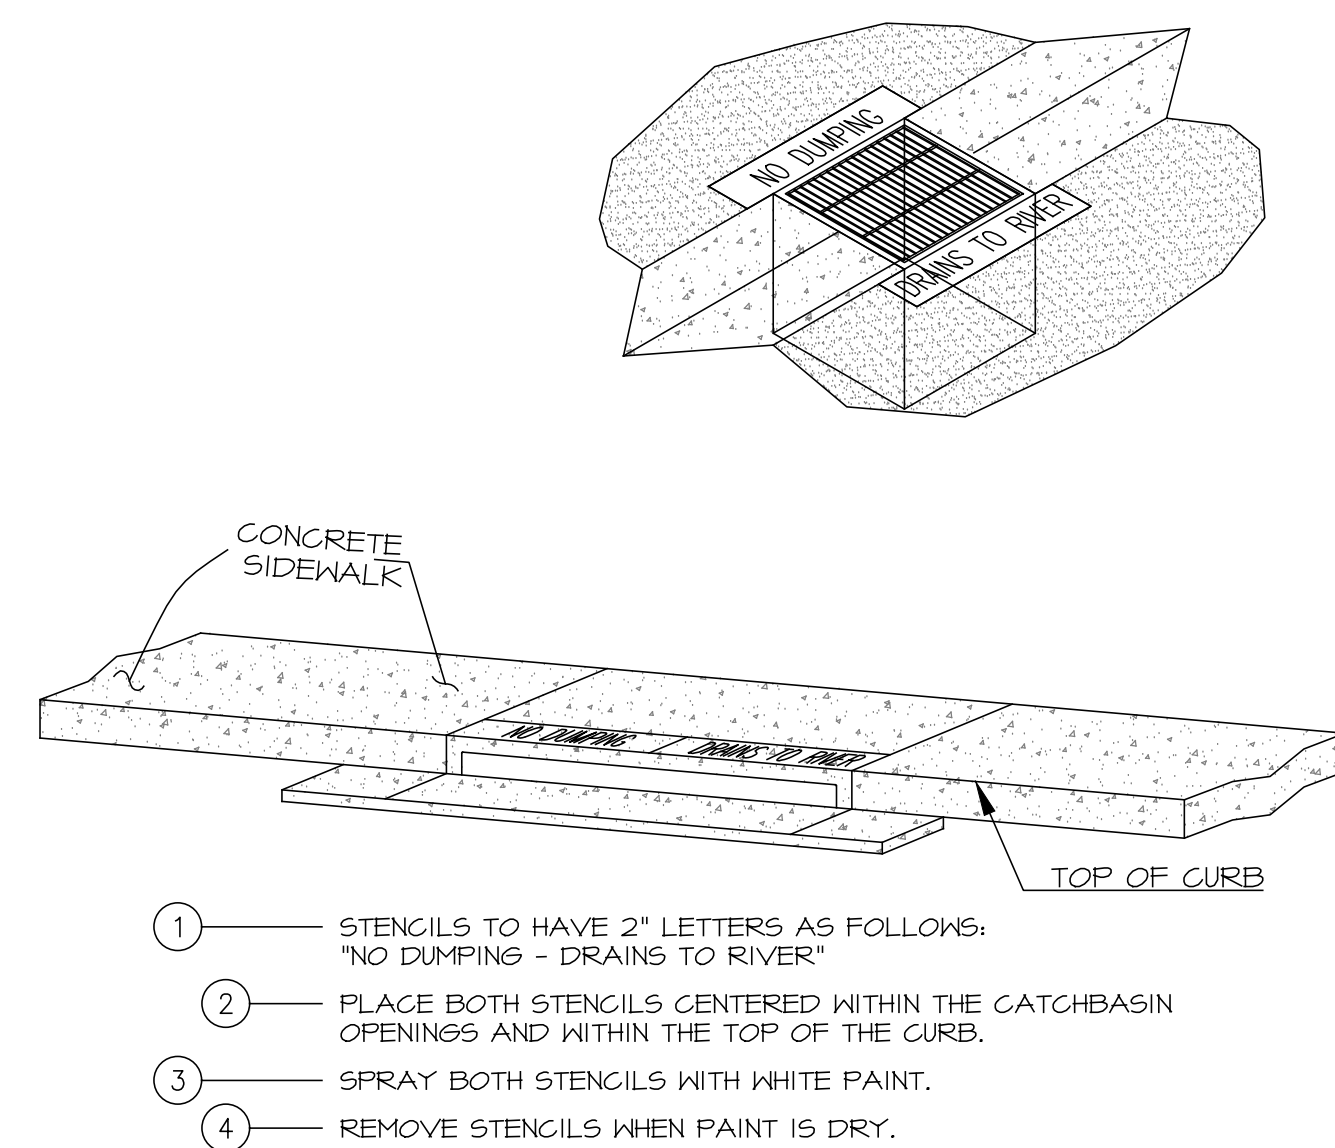


CATCH BASIN STENCILING DETAIL
N.T.S.

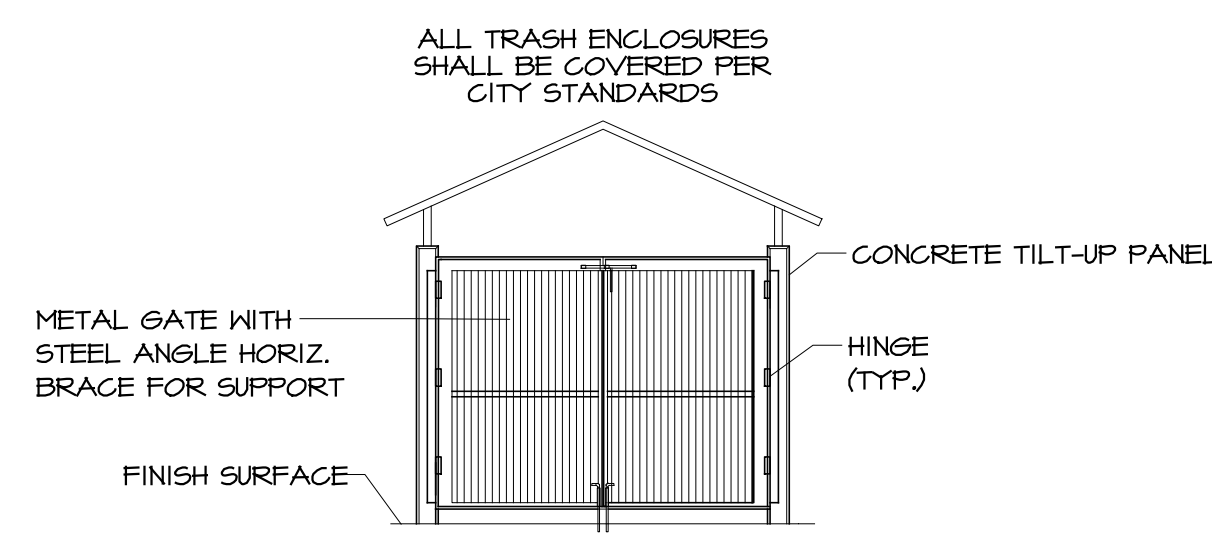



TRASH ENCLOSURE GATE ELEVATION
N.T.S.

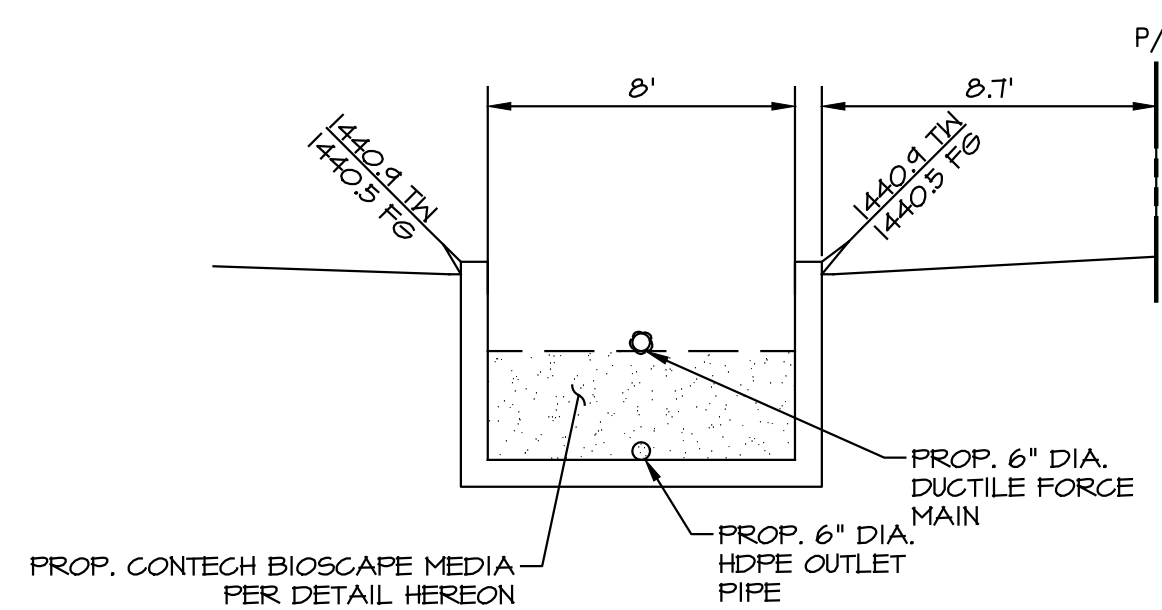

CONTECH CMP UNDERGROUND DETENTION SYSTEM TYPICAL CROSS SECTION
N.T.S.

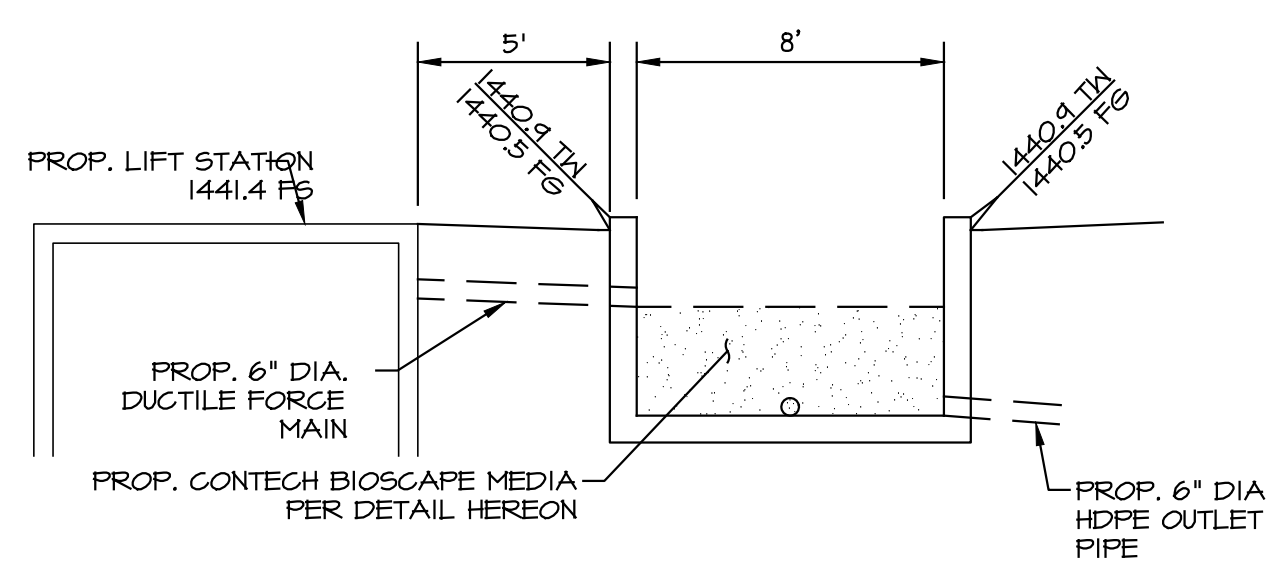

CONTECH FILTERRA UNIT DETAIL
N.T.S.
SEE DETAIL HEREON

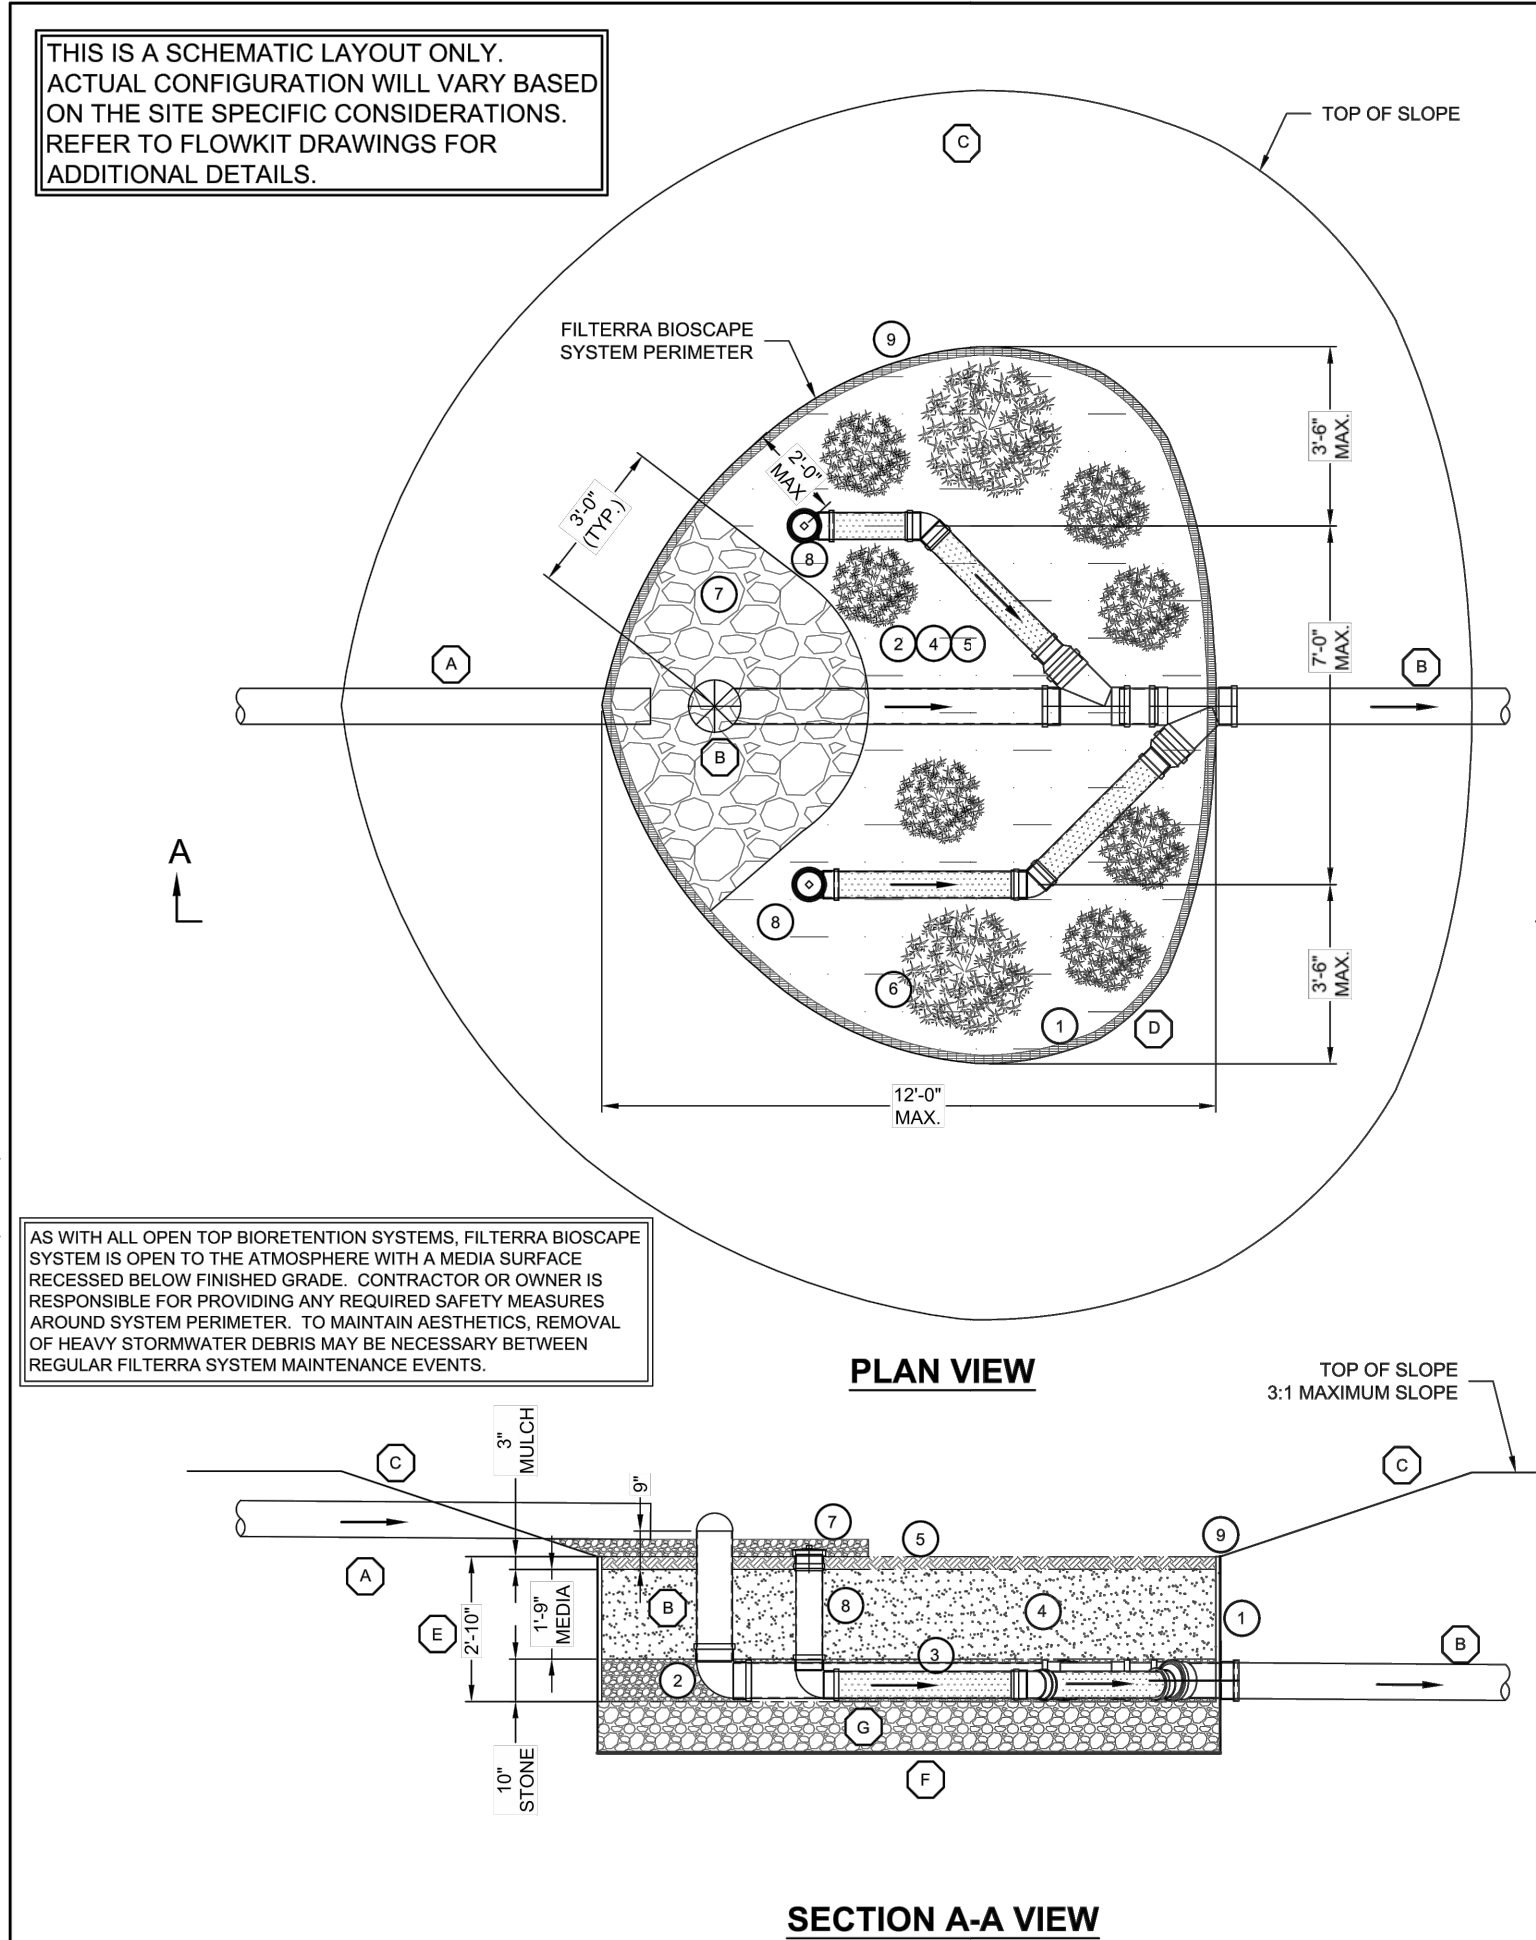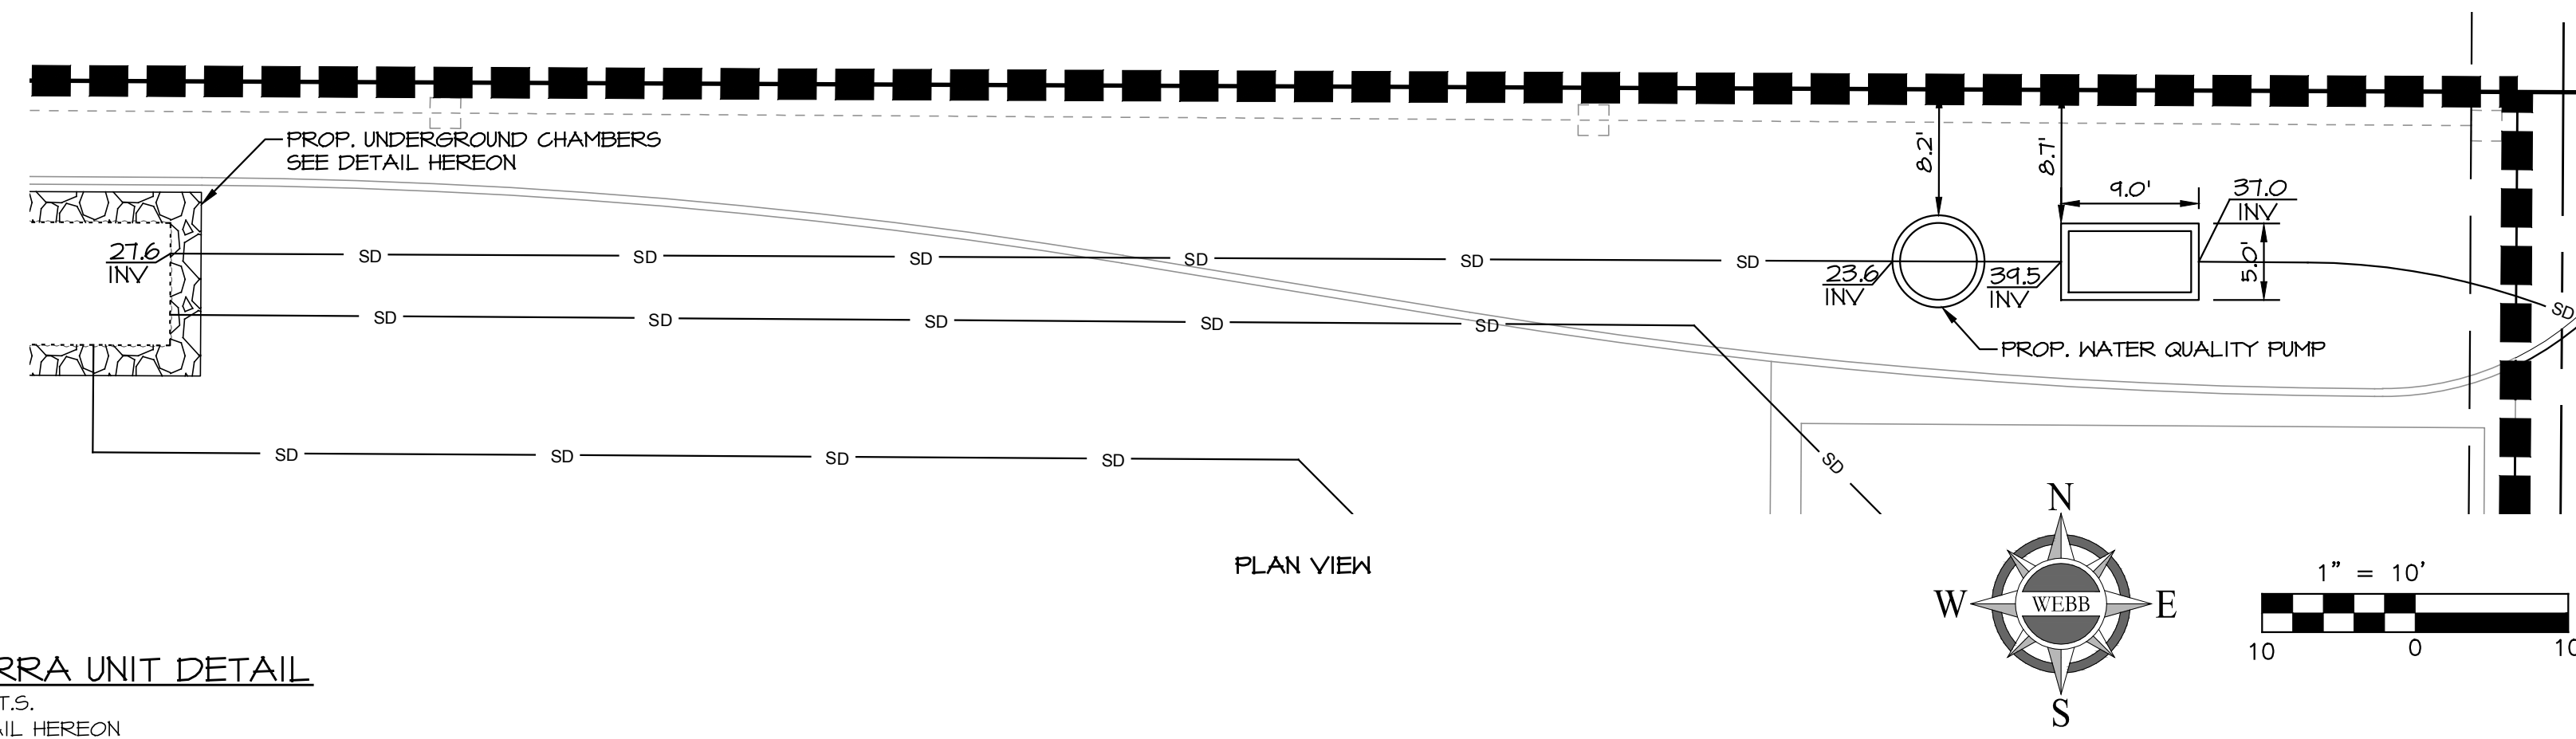

BILL OF MATERIALS			PLANTING SCHEDULE	
COUNT	DESCRIPTION	INSTALLED BY	QUANTITY	FILTERRA BIOSCAPE SYSTEM PLANT PALETTE
X	FILTERRA SURFACE AREA (SF)	CONTRACTOR		
X	MULCH VOLUME (CY)	CONTRACTOR		
XX	FILTERRA MEDIA VOLUME (CY)	CONTRACTOR		
X	12" #4 ROUND AGGREGATE UNDERDRAIN STONE (CY)	CONTRACTOR		
X	ENERGY DISSIPATION ROCK (CY)	CONTRACTOR		
X	EROSION CONTROL (LF)	CONTRACTOR		
X	FILTERRA FLOWKIT	CONTRACTOR		

GENERAL NOTES

- CONTRACTOR SHALL CONTACT CONTECH TO COORDINATE DELIVERY AND SUPERVISION OF PLACEMENT OF FILTERRA BIOSCAPE SYSTEM COMPONENTS (ACTIVATION). CONTRACTOR SHALL COMPLETE ITEMS IN THE LIST OF CONTRACTOR INSTALLATION RESPONSIBILITIES LISTED ON THIS DETAIL. BEFORE CONTECH'S REPRESENTATIVE ATTENDS AND SUPERVISES THE ACTIVATION OF THE BIOSCAPE SYSTEM.
- PERFORM FILTERRA BIOSCAPE SYSTEM EXCAVATION ONLY AFTER ALL THE CONTRIBUTING DRAINAGE AREAS ARE PERMANENTLY STABILIZED. DO NOT STOCKPILE MATERIALS NOR STORE EQUIPMENT IN THIS AREA.
- CONTRACTOR SHALL COORDINATE WITH CONTECH BEFORE THE FILTERRA BIOSCAPE SYSTEM AREA IS EXCAVATED TO MINIMIZE TIME BETWEEN EXCAVATION AND DELIVERY AND ACTIVATION OF THE FILTERRA BIOSCAPE SYSTEM. ANY STANDING WATER THAT ACCUMULATES IN THE EXCAVATED AREA MUST BE REMOVED BY THE CONTRACTOR BEFORE CONTECH CAN PROVIDE ACTIVATION OF THE FILTERRA BIOSCAPE SYSTEM. ANY ADDITIONAL EXCAVATION WILL BE THE RESPONSIBILITY OF THE CONTRACTOR.
- EXCAVATION DIMENSIONS SHOULD BE PROVIDED TO CONTECH IN THE ACTIVATION REQUEST CHECKLIST.
- CONTRACTOR SHALL PROVIDE ACCESS TO THE EXCAVATED AREAS FOR USE DURING THE ACTIVATION OF THE FILTERRA BIOSCAPE SYSTEMS. ACCESS SHALL NOT PROHIBIT LIGHT DUTY EQUIPMENT THAT MAY BE USED FOR RE-STABILIZATION THAT MAY BE REQUIRED AFTER THE FILTERRA BIOSCAPE SYSTEM ACTIVATION.
- CONTECH AND/OR ITS REPRESENTATIVES MUST BE SCHEDULED TO BE ON SITE FOR THE LIST ENTITLED CONTRACTOR ACTIVATION RESPONSIBILITIES.

CONTRACTOR SITE PREPARATION RESPONSIBILITIES AS DENOTED BY (A) ON THIS DETAIL:

- CONTRACTOR SHALL INSTALL PIPE OR SWALE THAT CONVEYS INFLUENT FLOWS AS WELL AS ANY REQUIRED INLET AND OUTLET STRUCTURES.
- CONTRACTOR SHALL PROVIDE BYPASS PIPE AND RISER OR OTHER STRUCTURE AS SHOWN ON PLANS. THE BYPASS PIPE SHALL BE INSTALLED WITH WYE(S), OR OTHER PIPE FITTINGS, AND WITH REDUCER COUPLING(S) FOR CONNECTION OF UNDERDRAIN PIPE, PER PLANS. PIPES SHALL BE INSTALLED TO PROMOTE POSITIVE FLOW FROM THE FILTERRA BIOSCAPE SYSTEM.
- IF REQUIRED, CONTRACTOR TO PROVIDE SHOULDER ACCORDING TO DIMENSION AND SLOPE SHOWN ON PLANS OR AS DESIGNED BY ENGINEER OF RECORD. SLOPE FROM SHOULDER TO FILTERRA BIOSCAPE SYSTEM SURFACE AREA SHALL NOT EXCEED 3:1. SOIL IS REQUIRED TO STABILIZE SIDE SLOPES OR ADJACENT GRADE.
- CONTRACTOR TO EXCAVATE MEDIA AREA CORRESPONDING TO THE SIZE OF THE FILTERRA BIOSCAPE SYSTEM SURFACE AREA AS SHOWN ON DETAIL AND ON PLAN SHEETS.
- CONTRACTOR SHALL EXCAVATE VERTICALLY FROM BOTTOM OF UNDERDRAIN STONE, OR DRAINAGE STONE, IF REQUIRED, TO ELEVATION OF MULCH AS SHOWN ON THIS DETAIL.
- CONTRACTOR TO PROVIDE AND INSTALL ANY GEOTEXTILE OR IMPERMEABLE LINER FOR BOTTOM OF THE FILTERRA BIOSCAPE SYSTEM IF REQUIRED PER THE PLANS.
- CONTRACTOR TO PROVIDE AND INSTALL ANY ADDITIONAL DRAINAGE STONE BELOW THE FILTERRA BIOSCAPE SYSTEM AS CALLED OUT ON THE PLANS.

CONTRACTOR ACTIVATION RESPONSIBILITIES AS DENOTED BY (B) ON THIS DETAIL:

- PLACE GEOTEXTILE FABRIC ALONG THE PERIMETER OF THE FILTERRA BIOSCAPE SYSTEM EXCAVATION.
- PLACE 12" OF UNDERDRAIN STONE - 2" UNDER THE PIPING, 6" AROUND THE PIPING AND 2" ABOVE THE PIPING USING LIGHT DUTY EQUIPMENT ONLY.
- PLACE 4" UNDERDRAIN PIPING UNLESS OTHERWISE APPROVED BY CONTECH. ASSOCIATED PIPING AND FITTINGS/ELBOWS TO CONNECT TO THE PIPING/FITTING(S) THAT IS PROVIDED BY CONTRACTOR (SEE CONTRACTOR INSTALLATION RESPONSIBILITIES THIS DETAIL).
- PLACE 2" FILTERRA MEDIA USING LIGHT DUTY EQUIPMENT ONLY. DO NOT COMPACT MEDIA.
- PLACE 3" DOUBLE SHREDDED HARDWOOD MULCH OVER ENTIRE FILTERRA BIOSCAPE SYSTEM SURFACE AREA USING LIGHT DUTY EQUIPMENT ONLY. DO NOT COMPACT MULCH.
- PROVIDE AND PLANT VEGETATION AS INDICATED IN TABLE ON THIS DETAIL OR ON SITE PLANS.
- PLACE ENERGY DISSIPATION ROCK APRON AS DESIGNED AND INDICATED ON THIS DETAIL OR PER ENGINEER OF RECORD PLANS.
- PLACE CLEANOUT ADAPTER, PLUG AND PIPING.
- PLACE ADDITIONAL EROSION CONTROL AROUND FILTERRA BIOSCAPE SYSTEM (IF REQUIRED).



FILTERRA BIOSCAPE™ SYSTEM STANDARD DETAIL

BMP-A
N.T.S.

SELF-RETAINING FINGER ISLAND
N.T.S.
ALL SELF-RETAINING AREAS WILL BE DEPRESSED A MINIMUM OF 2-INCHES

CITY OF PERRIS

FIR WILSON 3
WILSON AVENUE, PERRIS
P22-00017

SCALE:	N/A	ALBERT A. WEBB ASSOCIATES	ENGINEERING CONSULTANTS 3788 McCRAY STREET RIVERSIDE CA 92506 PH. (951) 686-1070 FAX (951) 788-1256	W.O.	21-0196
DATE:	4/15/2022			SHEET	2
DESIGNED:	RSB			OF	2 SHEETS
CHECKED:	SKK			DWG. NO.	
PLN CK REF:					
F.B.					

H:\2021\21-0196\DRAINAGE\WQMP\DWG DRAWINGS\21-0196-PWQMP.DWG 9/15/2022 2:34:11 PM

Appendix 2: Construction Plans

Grading and Drainage Plans

To be included in FWQMP

Appendix 3: Soils Information

Geotechnical Study and Other Infiltration Testing Data

**GEOTECHNICAL INVESTIGATION
PROPOSED COMMERCIAL/INDUSTRIAL
BUILDING**

West Side of Wilson Avenue, 820± feet South of
East Rider Street
Perris, California
for
First Industrial Realty Trust, Inc.



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

September 15, 2021
Revised March 4, 2022



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

First Industrial Realty Trust, Inc.
898 N. Pacific Coast Highway. STE 175
El Segundo, CA 90245

Attention: Mr. Matt Pioli
Investment Officer

Project No.: **21G206-3**

Subject: **Geotechnical Investigation**
Proposed Commercial/Industrial Building
West Side of Wilson Avenue, 820± feet South of East Rider Street
Perris, California

Dear Mr. Pioli:

In accordance with your request, we have conducted a geotechnical investigation at the subject site. We are pleased to present this report summarizing the conclusions and recommendations developed from our investigation.

We sincerely appreciate the opportunity to be of service on this project. We look forward to providing additional consulting services during the course of the project. If we may be of further assistance in any manner, please contact our office.

Respectfully Submitted,

SOUTHERN CALIFORNIA GEOTECHNICAL, INC.

Joseph Lozano Leon
Staff Engineer

Robert G. Trazo, GE 2655
Principal Engineer



Distribution: (1) Addressee

TABLE OF CONTENTS

1.0 EXECUTIVE SUMMARY	1
2.0 SCOPE OF SERVICES	4
3.0 SITE AND PROJECT DESCRIPTION	5
3.1 Site Conditions	5
3.2 Proposed Development	5
4.0 SUBSURFACE EXPLORATION	7
4.1 Scope of Exploration/Sampling Methods	7
4.2 Geotechnical Conditions	7
5.0 LABORATORY TESTING	9
6.0 CONCLUSIONS AND RECOMMENDATIONS	12
6.1 Seismic Design Considerations	12
6.2 Geotechnical Design Considerations	16
6.3 Site Grading Recommendations	19
6.4 Construction Considerations	23
6.5 Foundation Design and Construction	25
6.6 Floor Slab Design and Construction	27
6.7 Exterior Flatwork Design and Construction	28
6.8 Retaining Wall Design and Construction	28
6.9 Pavement Design Parameters	31
7.0 GENERAL COMMENTS	33
8.0 REFERENCES	34
APPENDICES	
A Plate 1: Site Location Map Plate 2: Boring Location Plan	
B Boring Logs	
C Laboratory Test Results	
D Grading Guide Specifications	
E Seismic Design Parameters	
F Liquefaction Evaluation Spreadsheets	

1.0 EXECUTIVE SUMMARY

Presented below is a brief summary of the conclusions and recommendations of this investigation. Since this summary is not all inclusive, it should be read in complete context with the entire report.

Geotechnical Design Considerations

- The Riverside County GIS website indicates that the subject site is located within a zone of moderate liquefaction susceptibility.
- Our site-specific liquefaction evaluation included two borings extended to a depth of 50± feet. A potentially liquefiable soil stratum was encountered at one of the borings between depths of 17 and 22± feet. The potential total dynamic settlement at this boring location is estimated to be 0.46± inches.
- Based on the estimated magnitude of the differential settlements, the proposed structure may be supported on shallow foundations. Additional design considerations related to the potentially liquefiable soils are presented within of this report.
- Most of the borings encountered artificial fill materials, extending to depths of 2½ to 5½± feet below the existing site grades. The fill soils possess varying strengths and densities, and are considered to represent undocumented fill. These soils, in their present condition, are not considered suitable for support of the foundation loads of the new structure.
- In addition, possible fill soils were encountered at some of the boring locations, extending to depths of 4½ to 8± feet.
- The fill soils and possible fill soils are underlain by native alluvium which possesses varying strengths and densities. The results of laboratory testing indicate that the near-surface soils within the upper 5 to 6± feet possess a potential for moderate to severe collapse when exposed to moisture infiltration as well as excessive consolidation when exposed to load increases in the range of those that will be exerted by the new foundations.
- Some of the near-surface soils at this site possess a medium expansion potential. Additional design considerations related to expansive soils are presented in this report.
- Based on the results of corrosivity testing, the on-site soils are considered to be corrosive to ductile iron pipe and to copper pipe.

Site Preparation

- Initial site preparation should include stripping of any surficial vegetation. The surficial vegetation, and any organic soils should be properly disposed of off-site.
- Demolition should include utilities and any other subsurface improvements that will not remain in place with the new development. Debris resultant from demolition should be disposed of off-site.
- Remedial grading is recommended to be performed within the proposed building area in order to remove all of the undocumented fill soils in their entirety, the upper portion of the near-surface native alluvial soils, and any soils disturbed during the demolition process. The proposed building area should be overexcavated to a depth of at least 5 feet below existing grade and to a depth of 5 feet below proposed building pad subgrade elevation, whichever is greater. Within the foundation influence zones, the overexcavation should extend to a depth

of at least 3 feet below proposed foundation bearing grade. The overexcavation should extend horizontally at least 5 feet beyond the building and foundation perimeters.

- After the overexcavation has been completed, the resulting subgrade soils should be evaluated by the geotechnical engineer to identify any additional soils that should be removed. The resulting subgrade should then be scarified to a depth of 12 inches and moisture conditioned (or air dried) to 2 to 4 percent above optimum. The previously excavated soils may then be replaced as compacted structural fill. All structural fill soils should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density.
- The new pavement and flatwork subgrade soils are recommended to be scarified to a depth of 12± inches, thoroughly moisture conditioned and recompacted to at least 90 percent of the ASTM D-1557 maximum dry density.

Building Foundations

- Conventional shallow foundations, supported in newly placed compacted fill.
- 2,500 lbs/ft² maximum allowable soil bearing pressure.
- Reinforcement consisting of at least six (6) No. 5 rebars (3 top and 3 bottom) in strip footings, due to the presence of potentially liquefiable and medium expansive native alluvial soils.
- Additional reinforcement may be necessary for structural considerations.

Building Floor Slab

- Conventional Slab-on-Grade, 6 inches thick.
- Modulus of Subgrade Reaction: $k = 100$ psi/in.
- Minimum slab reinforcement: Reinforcement of the floor slab should consist of No. 3 bars at 18-inches on center in both directions due to the presence of potentially liquefiable and medium expansive native alluvial soils.
- The actual floor slab reinforcement should be determined by the structural engineer, based upon the imposed loading.

Pavements

ASPHALT PAVEMENTS (R = 20)					
Materials	Thickness (inches)				
	Auto Parking and Auto Drive Lanes (TI = 4.0 to 5.0)	Truck Traffic			
		TI = 6.0	TI = 7.0	TI = 8.0	TI = 9.0
Asphalt Concrete	3	3½	4	5	5½
Aggregate Base	8	10	12	14	16
Compacted Subgrade	12	12	12	12	12

PORTLAND CEMENT CONCRETE PAVEMENTS (R = 20)				
Materials	Thickness (inches)			
	Autos and Light Truck Traffic (TI = 6.0)	Truck Traffic		
		TI = 7.0	TI = 8.0	TI = 9.0
PCC	5	5½	7	8½
Compacted Subgrade (95% minimum compaction)	12	12	12	12

2.0 SCOPE OF SERVICES

The scope of services performed for this project was in accordance with our Proposal No. 21P348, dated August 2, 2021, and Change Order Nos. 21G206-CO, dated January 13, 2022, and 21G206-CO2, dated February 15, 2022. The scope of services included a visual site reconnaissance, subsurface exploration, field and laboratory testing, and geotechnical engineering analysis to provide criteria for preparing the design of the building foundations, building floor slab, and parking lot pavements along with site preparation recommendations and construction considerations for the proposed development. Based on the location of this site, the geotechnical investigation also included a site-specific liquefaction evaluation. The evaluation of the environmental aspects of this site was beyond the scope of services for this geotechnical investigation.

3.0 SITE AND PROJECT DESCRIPTION

3.1 Site Conditions

The subject site is located on the west side of Wilson Avenue, 820± feet south of the intersection of Wilson Avenue and East Rider Street in Perris, California. The site is bounded to the north by a demolished single-family residence (SFR), to the east by Wilson Street, and to the south and west by vacant lots. The general location of the site is illustrated on the Site Location Map, included as Plate 1 in Appendix A of this report.

The site consists of four rectangular parcels, totaling 9.46± acres in size. Based on our visit to the site and review of Google Earth aerial photographs, the eastern portion of the northernmost parcel is currently developed with a single-story SFR, and is used as a medical recreational facility. The central-northern parcel is vacant and undeveloped. The central-southern and southernmost parcels are each developed with a single-story duplex home and a metal-framed canopy. The existing structures are assumed to be supported on shallow foundation systems, with concrete slab-on-grade floors. Ground surface throughout the parcels generally consists of exposed soil with sparse to dense native grass and weed growth, and occasional medium-to-large trees. Asphaltic concrete pavements with isolated areas of concrete flatwork and medium sized-trees surround the existing medical recreational facility in the northernmost parcel. Abundant scattered debris are located within the western portion of this parcel. In addition, ground surface cover throughout the central parcel consists mainly of open-graded gravel, with small regions of moderate native grass and weed growth.

Detailed topographic information was not available at the time of this report. Based on elevations obtained from Google Earth and visual observations made at the time of the subsurface investigation, the site is relatively flat, with an overall gradient of less than 1± percent.

3.2 Proposed Development

The most current conceptual site plan, identified as A1—3PA prepared by RGA, was provided to our office by the client. The plan indicates that the new development will consist of one (1) new commercial/industrial building, 182,925± ft² in size, located in the eastern portion of the subject site. Dock-high doors and a truck court will be constructed on the west side of the proposed building. The new building is expected to be surrounded by asphaltic concrete (AC) pavements in the parking and drive areas and Portland cement concrete (PCC) pavements in the loading dock area. Several landscaped planters and concrete flatwork are also expected to be included throughout the site.

Detailed structural information has not been provided. It is assumed that the new building will be a single-story structure of tilt-up concrete construction, supported on a conventional shallow foundation system with a concrete slab-on-grade floor. Based on the assumed construction,

maximum column and wall loads are expected to be on the order of 100 kips and 4 to 7 kips per linear foot, respectively.

No significant amounts of below grade construction, such as basements or crawl spaces, are expected to be included in the proposed development. Based on the assumed topography, cuts and fills of up to 3 to 4± feet are expected to be necessary to achieve the proposed building pad grades. It should be noted that this estimate does not include any remedial grading recommendations which are presented in a subsequent section of this report.

4.0 SUBSURFACE EXPLORATION

4.1 Scope of Exploration/Sampling Methods

The subsurface exploration for the current project consisted of nine (9) borings (identified as Boring Nos. B-1 through B-9) advanced to depths of 15 to 50± feet below the existing site grades. Boring Nos. B-2 and B-4 were advanced to depths of 50± feet as a part of the liquefaction analysis for this site. Boring Nos. B-1 through B-6 were performed on August 25, 2021, and Boring Nos. B-7, B-8 and B-9 were performed on January 17, 2022. In addition, 8 hand auger borings (identified as C-1 through C-8) were advanced to a depth of 5 feet as part of the corrosivity testing for this project. Boring Nos. B-1 through B-9 were logged during drilling by a member of our staff.

The borings were advanced with hollow-stem augers, by a conventional truck-mounted drilling rig. The hand auger borings were advanced using manually-operated hand auger equipment. Representative bulk and undisturbed soil samples were taken during drilling. Relatively undisturbed samples were taken with a split barrel "California Sampler" containing a series of one inch long, 2.416± inch diameter brass rings. This sampling method is described in ASTM Test Method D-3550. Samples were also taken using a 1.4± inch inside diameter split spoon sampler, in general accordance with ASTM D-1586. Both of these samplers are driven into the ground with successive blows of a 140-pound weight falling 30 inches. The blow counts obtained during driving are recorded for further analysis. Bulk samples were collected in plastic bags to retain their original moisture content. The relatively undisturbed ring samples were placed in molded plastic sleeves that were then sealed and transported to our laboratory.

The approximate locations of the borings are indicated on the Boring Location Plan, included as Plate 2 in Appendix A of this report. The Boring Logs, which illustrate the conditions encountered at the boring locations, as well as the results of some of the laboratory testing, are included in Appendix B.

4.2 Geotechnical Conditions

Artificial Fill

Artificial fill soils were encountered at the ground surface at all of the boring locations, with the exception of Boring No. B-5, extending to depths of 2½ to 5½± feet below the existing site grades. The fill soils generally consist of loose to medium dense sandy silts and silty sands with varying clay and fine gravel content, and stiff to very stiff sandy clays and clayey silts. The fill soils possess a disturbed and mottled appearance, and some samples possess debris such as plastic fragments, resulting in their classification as artificial fill.

Additional soils classified as possible fill were encountered at the ground surface at Boring No. B-5 and beneath the artificial fill soils at Boring Nos. B-1 and B-6, extending to depths of 4½ to 8± feet. The possible fill soils consist of loose to medium dense sandy silts and silty sands. These soils are similar in composition to the artificial fill soils, but lack any other indicators of fill, resulting in their classification as possible fill.

Alluvium

Native alluvial soils were encountered beneath the fill and possible fill soils at all of the boring locations, extending to at least the maximum depth explored of 50± feet below the existing site grades. The alluvial soils generally consist of medium dense to dense silty sands, clayey sands and sandy silts, and very stiff to hard sandy clays and silty clays. Boring No. B-2 encountered a stratum of dense well graded sands at depths of 42 to 50± feet. Boring No. B-5 encountered a stratum of stiff silty clays at depths of 8 to 12± feet. Boring No. B-7 encountered a stratum of very dense clayey sands at depths of 6½ to 8½± feet.

Groundwater

Free water was encountered during drilling at Boring Nos. B-2 and B-4 at depths of 38 to 38½± feet below the ground surface. Delayed groundwater readings could not be taken these boring based on the shallower cave depths caused by the removal of the augers. Based on these observations, the static groundwater table is considered to have been present at a depth of 38 to 38½± feet below the existing site grades at the time of the subsurface exploration.

As part of our research, we reviewed available groundwater data in order to determine the historic high groundwater level for the site. The primary reference used to determine the historic groundwater depths in this area is the Western Municipal Water District and the San Bernardino Valley Water Conservation District Cooperative Well Measuring Program. High water level from the nearest well is included below:

State Well ID	Approximate Distance from Subject Site	High Water Level MSL (feet)
04S/03W-10M01	< 2640 feet	1,424.00

Based on topographic information obtained from Google Earth, the elevation at the subject site ranges from 1439± feet msl to 1444± feet msl. The elevation of the high water level in the well is 1424± feet msl. Based on this well data, the depth of the high water level at the subject site, measured from the lowest elevation at the subject site, is 15± feet below the existing site grades. Therefore, a groundwater depth of 15± feet is considered to be conservative with respect to the more recent site conditions.

5.0 LABORATORY TESTING

The soil samples recovered from the subsurface exploration were returned to our laboratory for further testing to determine selected physical and engineering properties of the soils. The tests are briefly discussed below. It should be noted that the test results are specific to the actual samples tested, and variations could be expected at other locations and depths.

Classification

All recovered soil samples were classified using the Unified Soil Classification System (USCS), in accordance with ASTM D-2488. The field identifications were then supplemented with additional visual classifications and/or by laboratory testing. The USCS classifications are shown on the Boring Logs and are periodically referenced throughout this report.

Dry Density and Moisture Content

The density has been determined for selected relatively undisturbed ring samples. These densities were determined in general accordance with the method presented in ASTM D-2937. The results are recorded as dry unit weight in pounds per cubic foot. The moisture contents are determined in accordance with ASTM D-2216, and are expressed as a percentage of the dry weight. These test results are presented on the Boring Logs.

Consolidation

Selected soil samples have been tested to determine their consolidation potential, in accordance with ASTM D-2435. The testing apparatus is designed to accept either natural or remolded samples in a one-inch high ring, approximately 2.416 inches in diameter. Each sample is then loaded incrementally in a geometric progression and the resulting deflection is recorded at selected time intervals. Porous stones are in contact with the top and bottom of the sample to permit the addition or release of pore water. The samples are typically inundated with water at an intermediate load to determine their potential for collapse or heave. The results of the consolidation testing are plotted on Plates C-1 through C-7 in Appendix C of this report.

Maximum Dry Density and Optimum Moisture Content

Representative bulk samples were tested to determine their maximum dry densities and optimum moisture contents. The results have been obtained using the Modified Proctor procedure, per ASTM D-1557. These tests are generally used to compare the in-situ densities of undisturbed field samples, and for later compaction testing. Additional testing of other soil type or soil mixes may be necessary at a later date. The results of the testing are plotted on Plates C-8 and C-9 in Appendix C of this report.

Expansion Index

The expansion potential of the on-site soils was determined in general accordance with ASTM D-4829. The testing apparatus is designed to accept a 4-inch diameter, 1-in high, remolded sample.

The sample is initially remolded to 50± 1 percent saturation and then loaded with a surcharge equivalent to 144 pounds per square foot. The sample is then inundated with water, and allowed to swell against the surcharge. The resultant swell or consolidation is recorded after a 24-hour period. The results of the expansion index (EI) testing are as follows:

<u>Sample Identification</u>	<u>Expansion Index</u>	<u>Expansive Potential</u>
B-2 @ 0 to 5 feet	53	Medium
B-3 @ 0 to 5 feet	30	Low
B-7 @ 0 to 5 feet	25	Low

Soluble Sulfates

Representative samples of the near-surface soils were submitted to a subcontracted analytical laboratory for determination of soluble sulfate content. Soluble sulfates are naturally present in soils, and if the concentration is high enough, can result in degradation of concrete which comes into contact with these soils. The results of the soluble sulfate testing are presented below, and are discussed further in a subsequent section of this report.

<u>Sample Identification</u>	<u>Soluble Sulfates (%)</u>	<u>Sulfate Classification</u>
B-2 @ 0 to 5 feet	0.006	Not Applicable (S0)
B-3 @ 0 to 5 feet	0.003	Not Applicable (S0)
B-7 @ 0 to 5 feet	0.030	Not Applicable (S0)
C-1 @ 1 to 2½ feet	0.008	Not Applicable (S0)
C-1 @ 3½ to 5 feet	0.005	Not Applicable (S0)
C-2 @ 1 to 2½ feet	0.007	Not Applicable (S0)
C-2 @ 3½ to 5 feet	0.003	Not Applicable (S0)
C-3 @ 1 to 2½ feet	0.005	Not Applicable (S0)
C-3 @ 3½ to 5 feet	0.008	Not Applicable (S0)
C-4 @ 1 to 2½ feet	0.010	Not Applicable (S0)
C-4 @ 3½ to 5 feet	0.008	Not Applicable (S0)
C-5 @ 1 to 2½ feet	0.001	Not Applicable (S0)
C-5 @ 3½ to 5 feet	0.002	Not Applicable (S0)
C-6 @ 1 to 2½ feet	0.008	Not Applicable (S0)
C-6 @ 3½ to 5 feet	0.013	Not Applicable (S0)
C-7 @ 1 to 2½ feet	0.022	Not Applicable (S0)
C-7 @ 3½ to 5 feet	0.034	Not Applicable (S0)
C-8 @ 1 to 2½ feet	0.033	Not Applicable (S0)
C-8 @ 3½ to 5 feet	0.008	Not Applicable (S0)

Corrosivity Testing

Representative bulk samples of the near-surface soils were submitted to a subcontracted corrosion engineering laboratory to determine if the near-surface soils possess corrosive characteristics with respect to common construction materials. The corrosivity testing included a

determination of the electrical resistivity, pH, chloride, and nitrate concentrations of the soils, as well as other tests. The results of some of these tests are presented below.

<u>Sample Identification</u>	<u>Saturated Resistivity (ohm-cm)</u>	<u>pH</u>	<u>Chlorides (mg/kg)</u>	<u>Nitrates (mg/kg)</u>
B-2 @ 0 to 5 feet	1,520	7.6	20	173
B-3 @ 0 to 5 feet	1,200	7.7	27	186
C-1 @ 1 to 2½ feet	3,752	8.1	38.0	47.5
C-1 @ 3½ to 5 feet	3,752	9.2	60.4	41.7
C-2 @ 1 to 2½ feet	5,695	9.1	23.4	31.9
C-2 @ 3½ to 5 feet	4,824	9.2	18.7	5.5
C-3 @ 1 to 2½ feet	4,020	8.6	38.2	27.2
C-3 @ 3½ to 5 feet	2,345	8.4	136.5	16.5
C-4 @ 1 to 2½ feet	2,211	8.8	65.4	7.4
C-4 @ 3½ to 5 feet	2,412	9.1	19.0	3.9
C-5 @ 1 to 2½ feet	4,087	9.4	9.0	3.9
C-5 @ 3½ to 5 feet	5,159	8.9	25.7	12.3
C-6 @ 1 to 2½ feet	2,479	8.6	26.9	45.9
C-6 @ 3½ to 5 feet	1,608	8.8	159.8	83.2
C-7 @ 1 to 2½ feet	2,211	8.4	109.9	98.8
C-7 @ 3½ to 5 feet	1,072	9.1	294.0	57.0
C-8 @ 1 to 2½ feet	2,345	10.4	146.7	276.5
C-8 @ 3½ to 5 feet	2,144	9.1	64.6	91.1

Grain Size Analysis

Limited grain size analyses have been performed on four (4) selected samples, in accordance with ASTM D-1140. These samples were washed over a #200 sieve to determine the percentage of fine-grained material in each sample, which is defined as the material which passes the #200 sieve. The weight of the portion of the sample retained on each screen is recorded and the percentage finer or coarser of the total weight is calculated. The results of these laboratory tests are shown on the enclosed boring logs.

6.0 CONCLUSIONS AND RECOMMENDATIONS

Based on the results of our review, field exploration, laboratory testing and geotechnical analysis, the proposed development is considered feasible from a geotechnical standpoint. The recommendations contained in this report should be taken into the design, construction, and grading considerations.

The recommendations are contingent upon all grading and foundation construction activities being monitored by the geotechnical engineer of record. The recommendations are provided with the assumption that an adequate program of client consultation, construction monitoring, and testing will be performed during the final design and construction phases to verify compliance with these recommendations. Maintaining Southern California Geotechnical, Inc., (SCG) as the geotechnical consultant from the beginning to the end of the project will provide continuity of services. The geotechnical engineering firm providing testing and observation services shall assume the responsibility of Geotechnical Engineer of Record.

The Grading Guide Specifications, included as Appendix D, should be considered part of this report, and should be incorporated into the project specifications. The contractor and/or owner of the development should bring to the attention of the geotechnical engineer any conditions that differ from those stated in this report, or which may be detrimental for the development.

6.1 Seismic Design Considerations

The subject site is located in an area which is subject to strong ground motions due to earthquakes. The performance of a site-specific seismic hazards analysis was beyond the scope of this investigation. However, numerous faults capable of producing significant ground motions are located near the subject site. Due to economic considerations, it is not generally considered reasonable to design a structure that is not susceptible to earthquake damage. Therefore, significant damage to structures may be unavoidable during large earthquakes. The proposed structure should, however, be designed to resist structural collapse and thereby provide reasonable protection from serious injury, catastrophic property damage and loss of life.

Faulting and Seismicity

Research of available maps indicates that the subject site is not located within an Alquist-Priolo Earthquake Fault Zone. In addition, our review of the Riverside County RCIT GIS website indicates that the site is not located within a Riverside County fault zone. Furthermore, SCG did not identify any evidence of faulting during the geotechnical investigation. Therefore, the possibility of significant fault rupture on the site is considered to be low. Therefore, the possibility of significant fault rupture on the site is considered to be low.

The potential for other geologic hazards such as seismically induced settlement, lateral spreading, tsunamis, inundation, seiches, flooding, and subsidence affecting the site is considered low. Based on Map Number 06065C1430H, dated August 18, 2014, prepared by FEMA Flood Maps, the project site is in an area designated as Other Flood Area, Zone X, which is determined to be an

area of 0.2% annual chance flood; area of 1% annual chance flood with average depths of less than 1 foot or with drainage areas less than 1 square mile; and an area protected by levees from 1% annual chance flood.

Seismic Design Parameters

The 2019 California Building Code (CBC) provides procedures for earthquake resistant structural design that include considerations for on-site soil conditions, occupancy, and the configuration of the structure including the structural system and height. The seismic design parameters presented below are based on the soil profile and the proximity of known faults with respect to the subject site.

Based on standards in place at the time of this report, the proposed development is expected to be designed in accordance with the requirements of the 2019 edition of the California Building Code (CBC), which was adopted on January 1, 2020.

The 2019 CBC Seismic Design Parameters have been generated using the SEAOC/OSHPD Seismic Design Maps Tool, a web-based software application available at the website www.seismicmaps.org. This software application calculates seismic design parameters in accordance with several building code reference documents, including ASCE 7-16, upon which the 2019 CBC is based. The application utilizes a database of risk-targeted maximum considered earthquake (MCE_R) site accelerations at 0.01-degree intervals for each of the code documents. The table below was created using data obtained from the application. The output generated from this program is included as Plate E-1 in Appendix E of this report.

The 2019 CBC requires that a site-specific ground motion study be performed in accordance with Section 11.4.8 of ASCE 7-16 for Site Class D sites with a mapped S_1 value greater than 0.2. However, Section 11.4.8 of ASCE 7-16 also indicates an exception to the requirement for a site-specific ground motion hazard analysis for certain structures on Site Class D sites. The commentary for Section 11 of ASCE 7-16 (Page 534 of Section C11 of ASCE 7-16) indicates that "In general, this exception effectively limits the requirements for site-specific hazard analysis to very tall and or flexible structures at Site Class D sites." **Based on our understanding of the proposed development, the seismic design parameters presented below were calculated assuming that the exception in Section 11.4.8 applies to the proposed structure at this site. However, the structural engineer should verify that this exception is applicable to the proposed structure.** Based on the exception, the spectral response accelerations presented below were calculated using the site coefficients (F_a and F_v) from Tables 1613.2.3(1) and 1613.2.3(2) presented in Section 16.4.4 of the 2019 CBC.

2019 CBC SEISMIC DESIGN PARAMETERS

Parameter		Value
Mapped Spectral Acceleration at 0.2 sec Period	S_S	1.500
Mapped Spectral Acceleration at 1.0 sec Period	S_1	0.573
Site Class	---	D*
Site Modified Spectral Acceleration at 0.2 sec Period	S_{MS}	1.500
Site Modified Spectral Acceleration at 1.0 sec Period	S_{M1}	0.990
Design Spectral Acceleration at 0.2 sec Period	S_{DS}	1.000
Design Spectral Acceleration at 1.0 sec Period	S_{D1}	0.660

*The 2019 CBC requires that Site Class F be assigned to any profile containing soils vulnerable to potential failure or collapse under seismic loading, such as liquefiable soils. For Site Class F, the site *coefficients* are to be determined in accordance with Section 11.4.7 of ASCE 7-16. However, Section 20.3.1 of ASCE 7-16 indicates that for sites with structures having a fundamental period of vibration equal to or less than 0.5 seconds, the site coefficient factors (F_a and F_v) may be determined using the standard procedures. The seismic design parameters tabulated above were calculated using the site coefficient factors for Site Class D, assuming that the fundamental period of the structure is less than 0.5 seconds. However, the results of the liquefaction evaluation indicate that the subject site is underlain by potentially liquefiable soils. Therefore, if the proposed structure has a fundamental period greater than 0.5 seconds, a site-specific seismic hazards analysis will be required and additional subsurface exploration will be necessary.

It should be noted that the site coefficient F_v and the parameters S_{M1} and S_{D1} were not included in the SEAOC/OSHPD Seismic Design Maps Tool output for the 2019 CBC. We calculated these parameters-based on Table 1613.2.3(2) in Section 16.4.4 of the 2019 CBC using the value of S_1 obtained from the Seismic Design Maps Tool, assuming that a site-specific ground motion hazards analysis is not required for the proposed building at this site.

Ground Motion Parameters

For the purposes of the liquefaction analysis performed for this study, we utilized a site acceleration consistent with maximum considered earthquake ground motions, as required by the 2019 CBC. The peak ground acceleration (PGA) was determined in accordance with Section 11.8.3 of ASCE 7-16. The parameter PGA_M is the maximum considered earthquake geometric mean (MCE_G) PGA, multiplied by the appropriate site coefficient from Table 11.8-1 of ASCE 7-16. The web-based software application SEAOC/OSHPD Seismic Design Maps Tool (described in the previous section) was used to determine PGA_M , which is 0.550g. A portion of the program output is included as Plate E-1 of this report. An associated earthquake magnitude was obtained from the USGS Unified Hazard Tool, Interactive Deaggregation application available on the USGS website. The deaggregated mean magnitude is 7.01, based on the peak ground acceleration and soil classification D.

Liquefaction

The Riverside County GIS website indicates that the subject site is located within a zone of moderate liquefaction susceptibility. Based on this mapping, the scope of this investigation included additional subsurface exploration, laboratory testing, and engineering analysis in order to determine the site-specific liquefaction potential.

Liquefaction is the loss of strength in generally cohesionless, saturated soils when the pore-water pressure induced in the soil by a seismic event becomes equal to or exceeds the overburden pressure. The primary factors which influence the potential for liquefaction include groundwater table elevation, soil type and plasticity characteristics, relative density of the soil, initial confining pressure, and intensity and duration of ground shaking. The depth within which the occurrence of liquefaction may impact surface improvements is generally identified as the upper 50 feet below the existing ground surface. Liquefaction potential is greater in saturated, loose, poorly graded fine sands with a mean (d_{50}) grain size in the range of 0.075 to 0.2 mm (Seed and Idriss, 1971). Non-sensitive clayey (cohesive) soils which possess a plasticity index of at least 18 (Bray and Sancio, 2006) are generally not considered to be susceptible to liquefaction, nor are those soils which are above the historic static groundwater table.

The liquefaction analysis was conducted in accordance with the requirements of Special Publication 117A (CDMG, 2008), and currently accepted practice (SCEC, 1997). The liquefaction potential of the subject site was evaluated using the empirical method developed by Boulanger and Idriss (Boulanger and Idriss, 2008, 2014). This method predicts the earthquake-induced liquefaction potential of the site based on a given design earthquake magnitude and peak ground acceleration at the subject site. This procedure essentially compares the cyclic resistance ratio (CRR) [the cyclic stress ratio required to induce liquefaction for a cohesionless soil stratum at a given depth] with the earthquake-induced cyclic stress ratio (CSR) at that depth from a specified design earthquake (defined by a peak ground surface acceleration and an associated earthquake moment magnitude). CRR is determined as a function of the corrected SPT N-value ($(N_1)_{60-cs}$, adjusted for fines content). The factor of safety against liquefaction is defined as CRR/CSR. Based on Special Publication 117A, a factor of safety of at least 1.3 is required in order to demonstrate that a given soil stratum is non-liquefiable. Additionally, in accordance with Special Publication 117A, clayey soils which do not meet the criteria for liquefiable soils defined by Bray and Sancio (2006), loose soils with a plasticity index (PI) less than 12 and moisture content greater than 85% of the liquid limit, are considered to be unsusceptible to liquefaction. Non-sensitive soils with a PI greater than 18 are also considered non-liquefiable.

As part of the liquefaction evaluation, Boring Nos. B-2 and B-4 were extended to a depth of 50± feet. The liquefaction analysis procedure is tabulated on the spreadsheet forms included in Appendix F of this report, using the data obtained from these borings. The liquefaction potential of the site was analyzed utilizing a PGA_M of 0.550g for a magnitude 7.01 seismic event. The liquefaction evaluation was performed using the reported historic high groundwater depth of 15 feet.

If liquefiable soils are identified, the potential settlements that could occur as a result of liquefaction are determined using the equation for volumetric strain due to post-cyclic reconsolidation (Yoshimine et. al, 2006). This procedure uses an empirical relationship between the induced cyclic shear strain and the corrected N-value to determine the expected volumetric strain of saturated sands subjected to earthquake shaking. This analysis is also documented on the spreadsheets included in Appendix F.

Conclusions and Recommendations

Potentially liquefiable soils were encountered at one of the 50±-foot deep boring locations. A potentially liquefiable soil stratum was encountered at Boring No. B-4 between depths of 17 and 22± feet. The remaining soil strata encountered below the historic high groundwater table either possess factors of safety in excess of 1.3. Settlement analyses were performed for the potentially liquefiable strata. The results of the settlement analyses indicate the following total deformations:

- Boring No. B-2: 0.00 inches
- Boring No. B-4: 0.46 inches

Based on the results of the settlement analyses, differential settlements are expected to be on the order of ½± inch or less. The estimated differential settlement can be assumed to occur across a distance of 100 feet, indicating a maximum angular distortion of less than 0.001 inches per inch.

Based on our understanding of the proposed development, it is considered feasible to support the proposed structure on shallow foundations. Such a foundation system can be designed to resist the effects of the anticipated differential settlements, to the extent that the structure would not catastrophically fail. Designing the proposed structure to remain completely undamaged during a major seismic event is not considered to be economically feasible. Based on this understanding, the use of shallow foundation systems is considered to be the most economical means of supporting the proposed structure.

In order to support the proposed structure on shallow foundations (such as spread footings) the structural engineer should verify that the structure would not catastrophically fail due to the predicted dynamic differential settlements. Any utility connections to the structure should be designed to withstand the estimated differential settlements. It should also be noted that minor to moderate repairs, including re-leveling, restoration of utility connections, repair of damaged drywall and stucco, etc., would likely be required after occurrence of the liquefaction-induced settlements.

The use of a shallow foundation system, as described in this report, is typical for buildings of this type, where they are underlain by the extent of liquefiable soils encountered at this site. The post-liquefaction damage that could occur within the building proposed for this site will also be typical of similar buildings in the vicinity of this project. However, if the owner determines that this level of potential damage is not acceptable, other geotechnical and structural options are available, including the use of ground improvement techniques or mat foundations.

6.2 Geotechnical Design Considerations

General

Most of the borings encountered artificial fill materials, extending to depths of 2½ to 5½± feet below the existing site grades. Based on a lack of documentation regarding the placement and compaction of the existing fill materials, these soils are considered to consist of undocumented

fill, and are not suitable for the support of the foundation loads of the proposed building. In addition, possible fill soils were encountered at some of the boring locations, extending to depths of 4½ to 8± feet. These fill soils are underlain by native alluvium which possesses varying strengths and densities. The results of laboratory testing indicate that the near-surface soils within the upper 5 to 6± feet possess a potential for moderate to severe collapse when exposed to moisture infiltration as well as excessive consolidation when exposed to load increases in the range of those that will be exerted by the new foundations. By visual examination, the majority of the near-surface samples also possess calcareous nodules and veining throughout, and appear to be weakly cemented. Cemented soils with low relative densities are generally prone to settlement due to collapse when inundated with water. Based on these conditions, remedial grading will be necessary within the proposed building area in order to provide a subgrade suitable for support of the new foundations and floor slab. The remedial grading will also serve to create more uniform support characteristics across the proposed building pad area.

It should be noted that based on the results of corrosivity testing, the on-site soils are considered to be corrosive to ductile iron pipe and to copper pipe.

Settlement

The recommended remedial grading will remove the existing undocumented fill soils and a portion of the near-surface native alluvial soils and replace these materials as compacted structural fill. The native soils that will remain in place below the recommended depth of overexcavation will not be subject to significant stress increases from the foundations of the new structure. Provided that the recommended remedial grading is completed, the post-construction static settlements of the proposed structure are expected to be less than 1.0 and 0.5 inches for total and differential settlements of shallow foundations, respectively.

Expansion

Laboratory testing performed on representative samples of the near-surface soils indicates that these materials possess a low to medium expansion potential (EI = 25, 30 and 53). Based on the presence of expansive soils at this site, care should be given to proper moisture conditioning of all building pad subgrade soils to a moisture content of 2 to 4 percent above the ASTM D-1557 optimum during site grading. In addition to adequately moisture conditioning the subgrade soils and fill soils during grading, special care must be taken to maintaining moisture content of these soils at 2 to 4 percent above the optimum moisture content. This will require the contractor to frequently moisture condition these soils throughout the grading process, unless grading occurs during a period of relatively wet weather. Civil and structural design considerations are presented in Section 6.4 of this report.

Soluble Sulfates

The results of the soluble sulfate testing indicate that the tested soil samples possess a level of soluble sulfates that is considered to be "not applicable" (S0) with respect to the American Concrete Institute (ACI) Publication 318-14 Building Code Requirements for Structural Concrete and Commentary, Section 4.3. Therefore, specialized concrete mix designs are not considered to be necessary, with regard to sulfate protection purposes. It is, however, recommended that

additional soluble sulfate testing be conducted at the completion of rough grading to verify the soluble sulfate concentrations of the soils which are present at pad grade within the building area.

Corrosion Potential

The results of laboratory testing indicate that the tested samples of the near-surface on-site soils possess saturated resistivity values of 1,072 to 5,695 ohm-cm, and pH values of 7.6 to 10.4. These test results have been evaluated in accordance with guidelines published by the Ductile Iron Pipe Research Association (DIPRA). The DIPRA guidelines consist of a point system by which characteristics of the soils are used to quantify the corrosivity characteristics of the site. Resistivity and pH are two of the five factors that enter into the evaluation procedure. Redox potential, relative soil moisture content and sulfides are also included. We have evaluated the corrosivity characteristics of the on-site soils using resistivity, pH and moisture content. **Based on these factors, and utilizing the DIPRA procedure, the on-site soils are considered to be corrosive to ductile iron pipe. Therefore, polyethylene protection is expected to be required for cast iron or ductile iron pipes.** It should be noted that SCG does not practice in the field of corrosion engineering. **Therefore, the client may also wish to contact a corrosion engineer to provide a more thorough evaluation.**

Based on American Concrete Institute (ACI) Publication 318 Building Code Requirements for Structural Concrete and Commentary, reinforced concrete that is exposed to external sources of chlorides requires corrosion protection for the steel reinforcement contained within the concrete. ACI 318 defines concrete exposed to moisture and an external source of chlorides as "severe" or exposure category C2. ACI 318 does not clearly define a specific chloride concentration at which contact with the adjacent soil will constitute a "C2" or severe exposure. However, the Caltrans Memo to Designers 10-5, Protection of Reinforcement Against Corrosion Due to Chlorides, Acids and Sulfates, dated June 2010, indicates that soils possessing chloride concentrations greater than 500 mg/kg are considered to be corrosive to reinforced concrete. The results of the laboratory testing indicate chloride concentrations ranging from 9.0 to 294 mg/kg. Although the soils contain some chlorides, we do not expect that the chloride concentrations of the tested soils are high enough to constitute a "severe" or C2 chloride exposure. Therefore, a chloride exposure category of C1 is considered appropriate for this site.

Nitrates present in soil can be corrosive to copper tubing at concentrations greater than 50 mg/kg. The tested samples possess nitrate concentrations ranging from 3.9 to 276.5 mg/kg. **Based on these test results, the on-site soils are considered to be corrosive to copper pipe.**

Since SCG does not practice in the area of corrosion engineering, we recommend that the client contact a corrosion engineer to provide a more thorough evaluation of these test results. It is recommended that additional testing be conducted during the design-level geotechnical investigation.

Shrinkage/Subsidence

Removal and recompaction of the existing fill soils and near-surface alluvium is estimated to result in an average shrinkage of 4 to 14 percent. However, potential shrinkage for individual samples ranged locally between 1 and 23 percent. The potential shrinkage estimate is based on dry density testing performed on small-diameter samples taken at the boring locations. If a more accurate

and precise shrinkage estimate is desired, SCG can perform a shrinkage study involving several excavated test-pits where in-place densities are determined using in-situ testing methods instead of laboratory density testing on small-diameter samples. Please contact SCG for details and a cost estimate regarding a shrinkage study, if desired.

Minor ground subsidence is expected to occur in the soils below the zone of removal, due to settlement and machinery working. The subsidence is estimated to be 0.1 feet.

These estimates are based on previous experience and the subsurface conditions encountered at the boring locations. The actual amount of subsidence is expected to be variable and will be dependent on the type of machinery used, repetitions of use, and dynamic effects, all of which are difficult to assess precisely.

Grading and Foundation Plan Review

Grading and foundation plans were not available at the time of this report. It is therefore recommended that we be provided with copies of the preliminary grading and foundation plans, when they become available, for review with regard to the conclusions, recommendations, and assumptions contained within this report.

6.3 Site Grading Recommendations

The grading recommendations presented below are based on the subsurface conditions encountered at the boring locations, and our understanding of the proposed development. We recommend that all grading activities be completed in accordance with the Grading Guide Specifications included as Appendix D of this report, unless superseded by site-specific recommendations presented below.

Site Stripping and Demolition

Demolition of the existing structures and any associated improvements will be necessary to facilitate the construction of the proposed development. Demolition of the existing structures should include all foundations, floor slabs, and any associated utilities. Any septic systems encountered during demolition and/or grading (if present) should be removed in their entirety. Any associated leach fields or other existing underground improvements should also be removed in their entirety. Debris resultant from demolition should be disposed of off-site. All applicable federal, state and local specifications and regulations should be followed in demolition, abandonment, and disposal of the existing structures and resulting debris. The existing open-graded gravel may be re-used as compacted fill, provided their maximum particle size is less than 2 inches, are cleaned from any debris or organic content, and well mixed with sandy soils. Mixing open-graded gravel with clayey soils is not recommended.

Initial site stripping should include removal of the surficial vegetation from the site. Stripping should include native grass, weeds, shrubs and trees. Root systems associated with the trees should be removed in their entirety, and the resultant excavations should be backfilled with compacted structural fill soils. These materials should be properly disposed of off-site. The actual

extent of site stripping should be determined in the field by the geotechnical engineer, based on the organic content and stability of the materials encountered.

Treatment of Existing Soils: Building Pad

Remedial grading should be performed within the proposed building area in order to remove the existing undocumented fill soils, any soils disturbed during demolition, and the upper portion of the near-surface native alluvium. Undocumented fill soils were encountered at most of the boring locations, extending to depths of 2½ to 5½± feet below the existing site grades. Based on conditions encountered at the boring locations, the existing soils within the proposed building area are recommended to be overexcavated to a depth of at least 5 feet below existing grades and to a depth of at least 5 feet below proposed building pad subgrade elevation, whichever is greater. Within the influence zones of the new foundations, the overexcavation should extend to a depth of at least 3 feet below proposed foundation bearing grade. In addition, possible fill soils were encountered at some of the boring locations, extending to depths of 4½ to 8± feet. We recommend that the possible fill soils be evaluated at the time of remedial grading, in order to determine if the existing possible fill soils are suitable for the support of the new structure. These soils should be pot-holed at several locations to determine the extent of remedial grading necessary in these areas. If these soils are found to consist of undocumented fill or otherwise unsuitable native alluvium, it is recommended that these areas be removed until a suitable overexcavation subgrade is achieved.

The overexcavation areas should extend at least 5 feet beyond the building and foundation perimeters, and to an extent equal to the depth of fill placed below the foundation bearing grade, whichever is greater. If the proposed structure incorporates any exterior columns (such as for a canopy or overhang) the area of overexcavation should also encompass these areas.

Following completion of the overexcavation, the subgrade soils within the building area should be evaluated by the geotechnical engineer to verify their suitability to serve as the structural fill subgrade, as well as to support the foundation loads of the new structure. This evaluation should include proofrolling and probing to identify any soft, loose or otherwise unstable soils that must be removed. Some localized areas of deeper excavation may be required if additional fill materials or loose, porous, or low-density native soils are encountered at the base of the overexcavation.

Based on conditions encountered at the exploratory boring locations, moist to very moist soils may be encountered at or near the base of the recommended overexcavation. Scarification and air drying of these materials may be sufficient to obtain a stable subgrade. However, if highly unstable soils are identified, and if the construction schedule does not allow for delays associated with drying, mechanical stabilization, usually consisting of coarse crushed stone and/or geotextile, may be necessary. If unstable subgrade conditions are encountered, the geotechnical engineer should be contacted for supplementary recommendations.

After a suitable overexcavation subgrade has been achieved, the exposed soils should be scarified to a depth of at least 12 inches and moisture conditioned or air dried to achieve a moisture content of 2 to 4 percent above optimum moisture content. The subgrade soils should then be recompacted to at least 90 percent of the ASTM D-1557 maximum dry density. The building pad area may then be raised to grade with previously excavated soils or imported structural fill.

Treatment of Existing Soils: Retaining Walls and Site Walls

The existing soils within the areas of any proposed retaining walls and site walls should be overexcavated to a depth of 3 feet below foundation bearing grade and replaced as compacted structural fill as discussed above for the proposed building pad. Any undocumented fill soils or disturbed native alluvium within any of these foundation areas should be removed in their entirety. The overexcavation areas should extend at least 3 feet beyond the foundation perimeters, and to an extent equal to the depth of fill below the new foundations. Any erection pads for tilt-up concrete walls are considered to be part of the foundation system. Therefore, these overexcavation recommendations are applicable to erection pads. The overexcavation subgrade soils should be evaluated by the geotechnical engineer prior to scarifying, moisture conditioning to within 2 to 4 percent above the optimum moisture content, and recompacting the upper 12 inches of exposed subgrade soils. The previously excavated soils may then be replaced as compacted structural fill.

If the full lateral recommended remedial grading cannot be completed for the proposed retaining walls and site walls located along property lines, the foundations for those walls should be designed using a reduced allowable bearing pressure. Furthermore, the contractor should take necessary precautions to protect the adjacent improvements during rough grading. Specialized grading techniques, such as A-B-C slot cuts, will likely be required during remedial grading. The geotechnical engineer of record should be contacted if additional recommendations, such as shoring design recommendations, are required during grading.

Treatment of Existing Soils: Parking Areas

Based on economic considerations, overexcavation of the existing near-surface existing soils in the new parking and drive areas is not considered warranted, with the exception of areas where lower strength or unstable soils are identified by the geotechnical engineer during grading. Subgrade preparation in the new parking and drive areas should initially consist of removal of all soils disturbed during stripping and demolition operations.

The geotechnical engineer should then evaluate the subgrade to identify any areas of additional unsuitable soils. Any such materials should be removed to a level of firm and unyielding soil. The exposed subgrade soils should then be scarified to a depth of 12± inches, moisture conditioned to 2 to 4 percent above the optimum moisture content, and recompacted to at least 90 percent of the ASTM D-1557 maximum dry density. Based on the presence of variable strength surficial soils throughout the site, it is expected that some isolated areas of additional overexcavation may be required to remove zones of lower strength, unsuitable soils.

The grading recommendations presented above for the proposed parking and drive areas assume that the owner and/or developer can tolerate minor amounts of settlement within these areas. The grading recommendations presented above do not mitigate the extent of undocumented fill or compressible/collapsible native alluvium in the parking and drive areas. As such, some settlement and associated pavement distress could occur. Typically, repair of such distressed areas involves significantly lower costs than completely mitigating these soils at the time of construction. If the owner cannot tolerate the risk of such settlements, the parking and drive

areas should be overexcavated to a depth of 2 feet below proposed pavement subgrade elevation, with the resulting soils replaced as compacted structural fill.

Treatment of Existing Soils: Flatwork Areas

Subgrade preparation in the new flatwork areas should initially consist of removal of all soils disturbed during stripping and possible demolition operations. The geotechnical engineer should then evaluate the subgrade to identify any areas of additional unsuitable soils. The subgrade soils should then be scarified to a depth of 12± inches, moisture conditioned or air dried to 2 to 4 percent above optimum, and recompacted to at least 90 percent of the ASTM D-1557 maximum dry density. Based on the presence of variable strength alluvial soils throughout the subject site, it is expected that some isolated areas of additional overexcavation may be required to remove zones of lower strength, unsuitable soils.

As noted previously, the subject site is underlain by low to medium expansive soils. Support of new flatwork on medium expansive soils carries additional risk with respect to flatwork movement and potential distress. This report provides recommendations for moisture conditioning and additional steel reinforcement in the flatwork areas in order to minimize the potential effects of the expansive soils. However, if additional protection is desired, the client should consider the placement of a 1 to 2-foot thick layer of non-expansive soil beneath all flatwork.

Fill Placement

- Fill soils should be placed in thin (6± inches), near-horizontal lifts, moisture conditioned (or air dried) to 2 to 4 percent above the optimum moisture content, and compacted.
- On-site soils may be used for fill provided they are cleaned of any debris to the satisfaction of the geotechnical engineer.
- All grading and fill placement activities should be completed in accordance with the requirements of the 2019 CBC and the grading code of the city of Perris.
- All fill soils should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density. Fill soils should be well mixed.
- Compaction tests should be performed periodically by the geotechnical engineer as random verification of compaction and moisture content. These tests are intended to aid the contractor. Since the tests are taken at discrete locations and depths, they may not be indicative of the entire fill and therefore should not relieve the contractor of his responsibility to meet the job specifications.

Imported Structural Fill

All imported structural fill should consist of low expansive ($EI < 50$), well graded soils possessing at least 10 percent fines (that portion of the sample passing the No. 200 sieve). Additional specifications for structural fill are presented in the Grading Guide Specifications, included as Appendix D.

Utility Trench Backfill

In general, all utility trench backfill should be compacted to at least 90 percent of the ASTM D-1557 maximum dry density. As an alternative, a clean sand (minimum Sand Equivalent of 30) may be placed within trenches and compacted in place (jetting or flooding is not recommended).

Compacted trench backfill should conform to the requirements of the local grading code, and more restrictive requirements may be indicated by the city of Perris. All utility trench backfills should be witnessed by the geotechnical engineer. The trench backfill soils should be compaction tested where possible; probed and visually evaluated elsewhere.

Utility trenches which parallel a footing, and extending below a 1h:1v (horizontal to vertical) plane projected from the outside edge of the footing should be backfilled with structural fill soils, compacted to at least 90 percent of the ASTM D-1557 standard. Pea gravel backfill should not be used for these trenches.

Any soils used to backfill voids around subsurface utility structures, such as manholes or vaults, should be placed as compacted structural fill. If it is not practical to place compacted fill in these areas, then such void spaces may be backfilled with lean concrete slurry. Uncompacted pea gravel or sand is not recommended for backfilling these voids since these materials have a potential to settle and thereby cause distress of pavements placed around these subterranean structures.

6.4 Construction Considerations

Excavation Considerations

The near-surface soils generally consist of moderate strength silty sands, sandy silts, clayey sands, sandy clays and silty clays. These materials may be subject to minor to moderate caving within shallow excavations. Where caving does occur, flattened excavation slopes may be sufficient to provide excavation stability. On a preliminary basis, the inclination of temporary slopes should not exceed 2h:1v. The inclination of temporary slopes within on-site clayey soils should not exceed 1.5h:1v. Deeper excavations may require some form of external stabilization such as shoring or bracing. Maintaining adequate moisture content within the near-surface soils will improve excavation stability. All excavation activities on this site should be conducted in accordance with Cal-OSHA regulations.

Expansive Soils

The near-surface soils within the subject site have been determined to possess a low to medium expansion potential. Therefore, care should be given to proper moisture conditioning of all subgrade soils to a moisture content of 2 to 4 percent above the Modified Proctor optimum during site grading. All imported fill soils should have low expansive ($EI < 50$) characteristics. **In addition to adequately moisture conditioning the subgrade soils and fill soils during grading, special care must be taken to maintain the moisture content of these soils at 2 to 4 percent above the Modified Proctor optimum. This will require the contractor to frequently moisture condition these soils throughout the grading process, unless grading occurs during a period of relatively wet weather.**

Due to the presence of expansive soils at this site, provisions should be made to limit the potential for surface water to penetrate the soils immediately adjacent to the new structure. These provisions should include directing surface runoff into rain gutters and area drains, reducing the extent of landscaped areas around the structure, and sloping the ground surface away from the

building. Where possible, it is recommended that landscaped planters not be located immediately adjacent to the proposed building. If landscaped planters around the building are necessary, it is recommended that drought tolerant plants or a drip irrigation system be utilized, to minimize the potential for deep moisture penetration around the structure. Presented below is a list of additional soil moisture control recommendations that should be considered by the owner, developer, and civil engineer:

- Ponding and areas of low flow gradients in unpaved walkways, grass and planter areas should be avoided. In general, minimum drainage gradients of 2 percent should be maintained in unpaved areas.
- Bare soil within five feet of proposed structure should be sloped at a minimum five percent gradient away from the structure (about three inches of fall in five feet), or the same area could be paved with a minimum surface gradient of one percent. Pavement is preferable.
- Decorative gravel ground cover tends to provide a reservoir for surface water and may hide areas of ponding or poor drainage. Decorative gravel is, therefore, not recommended and should not be utilized for landscaping unless equipped with a subsurface drainage system designed by a licensed landscape architect.
- Positive drainage devices, such as graded swales, paved ditches, and catch basins should be installed at appropriate locations within the area of proposed development.
- Concrete walks and flatwork should not obstruct the free flow of surface water to the appropriate drainage devices.
- Area drains should be recessed below grade to allow free flow of water into the drain. Concrete or brick flatwork joints should be sealed with mortar or flexible mastic.
- Gutter and downspout systems should be installed to capture all discharge from roof areas. Downspouts should discharge directly into a pipe or paved surface system to be conveyed off-site.
- Enclosed planters adjoining, or in close proximity to proposed structures, should be sealed at the bottom and provided with subsurface collection systems and outlet pipes.
- Depressed planters should be raised with soil to promote runoff (minimum drainage gradient two percent or five percent, see above), and/or equipped with area drains to eliminate ponding.
- Drainage outfall locations should be selected to avoid erosion of slopes and/or properly armored to prevent erosion of graded surfaces. No drainage should be directed over or towards adjoining slopes.
- All drainage devices should be maintained on a regular basis, including frequent observations during the rainy season to keep the drains free of leaves, soil and other debris.
- Landscape irrigation should conform to the recommendations of the landscape architect and should be performed judiciously to preclude either soaking or excessive drying of the foundation soils. This should entail regular watering during the drier portions of the year and little or no irrigation during the rainy season. Automatic sprinkler systems should, therefore, be switched to manual operation during the rainy season. Good irrigation practice typically requires frequent application of limited quantities of water that are sufficient to sustain plant growth, but do not excessively wet the soils. Ponding and/or run-off of irrigation water are indications of excessive watering.

Other provisions, as determined by the landscape architect or civil engineer, may also be appropriate.

Moisture Sensitive Subgrade Soils

As discussed in Section 6.3 of this report, unstable subgrade soils may be encountered at the base of the overexcavations within the proposed building area. The extent of unstable subgrade soils will, to a large degree, depend on methods used by the contractor to avoid adding additional moisture to these soils or disturbing soils which already possess high moisture contents. If grading

occurs during a period of relatively wet weather, an increase in subgrade instability should also be expected. **If unstable subgrade conditions are encountered, it is recommended that only tracked vehicles be used for fill placement and compaction.**

If the construction schedule dictates that site grading will occur during a period of wet weather, allowances should be made for costs and delays associated with drying the on-site soils or import of a drier, less moisture sensitive fill material. Grading during wet or cool weather may also increase the depth of overexcavation in the pad area as well as the need for a stabilization layer.

Groundwater

The historic groundwater table is considered to exist at a depth of 15± feet below the existing grades. Therefore, groundwater is not expected to impact the grading or foundation construction activities.

6.5 Foundation Design and Construction

Based on the preceding grading recommendations, it is assumed that the new building pad will be underlain by structural fill soils extending to depths of at least 3 feet below foundation bearing grade, underlain by 1± foot of additional soil that has been densified and moisture conditioned in place. Based on this subsurface profile, the proposed structure may be supported on conventional shallow foundations.

Foundation Design Parameters

New square and rectangular footings may be designed as follows:

- Maximum, net allowable soil bearing pressure: 2,500 lbs/ft².
- Maximum, net allowable soil bearing pressure: 1,500 lbs/ft² if the full recommended lateral extent of remedial grading cannot be achieved.
- Minimum wall/column footing width: 14 inches/24 inches.
- Minimum longitudinal steel reinforcement within strip footings: Six (6) No. 5 rebars (3 top and 3 bottom), due to the presence of medium expansive and potentially liquefiable soils.
- Minimum foundation embedment: 12 inches into suitable structural fill soils, and at least 18 inches below adjacent exterior grade. Interior column footings may be placed immediately beneath the floor slab.
- It is recommended that the perimeter building foundations be continuous across all exterior doorways. Any flatwork adjacent to the exterior doors should be doweled into the perimeter foundations in a manner determined by the structural engineer.

The allowable bearing pressures presented above may be increased by 1/3 when considering short duration wind. **However, the allowable bearing pressures presented above may**

not be increased when considering seismic loads. The minimum steel reinforcement recommended above is based on standard geotechnical practice. Additional rigidity may be necessary for structural considerations, or to resist the effects of the liquefaction-induced differential settlements, as discussed in Section 6.1. The actual design of the foundations should be determined by the structural engineer.

Foundation Construction

The foundation subgrade soils should be evaluated at the time of overexcavation, as discussed in Section 6.3 of this report. It is further recommended that the foundation subgrade soils be evaluated by the geotechnical engineer immediately prior to steel or concrete placement. Soils suitable for direct foundation support should consist of newly placed structural fill, compacted to at least 90 percent of the ASTM D-1557 maximum dry density. Any unsuitable materials should be removed to a depth of suitable bearing compacted structural fill or suitable native alluvium (where reduced bearing pressures are utilized), with the resulting excavations backfilled with compacted fill soils. As an alternative, lean concrete slurry (500 to 1,500 psi) may be used to backfill such isolated overexcavations.

The foundation subgrade soils should also be properly moisture conditioned to 2 to 4 percent above the Modified Proctor optimum, to a depth of at least 12 inches below bearing grade. Since it is typically not feasible to increase the moisture content of the floor slab and foundation subgrade soils once rough grading has been completed, care should be taken to maintain the moisture content of the building pad subgrade soils throughout the construction process.

Estimated Foundation Settlements

Post-construction total and differential static settlements of shallow foundations designed and constructed in accordance with the previously presented recommendations are estimated to be less than 1.0 and 0.5 inches, respectively, under static conditions. Differential movements are expected to occur over a 30-foot span, thereby resulting in an angular distortion of less than 0.002 inches per inch. These settlements are in addition to the liquefaction-induced settlements previously discussed in Section 6.1 of this report.

Lateral Load Resistance

Lateral load resistance will be developed by a combination of friction acting at the base of foundations and slab and the passive earth pressure developed by footings below grade. The following friction and passive pressure may be used to resist lateral forces:

- Passive Earth Pressure: 275 lbs/ft³
- Friction Coefficient: 0.28

These are allowable values, and include a factor of safety. When combining friction and passive resistance, the passive pressure component should be reduced by one-third. These values assume that footings will be poured directly against compacted structural fill soils. The maximum allowable passive pressure is 2,500 lbs/ft².

6.6 Floor Slab Design and Construction

Subgrades which will support the new floor slab should be prepared in accordance with the recommendations contained in the ***Site Grading Recommendations*** section of this report. Based on the anticipated grading which will occur at this site, and based on the design considerations presented in Section 6.1 of this report, the floor of the proposed structure may be constructed as a conventional slab-on-grade supported on newly placed structural fill, extending to a depth of at least 5 feet below finished pad grade. Based on geotechnical considerations, the floor slab may be designed as follows:

- Minimum slab thickness: 6 inches.
- Modulus of Subgrade Reaction: 100 psi/in.
- Minimum slab reinforcement: No. 3 bars at 18-inches on-center, in both directions, due to presence of medium expansive and potentially liquefiable soils. The actual floor slab reinforcement should be determined by the structural engineer, based upon the imposed loading, and the potential liquefaction induced settlements.
- Slab underlayment: If moisture sensitive floor coverings will be used then minimum slab underlayment should consist of a moisture vapor barrier constructed below the entire slab area where such moisture sensitive floor coverings are expected. The moisture vapor barrier should meet or exceed the Class A rating as defined by ASTM E 1745-97 and have a permeance rating less than 0.01 perms as described in ASTM E 96-95 and ASTM E 154-88. A polyolefin material such as Stego® Wrap Vapor Barrier or equivalent will meet these specifications. The moisture vapor barrier should be properly constructed in accordance with all applicable manufacturer specifications. Given that a rock free subgrade is anticipated and that a capillary break is not required, sand below the barrier is not required. The need for sand and/or the amount of sand above the moisture vapor barrier should be specified by the structural engineer or concrete contractor. The selection of sand above the barrier is not a geotechnical engineering issue and hence outside our purview. Where moisture sensitive floor coverings are not anticipated, the vapor barrier may be eliminated.
- Moisture condition the floor slab subgrade soils to 2 to 4 percent above the Modified Proctor optimum moisture content, to a depth of 12 inches. The moisture content of the floor slab subgrade soils should be verified by the geotechnical engineer within 24 hours prior to concrete placement.
- Proper concrete curing techniques should be utilized to reduce the potential for slab curling or the formation of excessive shrinkage cracks.

The actual design of the floor slab should be completed by the structural engineer to verify adequate thickness and reinforcement.

6.7 Exterior Flatwork Design and Construction

Subgrades which will support new exterior slabs-on-grade for sidewalks, patios, and other concrete flatwork, should be prepared in accordance with the recommendations contained in the ***Grading Recommendations*** section of this report. Based on geotechnical considerations, exterior slabs on grade may be designed as follows:

- Minimum slab thickness: 4½ inches.
- Minimum slab reinforcement: No. 3 bars at 18 inches on center, in both directions.
- The flatwork at building entry areas should be structurally connected to the perimeter foundation that is recommended to span across the door opening. This recommendation is designed to reduce the potential for differential movement at this joint.
- Moisture condition the slab subgrade soils to at least 2 to 4 percent of optimum moisture content, to a depth of at least 12 inches. Adequate moisture conditioning should be verified by the geotechnical engineer 24 hours prior to concrete placement.
- Proper concrete curing techniques should be utilized to reduce the potential for slab curling or the formation of excessive shrinkage cracks.
- Control joints should be provided at a maximum spacing of 8 feet on center in two directions for slabs and at 6 feet on center for sidewalks. Control joints are intended to direct cracking. Minor cracking of exterior concrete slabs on grade should be expected.

Expansion or felt joints should be used at the interface of exterior slabs on grade and any fixed structures to permit relative movement.

6.8 Retaining Wall Design and Construction

Although not indicated on the site plan, some small (less than 6 feet in height) retaining walls may be required to facilitate the new site grades. The parameters recommended for use in the design of these walls are presented below.

Retaining Wall Design Parameters

Based on the soil conditions encountered at the boring locations, the following parameters may be used in the design of new retaining walls for this site. The following parameters assume that only the on-site soils will be utilized for retaining wall backfill. The near-surface soils vary in composition and include sandy silts, silty sands, sandy clays, and silty clays. Based on their composition, the on-site soils have been assigned a friction angle of 28 degrees. **It is recommended that the medium expansive soils be excluded from use as retaining wall backfill, where possible.**

If desired, SCG could provide design parameters for an alternative select backfill material behind the retaining walls. The use of select backfill material could result in lower lateral earth pressures. In order to use the design parameters for the imported select fill, this material must be placed within the entire active failure wedge. This wedge is defined as extending from the heel of the retaining wall upwards at an angle of approximately 60° from horizontal. If select backfill material behind the retaining wall is desired, SCG should be contacted for supplementary recommendations.

RETAINING WALL DESIGN PARAMETERS

Design Parameter		Soil Type
		On-site Sandy Soils
Internal Friction Angle (ϕ)		28°
Unit Weight		125 lbs/ft ³
Equivalent Fluid Pressure:	Active Condition (level backfill)	45 lbs/ft ³
	Active Condition (2h:1v backfill)	79 lbs/ft ³
	At-Rest Condition (level backfill)	66 lbs/ft ³

The walls should be designed using a soil-footing coefficient of friction of 0.28 and an equivalent passive pressure of 275 lbs/ft³. The structural engineer should incorporate appropriate factors of safety in the design of the retaining walls.

The active earth pressure may be used for the design of retaining walls that do not directly support structures or support soils that in turn support structures and which will be allowed to deflect. The at-rest earth pressure should be used for walls that will not be allowed to deflect such as those which will support foundation bearing soils, or which will support foundation loads directly.

Where the soils on the toe side of the retaining wall are not covered by a "hard" surface such as a structure or pavement, the upper 1 foot of soil should be neglected when calculating passive resistance due to the potential for the material to become disturbed or degraded during the life of the structure.

Retaining Wall Foundation Design

The retaining wall foundations should be underlain by at least 3 feet of newly placed structural fill. Foundations to support new retaining walls should be designed in accordance with the general Foundation Design Parameters presented in a previous section of this report.

Seismic Lateral Earth Pressures

In accordance with the 2019 CBC, any retaining walls more than 6 feet in height must be designed for seismic lateral earth pressures. If walls 6 feet or more are required for this site, the

geotechnical engineer should be contacted for supplementary seismic lateral earth pressure recommendations.

Backfill Material

On-site soils may be used to backfill the retaining walls, provided that they are low expansive ($EI < 50$). All backfill material placed within 3 feet of the back wall-face should have a particle size no greater than 3 inches. The retaining wall backfill materials should be well graded.

It is recommended that a minimum 1-foot thick layer of free-draining granular material (less than 5 percent passing the No. 200 sieve) be placed against the face of the retaining walls. This material should extend from the top of the retaining wall footing to within 1 foot of the ground surface on the back side of the retaining wall. This material should be approved by the geotechnical engineer. In lieu of the 1-foot thick layer of free-draining material, a properly installed prefabricated drainage composite such as the MiraDRAIN 6000XL (or approved equivalent), which is specifically designed for use behind retaining walls, may be used. If the layer of free-draining material is not covered by an impermeable surface, such as a structure or pavement, a 12-inch thick layer of a low permeability soil should be placed over the backfill to reduce surface water migration to the underlying soils. The layer of free draining granular material should be separated from the backfill soils by a suitable geotextile, approved by the geotechnical engineer.

All retaining wall backfill should be placed and compacted under engineering controlled conditions in the necessary layer thicknesses to ensure an in-place density between 90 and 93 percent of the maximum dry density as determined by the Modified Proctor test (ASTM D1557). Care should be taken to avoid over-compaction of the soils behind the retaining walls, and the use of heavy compaction equipment should be avoided.

Subsurface Drainage

As previously indicated, the retaining wall design parameters are based upon drained backfill conditions. Consequently, some form of permanent drainage system will be necessary in conjunction with the appropriate backfill material. Subsurface drainage may consist of either:

- A weep hole drainage system typically consisting of a series of 2-inch diameter holes in the wall situated slightly above the ground surface elevation on the exposed side of the wall and at an approximate 10-foot on-center spacing. Alternatively, 4-inch diameter holes at an approximate 20-foot on-center spacing can be used for this type of drainage system. In addition, the weep holes should include a 2 cubic foot pocket of open graded gravel, surrounded by an approved geotextile fabric, at each weep hole location.
- A 4-inch diameter perforated pipe surrounded by 2 cubic feet of gravel per linear foot of drain placed behind the wall, above the retaining wall footing. The gravel layer should be wrapped in a suitable geotextile fabric to reduce the potential for migration of fines. The footing drain should be extended to daylight or tied into a storm drainage system. The actual design of this type of system should be determined by the civil engineer to verify that the drainage system possesses the adequate capacity and slope for its intended use.

Weep holes or a footing drain will not be required for building stem walls.

6.9 Pavement Design Parameters

Site preparation in the pavement area should be completed as previously recommended in the ***Site Grading Recommendations*** section of this report. The subsequent pavement recommendations assume proper drainage and construction monitoring, and are based on either PCA or CALTRANS design parameters for a twenty (20) year design period. However, these designs also assume a routine pavement maintenance program to obtain the anticipated 20-year pavement service life.

Pavement Subgrades

It is anticipated that the new pavements will be primarily supported on a layer of compacted structural fill, consisting of scarified, thoroughly moisture conditioned and recompacted existing soils. The near-surface soils generally consist of sandy silts, silty sands, sandy clays, and silty clays. These soils are generally considered to possess poor to fair pavement support characteristics with estimated R-values ranging from 15 to 30. The subsequent pavement design is therefore based upon an assumed R-value of 20. Any fill material imported to the site should have support characteristics equal to or greater than that of the on-site soils and be placed and compacted under engineering controlled conditions. It is recommended that R-value testing be performed after completion of rough grading. Depending upon the results of the R-value testing, it may be feasible to use thinner pavement sections in some areas of the site.

Asphaltic Concrete

Presented below are the recommended thicknesses for new flexible pavement structures consisting of asphaltic concrete over a granular base. The pavement designs are based on the traffic indices (TI's) indicated. The client and/or civil engineer should verify that these TI's are representative of the anticipated traffic volumes. If the client and/or civil engineer determine that the expected traffic volume will exceed the applicable traffic index, we should be contacted for supplementary recommendations. The design traffic indices equate to the following approximate daily traffic volumes over a 20-year design life, assuming six operational traffic days per week.

Traffic Index	No. of Heavy Trucks per Day
4.0	0
5.0	1
6.0	3
7.0	11
8.0	35
9.0	93

For the purpose of the traffic volumes indicated above, a truck is defined as a 5-axle tractor trailer unit with one 8-kip axle and two 32-kip tandem axles. All of the traffic indices allow for 1,000 automobiles per day.

ASPHALT PAVEMENTS (R = 20)					
Materials	Thickness (inches)				
	Auto Parking and Auto Drive Lanes (TI = 4.0 to 5.0)	Truck Traffic			
		TI = 6.0	TI = 7.0	TI = 8.0	TI = 9.0
Asphalt Concrete	3	3½	4	5	5½
Aggregate Base	8	10	12	14	16
Compacted Subgrade	12	12	12	12	12

The aggregate base course should be compacted to at least 95 percent of the ASTM D-1557 maximum dry density. The asphaltic concrete should be compacted to at least 95 percent of the batch plant-reported maximum density. The aggregate base course may consist of crushed aggregate base (CAB) or crushed miscellaneous base (CMB), which is a recycled gravel, asphalt and concrete material. The gradation, R-Value, Sand Equivalent, and Percentage Wear of the CAB or CMB should comply with appropriate specifications contained in the current edition of the "Greenbook" Standard Specifications for Public Works Construction.

Portland Cement Concrete

The preparation of the subgrade soils within concrete pavement areas should be performed as previously described for proposed asphalt pavement areas. The minimum recommended thicknesses for the Portland Cement Concrete pavement sections are as follows:

PORTLAND CEMENT CONCRETE PAVEMENTS (R = 20)				
Materials	Thickness (inches)			
	Autos and Light Truck Traffic (TI = 6.0)	Truck Traffic		
		TI = 7.0	TI = 8.0	TI = 9.0
PCC	5	5½	7	8½
Compacted Subgrade (95% minimum compaction)	12	12	12	12

The concrete should have a 28-day compressive strength of at least 3,000 psi. Any reinforcement within the PCC pavements should be determined by the project structural engineer. The maximum joint spacing within all of the PCC pavements is recommended to be equal to or less than 30 times the pavement thickness.

7.0 GENERAL COMMENTS

This report has been prepared as an instrument of service for use by the client, in order to aid in the evaluation of this property and to assist the architects and engineers in the design and preparation of the project plans and specifications. This report may be provided to the contractor(s) and other design consultants to disclose information relative to the project. However, this report is not intended to be utilized as a specification in and of itself, without appropriate interpretation by the project architect, civil engineer, and/or structural engineer. The reproduction and distribution of this report must be authorized by the client and Southern California Geotechnical, Inc. Furthermore, any reliance on this report by an unauthorized third party is at such party's sole risk, and we accept no responsibility for damage or loss which may occur. The client(s)' reliance upon this report is subject to the Engineering Services Agreement, incorporated into our proposal for this project.

The analysis of this site was based on a subsurface profile interpolated from limited discrete soil samples. While the materials encountered in the project area are considered to be representative of the total area, some variations should be expected between boring locations and sample depths. If the conditions encountered during construction vary significantly from those detailed herein, we should be contacted immediately to determine if the conditions alter the recommendations contained herein.

This report has been based on assumed or provided characteristics of the proposed development. It is recommended that the owner, client, architect, structural engineer, and civil engineer carefully review these assumptions to ensure that they are consistent with the characteristics of the proposed development. If discrepancies exist, they should be brought to our attention to verify that they do not affect the conclusions and recommendations contained herein. We also recommend that the project plans and specifications be submitted to our office for review to verify that our recommendations have been correctly interpreted.

The analysis, conclusions, and recommendations contained within this report have been promulgated in accordance with generally accepted professional geotechnical engineering practice. No other warranty is implied or expressed.

8.0 REFERENCES

California Division of Mines and Geology (CDMG), "Guidelines for Evaluating and Mitigating Seismic Hazards in California," State of California, Department of Conservation, Division of Mines and Geology, Special Publication 117A, 2008.

Idriss, I. M. and Boulanger, R.W., "Soil Liquefaction During Earthquakes", Earthquake Engineering Research Institute, 2008.

National Research Council (NRC), "Liquefaction of Soils During Earthquakes," Committee on Earthquake Engineering, National Research Council, Washington D. C., Report No. CETS-EE-001, 1985.

Seed, H. B., and Idriss, I. M., "Simplified Procedure for Evaluating Soil Liquefaction Potential using field Performance Data," Journal of the Soil Mechanics and Foundations Division, American Society of Civil Engineers, September 1971, pp. 1249-1273.

Sadigh, K., Chang, C. -Y., Egan, J. A., Makdisi. F., Youngs, R. R., "Attenuation Relationships for Shallow Crustal Earthquakes Based on California Strong Motion Data", Seismological Research Letters, Seismological Society of America, Volume 68, Number 1, January/ February 1997, pp. 180-189.


Southern California Earthquake Center (SCEC), University of Southern California, "Recommended Procedures for Implementation of DMG Special Publication 117, Guidelines for Analyzing and Mitigating Liquefaction in California," Committee formed 1997.

Tokimatsu K., and Seed, H. B., "Evaluation of Settlements in Sands Due to Earthquake Shaking," Journal of the Geotechnical Engineering Division, American society of Civil Engineers, Volume 113, No. 8, August 1987, pp. 861-878.

Tokimatsu, K. and Yoshimi, Y., "Empirical Correlations of Soil Liquefaction Based on SPT N-value and Fines Content", Seismological Research Letters, Eastern Section Seismological Society Of America, Volume 63, Number 1, p. 73.

Youd, T. L. and Idriss, I. M. (Editors), "Proceedings of the NCEER Workshop on Evaluation of Liquefaction Resistance of Soils," Salt Lake City, UT, January 5-6 1996, NCEER Technical Report NCEER-97-0022, Buffalo, NY.

APPENDIX A

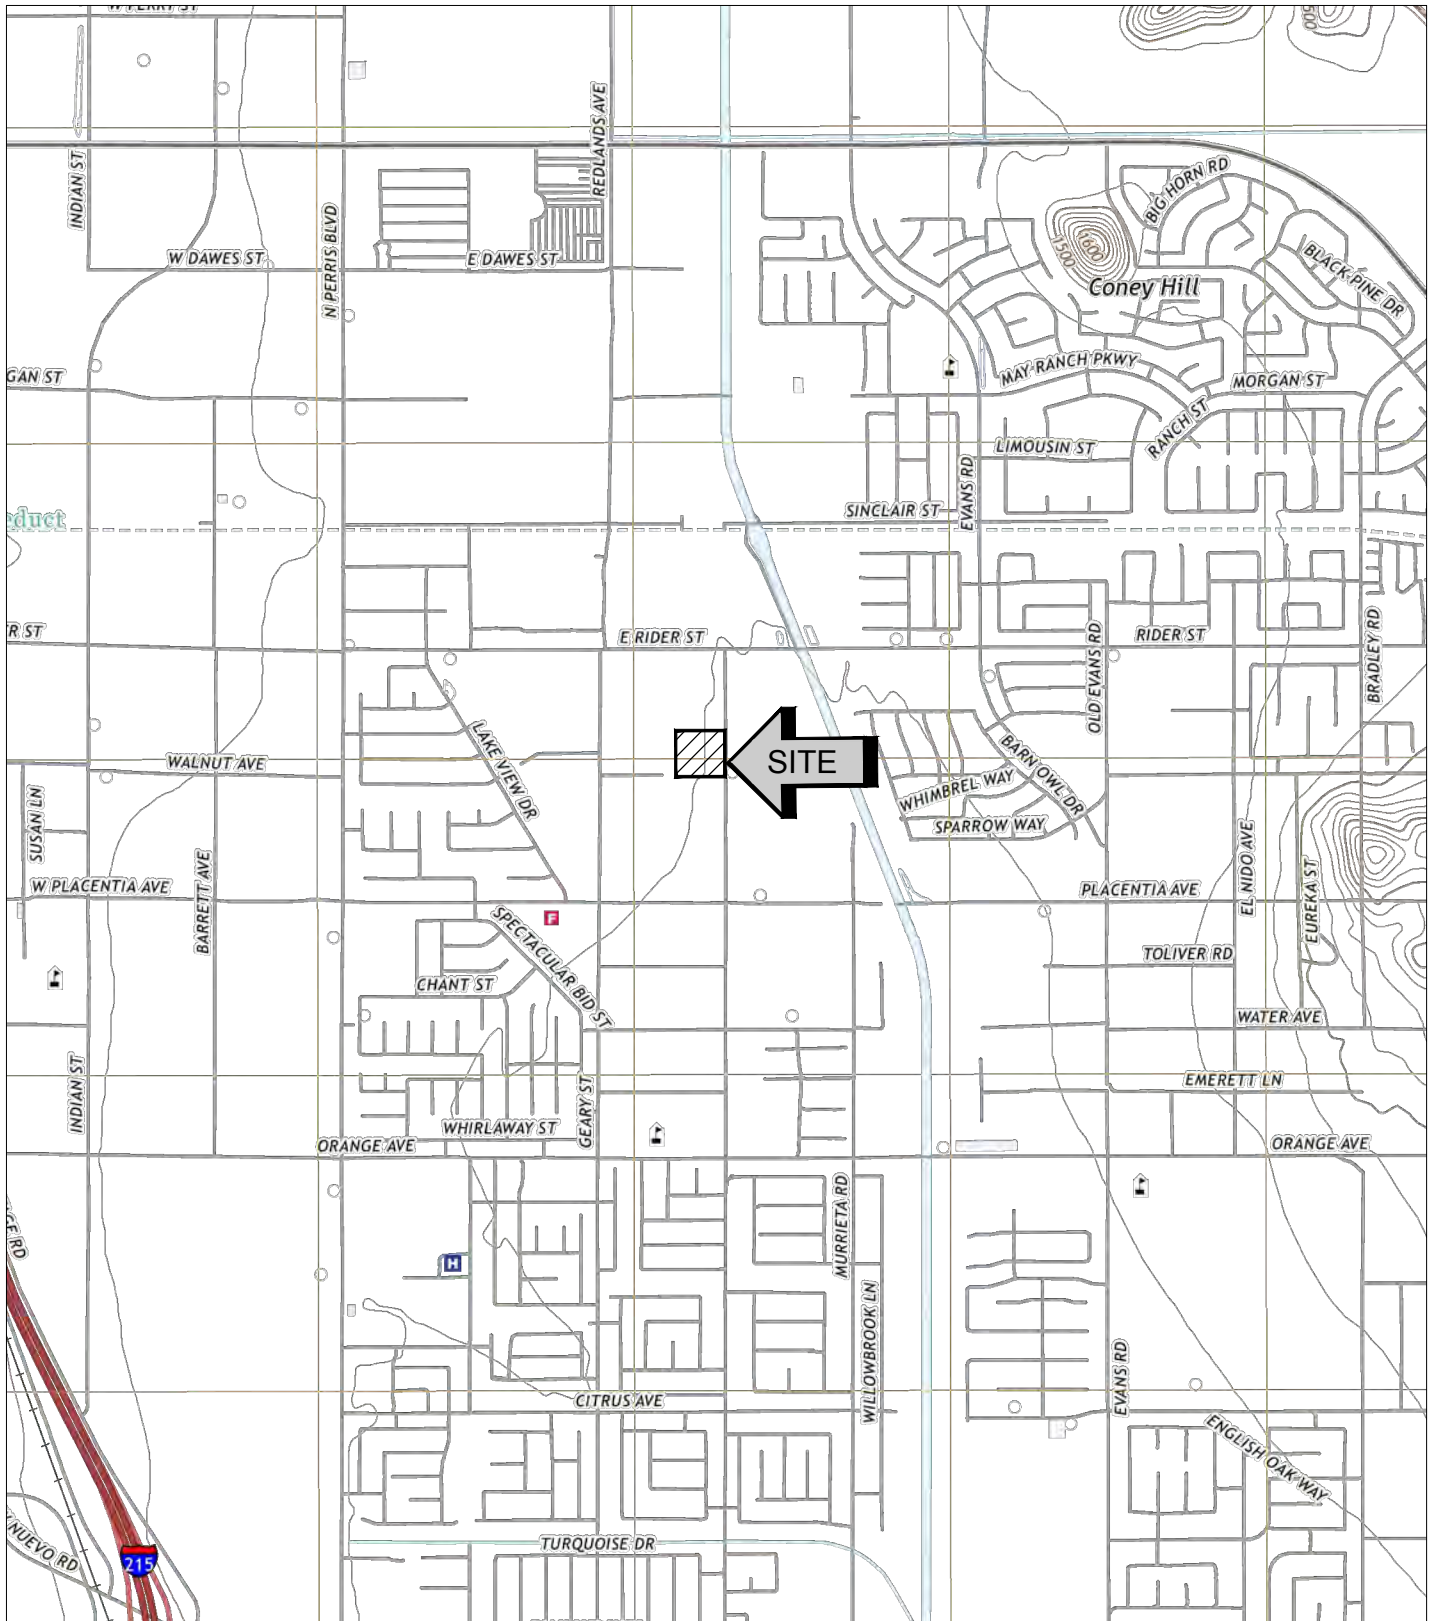




SOURCE: USGS TOPOGRAPHIC MAP OF THE PERRIS QUADRANGLE, RIVERSIDE COUNTY, CALIFORNIA, 2018.



SITE LOCATION MAP	
PROPOSED COMMERCIAL/INDUSTRIAL BUILDING	
PERRIS, CALIFORNIA	
SCALE: 1" = 2000'	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: RB	
CHKD: RGT	
SCG PROJECT 21G206-3	
PLATE 1	



GEOTECHNICAL LEGEND

- 
APPROXIMATE BORING LOCATION
- 
PROPERTY LINE
- 
APPROXIMATE HAND AUGER BORING LOCATION











NOTE: AIR PHOTO OBTAINED FROM GOOGLE EARTH
SITE PLAN PROVIDED BY RGA.

BORING LOCATION PLAN	
PROPOSED COMMERCIAL/INDUSTRIAL BUILDING	
PERRIS, CALIFORNIA	
SCALE: 1" = 80'	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JLL	
CHKD: RGT	
SCG PROJECT 21G208-3	
PLATE 2	

APPENDIX B

BORING LOG LEGEND

SAMPLE TYPE	GRAPHICAL SYMBOL	SAMPLE DESCRIPTION
AUGER		SAMPLE COLLECTED FROM AUGER CUTTINGS, NO FIELD MEASUREMENT OF SOIL STRENGTH. (DISTURBED)
CORE		ROCK CORE SAMPLE: TYPICALLY TAKEN WITH A DIAMOND-TIPPED CORE BARREL. TYPICALLY USED ONLY IN HIGHLY CONSOLIDATED BEDROCK.
GRAB		SOIL SAMPLE TAKEN WITH NO SPECIALIZED EQUIPMENT, SUCH AS FROM A STOCKPILE OR THE GROUND SURFACE. (DISTURBED)
CS		CALIFORNIA SAMPLER: 2-1/2 INCH I.D. SPLIT BARREL SAMPLER, LINED WITH 1-INCH HIGH BRASS RINGS. DRIVEN WITH SPT HAMMER. (RELATIVELY UNDISTURBED)
NSR		NO RECOVERY: THE SAMPLING ATTEMPT DID NOT RESULT IN RECOVERY OF ANY SIGNIFICANT SOIL OR ROCK MATERIAL.
SPT		STANDARD PENETRATION TEST: SAMPLER IS A 1.4 INCH INSIDE DIAMETER SPLIT BARREL, DRIVEN 18 INCHES WITH THE SPT HAMMER. (DISTURBED)
SH		SHELBY TUBE: TAKEN WITH A THIN WALL SAMPLE TUBE, PUSHED INTO THE SOIL AND THEN EXTRACTED. (UNDISTURBED)
VANE		VANE SHEAR TEST: SOIL STRENGTH OBTAINED USING A 4 BLADED SHEAR DEVICE. TYPICALLY USED IN SOFT CLAYS-NO SAMPLE RECOVERED.

COLUMN DESCRIPTIONS

DEPTH:

Distance in feet below the ground surface.

SAMPLE:

Sample Type as depicted above.

BLOW COUNT:

Number of blows required to advance the sampler 12 inches using a 140 lb hammer with a 30-inch drop. 50/3" indicates penetration refusal (>50 blows) at 3 inches. WH indicates that the weight of the hammer was sufficient to push the sampler 6 inches or more.

POCKET PEN.:

Approximate shear strength of a cohesive soil sample as measured by pocket penetrometer.

GRAPHIC LOG:

Graphic Soil Symbol as depicted on the following page.

DRY DENSITY:

Dry density of an undisturbed or relatively undisturbed sample in lbs/ft³.

MOISTURE CONTENT:

Moisture content of a soil sample, expressed as a percentage of the dry weight.

LIQUID LIMIT:

The moisture content above which a soil behaves as a liquid.

PLASTIC LIMIT:

The moisture content above which a soil behaves as a plastic.

PASSING #200 SIEVE:

The percentage of the sample finer than the #200 standard sieve.

UNCONFINED SHEAR:

The shear strength of a cohesive soil sample, as measured in the unconfined state.

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS	
			GRAPH	LETTER		
<p>COARSE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE</p>	<p>GRAVEL AND GRAVELLY SOILS</p>	<p>CLEAN GRAVELS</p> <p>(LITTLE OR NO FINES)</p>		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
		<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
		<p>MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
			<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES
	<p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>	<p>SAND AND SANDY SOILS</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SM	SILTY SANDS, SAND - SILT MIXTURES
			<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SC	CLAYEY SANDS, SAND - CLAY MIXTURES
	<p>FINE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE</p>	<p>SILTS AND CLAYS</p>	<p>LIQUID LIMIT LESS THAN 50</p>		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY
					CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS
					OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY
		<p>SILTS AND CLAYS</p>	<p>LIQUID LIMIT GREATER THAN 50</p>		MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS
				CH	INORGANIC CLAYS OF HIGH PLASTICITY	
				OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS	
<p>HIGHLY ORGANIC SOILS</p>				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS	

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 17 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
					FILL: Brown fine Sandy Silt, little porosity, micaceous, loose-damp	101	6					
					POSSIBLE FILL: Light Brown Silty fine Sand, trace medium to coarse Sand, medium dense-damp to moist	109	9					
5					ALLUVIUM: Brown Silty fine to medium Sand, trace coarse Sand, medium dense-damp	107	6					
					Brown Silty fine to coarse Sand, micaceous, medium dense-damp to moist	112	9					
10				4.5	Brown Silty Clay, little fine to medium Sand, little Silt, some Calcareous nodules and veining, very stiff-moist	115	12					
15				4.5	@ 13½ feet, Light Gray Brown, little fine to coarse Sand, hard-very moist		16					
20					Red Brown Clayey fine to medium Sand, trace coarse Sand, little Silt, little Calcareous veining, dense-moist		11					
Boring Terminated at 20 feet												

TBL 21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT 2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: 38.5 feet
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 30 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
35	✕	35		FILL: Brown Silty fine to coarse Sand, little Clay, trace fine Gravel, medium dense-dry to damp	111	3						El = 53 @ 0-5'
24	✕	24	4.5	ALLUVIUM: Brown fine Sandy Clay, little porosity, trace to little Silt, very stiff-moist	95	10						
5	✕	39	4.5	@ 5 feet, little Calcareous nodules and veining	91	11						
60	✕	60	4.5	Brown Silty Clay, trace fine to coarse Sand, little Silt, some Calcareous nodules and veining, hard-very moist	99	16						
10	✕	42		Gray Brown fine Sandy Silt, some Calcareous veining and nodules, medium dense-very moist	100	20						
15	✕	13		@ 13½ feet, trace Clay, trace medium to coarse Sand		16			65			
20	✕	34	4.5	Brown fine Sandy Clay, little Silt, trace medium to coarse Sand, hard-moist		11						
25	✕	50		Red Brown Silty fine Sand to fine Sandy Silt, trace medium to coarse Sand, trace Clay, very dense-moist		12						
30	✕	42		Brown Silty fine Sand, trace to little medium to coarse Sand, little Calcareous veining, dense-very moist		14						
45	✕	45		@ 33½ feet, no Calcareous veining, trace medium to coarse Sand		16						

TBL 21G206-3R ALLUVIUM VERSION.GPJ, SOCALGEO.GDT 2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: 38.5 feet
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 30 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION (Continued)	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
40	X	27	2.0		Red Brown fine Sandy Clay, little Silt, trace medium to coarse Sand, stiff to very stiff-wet		13		43			
45	X	31			Brown fine to coarse Sand, trace Silt, dense-wet		12					
50	X	34					9					
					Boring Terminated at 50 feet							

TBL_21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT_2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 13 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
		27			FILL: Light Gray Brown Silty fine Sand, trace medium Sand, little Clay, trace plastic fragments, medium dense-damp	93	6					EI = 30 @ 0-5'
		44			FILL: Light Brown fine Sandy Silt to Silty fine Sand, trace medium to coarse Sand, trace fine Gravel, little Clay, trace plastic fragments, medium dense-moist	86	10					
5		40			ALLUVIUM: Light Gray Brown Silty fine Sand, trace to little Clay, some Calcareous veining, medium dense-damp	112	5					
		56			Brown fine Sandy Silt, trace Clay, dense-damp to moist	113	9					
10		50	4.5		Brown fine Sandy Clay, little to some Silt, some Calcareous veining, trace medium Sand, hard-damp to moist	114	10					
		42			Brown Silty fine to medium Sand, trace coarse Sand, dense-moist		12					
15					Boring Terminated at 15 feet							

TBL_21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT_2/17/22




JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: 38 feet
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 28 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
5		13			FILL: Dark Brown Silty fine Sand, trace medium Sand, medium dense-damp	5						
		16			@ 3½ feet, trace to little medium to coarse Sand	5						
10		33			ALLUVIUM: Brown Silty fine to coarse Sand, trace to little Clay, dense-damp	5						
		24			@ 8½ feet, medium dense-moist to very moist	13						
15		21	4.5		Brown Silty Clay, trace fine Sand, little Silt, trace medium to coarse Sand, trace Calcareous veining, very stiff-moist to very moist	19						
20		14			Brown Clayey fine to coarse Sand, little Silt, little Iron Oxide veining, medium dense-damp	8			34			
25		40	4.5		Red Brown fine Sandy Clay, little Silt, trace medium to coarse Sand, hard-damp	8						
30		21			Dark Brown to Red Brown Silty fine to coarse Sand, medium dense to dense-moist to wet	9			20			
		24				10						

TBL 21G206-3R ALLUVIUM VERSION.GPJ, SOCALGEO.GDT 2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: 38 feet
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 28 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				DESCRIPTION	LABORATORY RESULTS						COMMENTS	
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)		GRAPHIC LOG	DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)		ORGANIC CONTENT (%)
(Continued)												
40	X	34		 <p>@ 38½ to 45 feet, trace Clay @ 38½ to 50 feet, wet</p>		15						
45	X	32					15					
50	X	39					13					
Boring Terminated at 50 feet												

TBL_21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT_2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 16.5 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
		6		3.0	POSSIBLE FILL: Light Brown fine Sandy Silt, trace fine root fibers, loose to medium dense-damp to moist		10					
		10					9					
5		14			@ 6 feet, trace medium to coarse Sand, very moist		14					
		14			ALLUVIUM: Light Brown Silty Clay, some Calcareous veining, stiff-very moist		17					
10		32			Red Brown Silty fine to coarse Sand, trace Calcareous nodules, dense-moist		11					
15		30			Brown Silty fine Sand, trace medium Sand, dense-moist		12					
20				Boring Terminated at 20 feet								

TBL 21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT 2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 8/25/21 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 14 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
				[Symbol]	FILL: Brown fine to medium Sandy Silt, trace coarse Sand, medium dense-damp		5					
				[Symbol]	POSSIBLE FILL: Light Brown fine Sandy Silt, trace medium Sand, medium dense-damp		8					
5				[Symbol]	ALLUVIUM: Light Brown Gray Silty fine Sand, trace medium to coarse Sand, little Calcareous veining, dense-damp		7					
				[Symbol]	Light Gray Brown fine Sandy Silt, dense-damp to moist		9					
10				[Symbol]	Light Brown Silty Clay, little fine sand, extensive Calcareous veining, very stiff-very moist		16					
			4.5	[Symbol]								
15				[Symbol]	Brown fine Sandy Clay, trace medium to coarse Sand, some Calcareous veining, very stiff-very moist		16					
			4.5	[Symbol]								
20				[Symbol]	Boring Terminated at 20 feet							

TBL 21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT 2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 1/17/22 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 16 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
14	5	14			FILL: Gray Brown fine Sandy Silt, trace to little medium to coarse Sand, trace Clay, loose-moist	97	10					El = 25 @ 0 to 5 feet
31	5	31	4.5		FILL: Gray Brown fine Sandy Clay, trace medium Sand, little Silt, little Organic content, very stiff-moist	87	18					
22	5	22			ALLUVIUM: Light Gray Brown fine Sandy Silt, little Clay, abundant Calcareous nodules/veining, medium dense-damp	93	10					
76/11"	5	76/11"			Gray Brown Clayey fine Sand, little medium Sand, trace coarse Sand, little Calcareous nodules/veining, very dense-damp to moist	112	10					
31	10	31	4.5		Gray Brown Silty Clay, trace fine Sand, abundant Calcareous/veining, very stiff-damp to moist	118	10					
32	15	32	4.5		Brown fine Sandy Clay, little Silt, trace medium to coarse Sand, trace Iron Oxide staining, hard-moist		12					
36	20	36	4.0				15					
Boring Terminated at 20 feet												

TBL 21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT 2/17/22



JOB NO.: 21G206-3 DRILLING DATE: 1/17/22 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 15 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS					COMMENTS	
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)		ORGANIC CONTENT (%)
SURFACE ELEVATION: --- MSL												
		7			FILL: Brown Silty fine Sand, trace medium to coarse Sand, loose-damp to moist		7					
		12			@ 3½ feet, light Brown, little Organic content, medium dense		17					
5		13			ALLUVIUM: Light Brown Silty fine Sand, trace Clay, abundant Calcareous nodules/veining, medium dense-damp		10					
10		19					10					
15		46			Light Brown Silty fine to medium Sand, trace coarse Sand, trace Clay nodules, little Calcareous nodules/veining, dense-damp		6					
20		22		Brown Clayey fine Sand, little medium Sand, trace coarse Sand, trace Silt, medium dense-moist		10						
Boring Terminated at 20 feet												

TBL_21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT_2/17/22




JOB NO.: 21G206-3 DRILLING DATE: 1/17/22 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building DRILLING METHOD: Hollow Stem Auger CAVE DEPTH: 16 feet
 LOCATION: Perris, California LOGGED BY: Ryan Bremer READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: --- MSL												
					FILL: Gray Brown Clayey Silt, little fine Sand, trace medium Sand, stiff to very stiff-moist	98	11					
						94	10					
5					ALLUVIUM: Gray Brown Silty fine Sand, little medium Sand, abundant Calcareous nodules/veining, medium dense-moist	97	15					
					Light Brown Silty Clay, trace fine Sand, abundant Calcareous nodules/veining, very stiff-moist to very moist	102	20					
10					@ 9 feet, some fine to coarse Sand	101	10					
					Brown Clayey fine Sand, trace medium Sand, trace Silt, medium dense-damp		7					
15					Brown Clayey fine to medium Sand, trace to little coarse Sand, little Silt, little Calcareous veining, very dense-damp		8					
20			50/5"		Boring Terminated at 20 feet							

TBL 21G206-3R ALLUVIUM VERSION.GPJ_SOCALGEO.GDT 2/17/22

A P P E N D I X C

Consolidation/Collapse Test Results

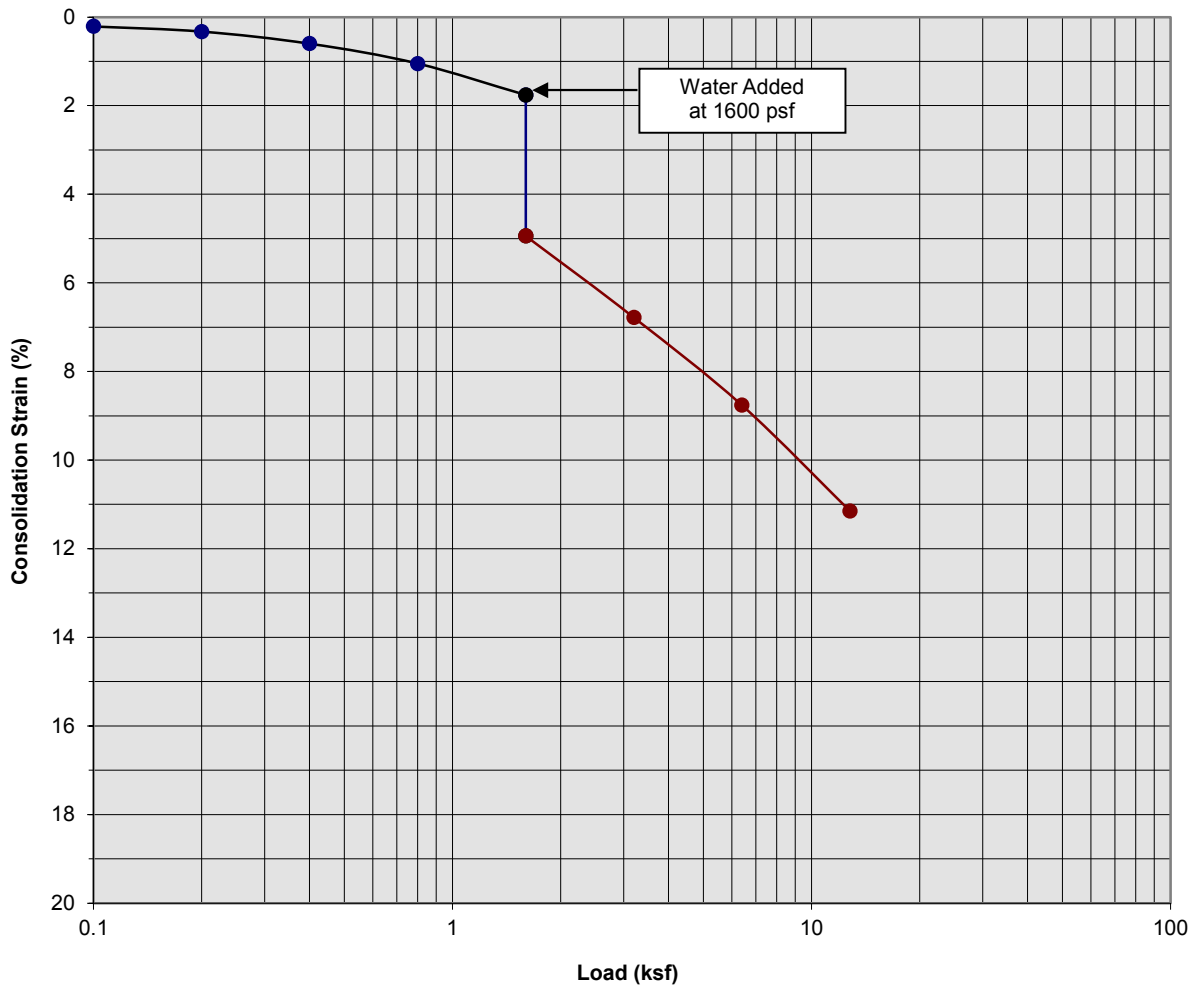

Classification: POSSIBLE FILL: Light Brown Silty fine Sand, trace medium to coarse Sand


Boring Number:	B-1	Initial Moisture Content (%)	9
Sample Number:	---	Final Moisture Content (%)	18
Depth (ft)	3 to 4	Initial Dry Density (pcf)	108.5
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	121.7
Specimen Thickness (in)	1.0	Percent Collapse (%)	3.18

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 1



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

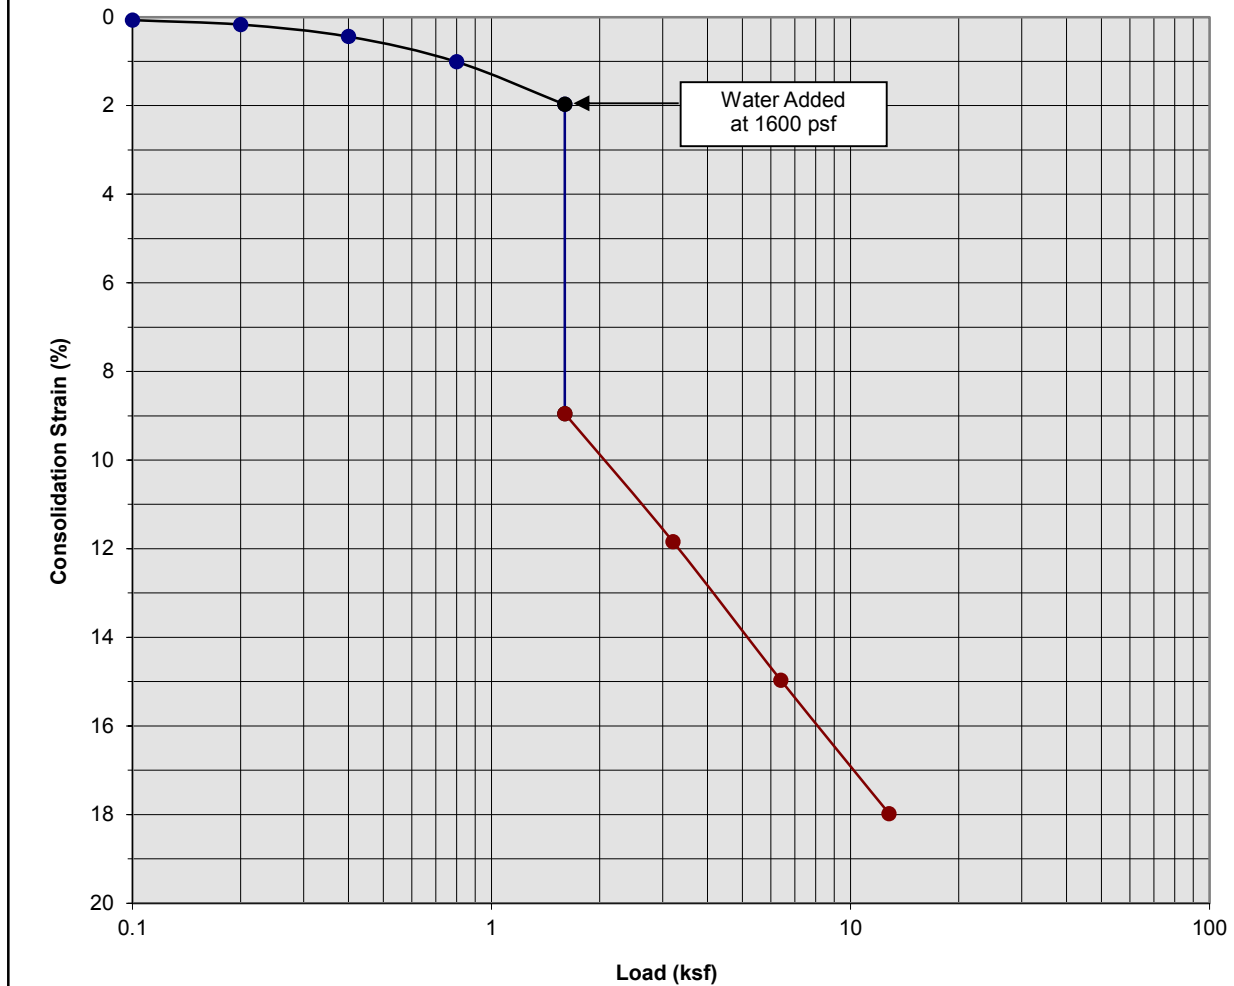

Classification: Brown Silty fine to medium Sand, trace coarse Sand


Boring Number:	B-1	Initial Moisture Content (%)	6
Sample Number:	---	Final Moisture Content (%)	16
Depth (ft)	5 to 6	Initial Dry Density (pcf)	106.7
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	129.3
Specimen Thickness (in)	1.0	Percent Collapse (%)	6.98

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 2



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

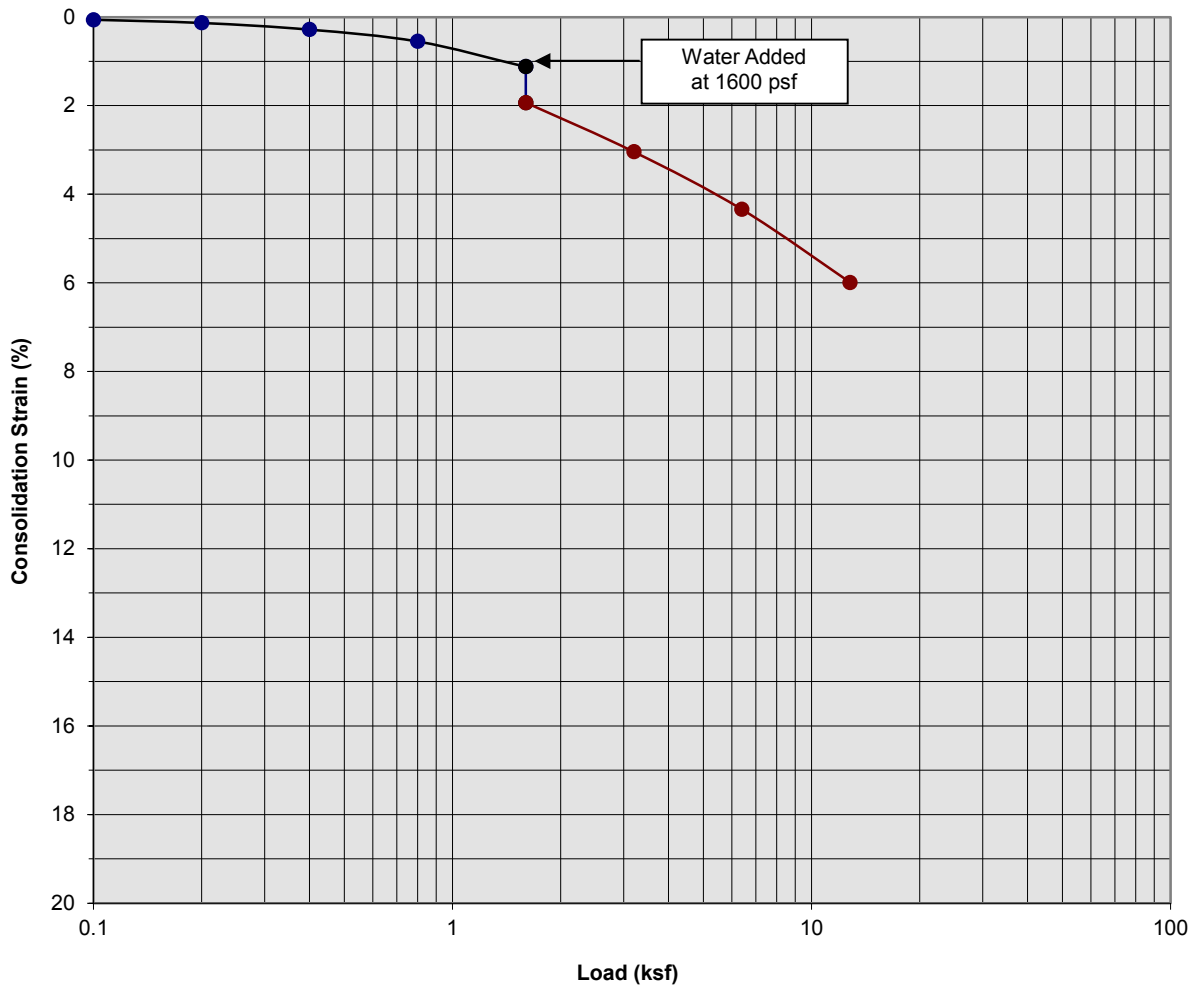

Classification: Brown Silty fine to coarse Sand


Boring Number:	B-1	Initial Moisture Content (%)	9
Sample Number:	---	Final Moisture Content (%)	26
Depth (ft)	7 to 8	Initial Dry Density (pcf)	111.6
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	118.2
Specimen Thickness (in)	1.0	Percent Collapse (%)	0.81

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 3



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

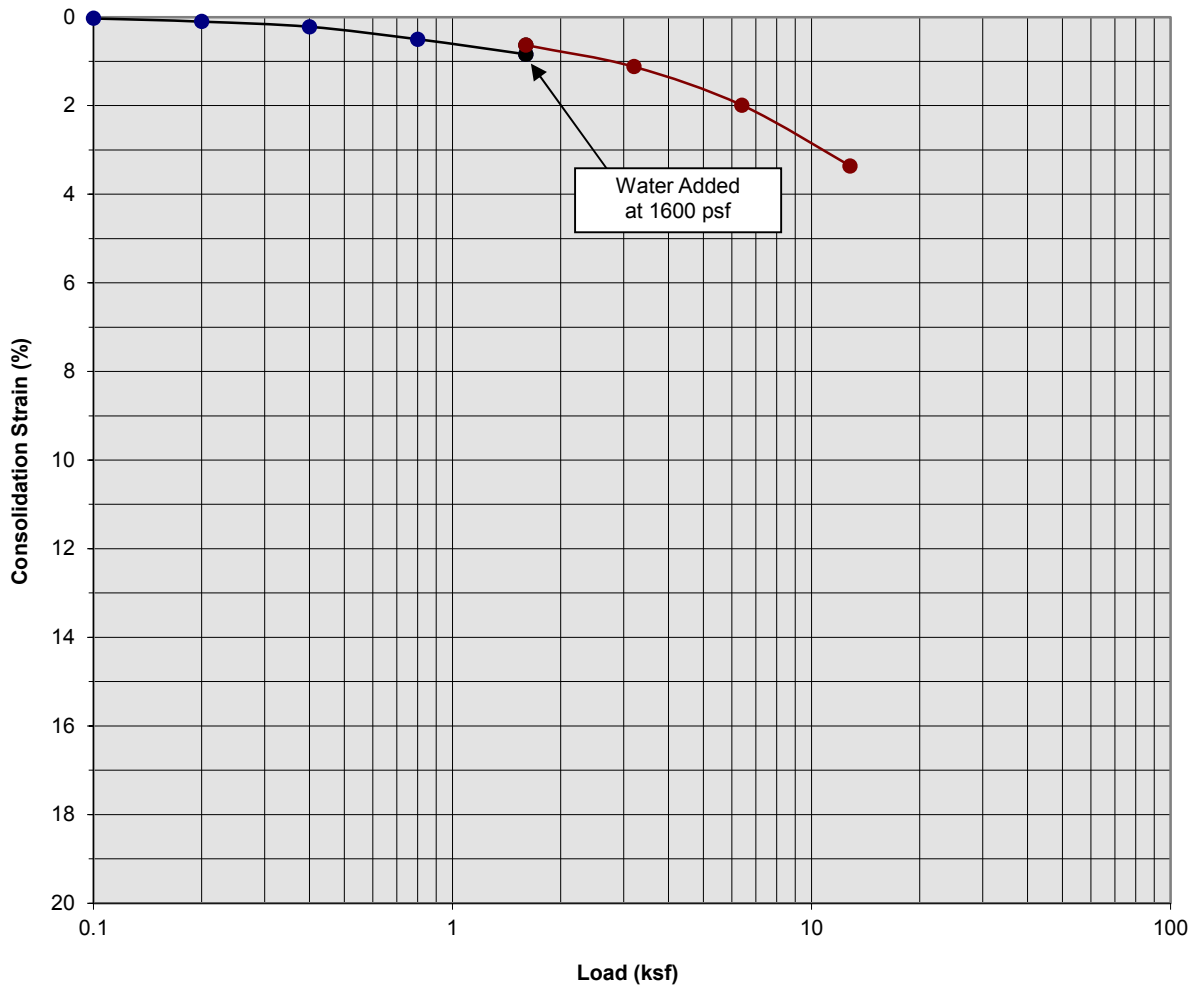

Classification: Brown Silty Clay, little fine to medium Sand, little Silt


Boring Number:	B-1	Initial Moisture Content (%)	12
Sample Number:	---	Final Moisture Content (%)	18
Depth (ft)	9 to 10	Initial Dry Density (pcf)	115.3
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	118.5
Specimen Thickness (in)	1.0	Percent Collapse (%)	-0.21

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 4



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

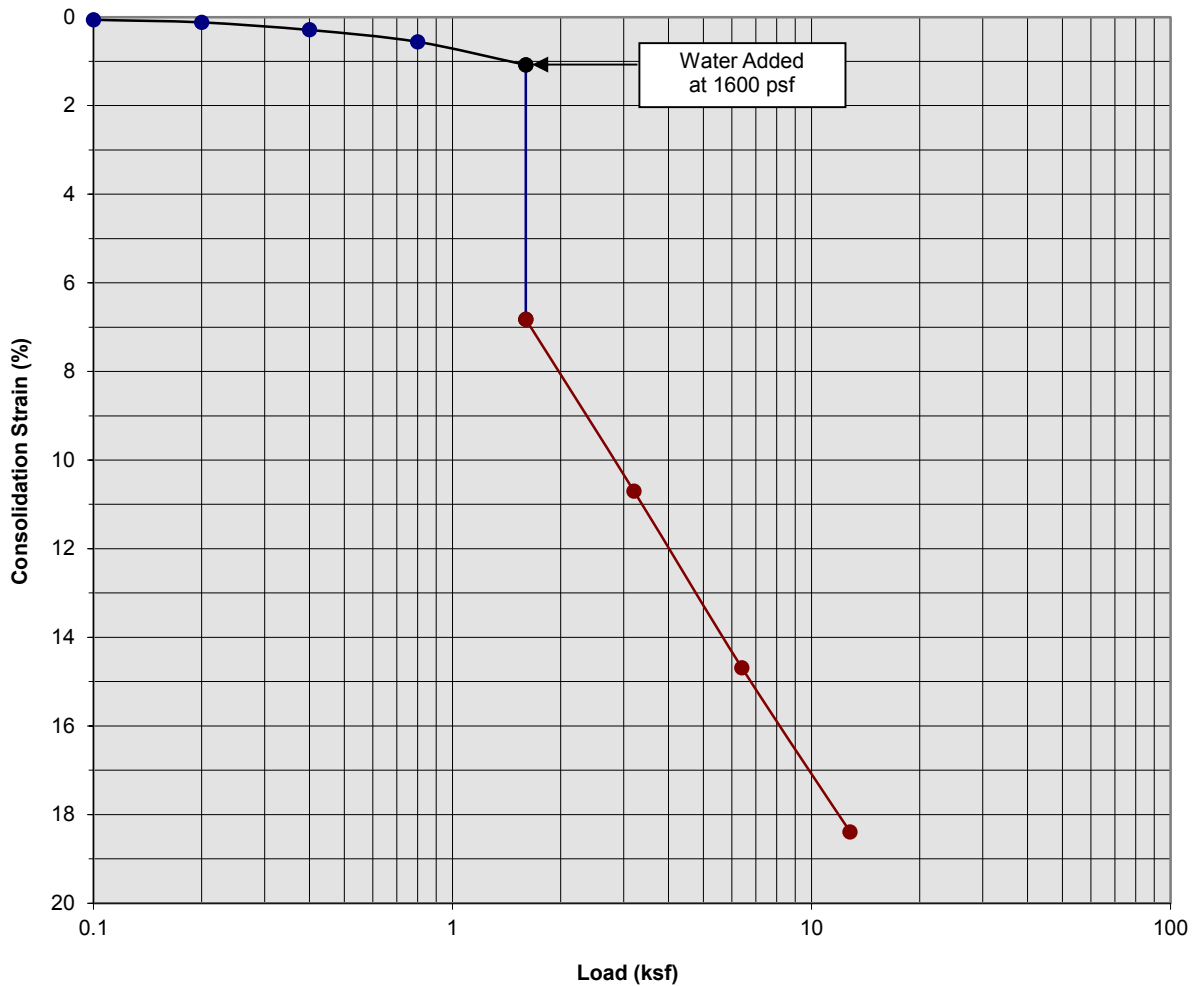

Classification: Gray Brown Silty fine Sand, little medium Sand, trace Clay


Boring Number:	B-9	Initial Moisture Content (%)	10
Sample Number:	---	Final Moisture Content (%)	20
Depth (ft)	3 to 4	Initial Dry Density (pcf)	93.9
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	114.2
Specimen Thickness (in)	1.0	Percent Collapse (%)	5.74

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 5



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

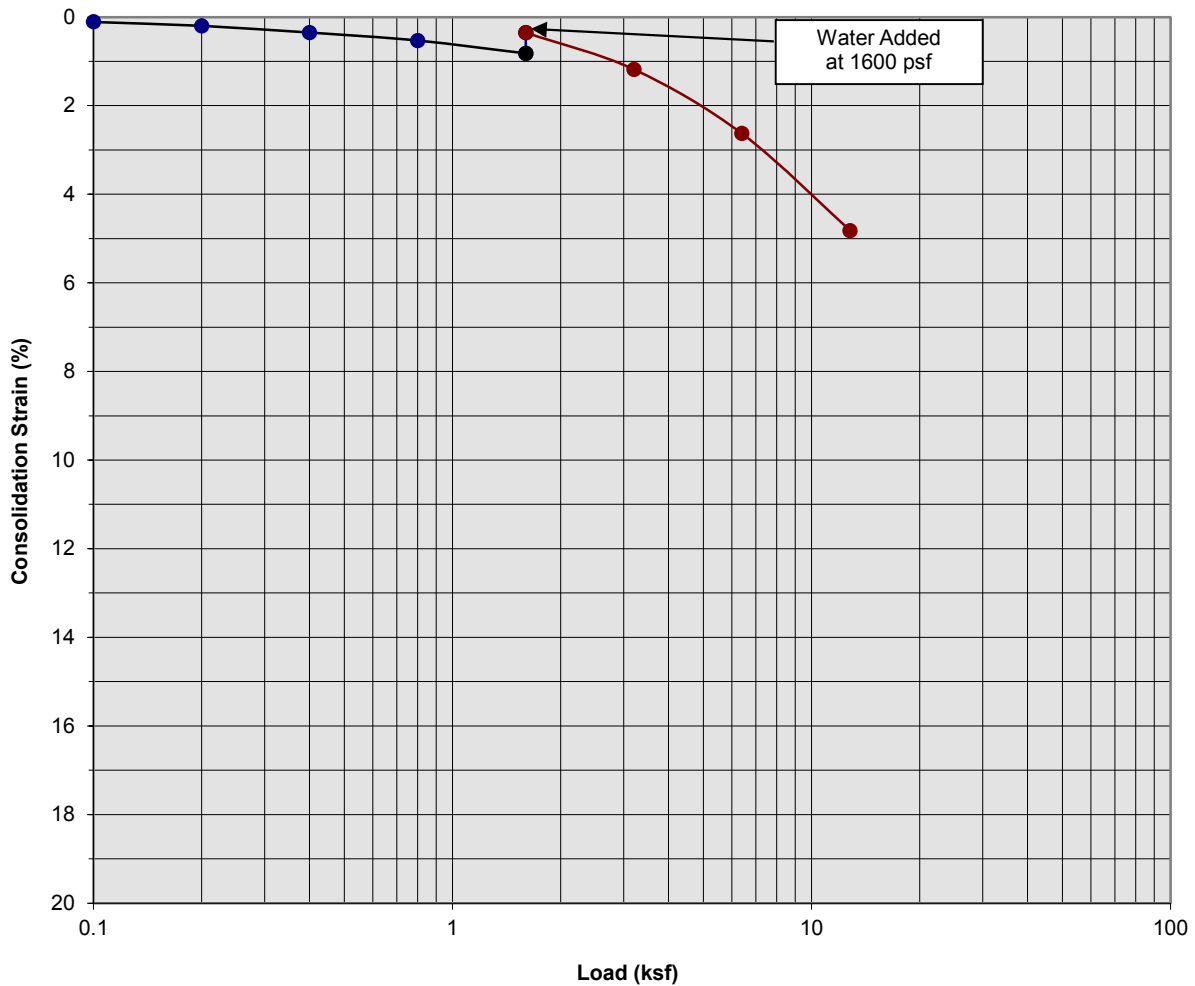

Classification: Light Brown Silty Clay, trace fine Sand


Boring Number:	B-9	Initial Moisture Content (%)	20
Sample Number:	---	Final Moisture Content (%)	23
Depth (ft)	7 to 8	Initial Dry Density (pcf)	101.7
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	107.6
Specimen Thickness (in)	1.0	Percent Collapse (%)	-0.47

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 6



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Consolidation/Collapse Test Results

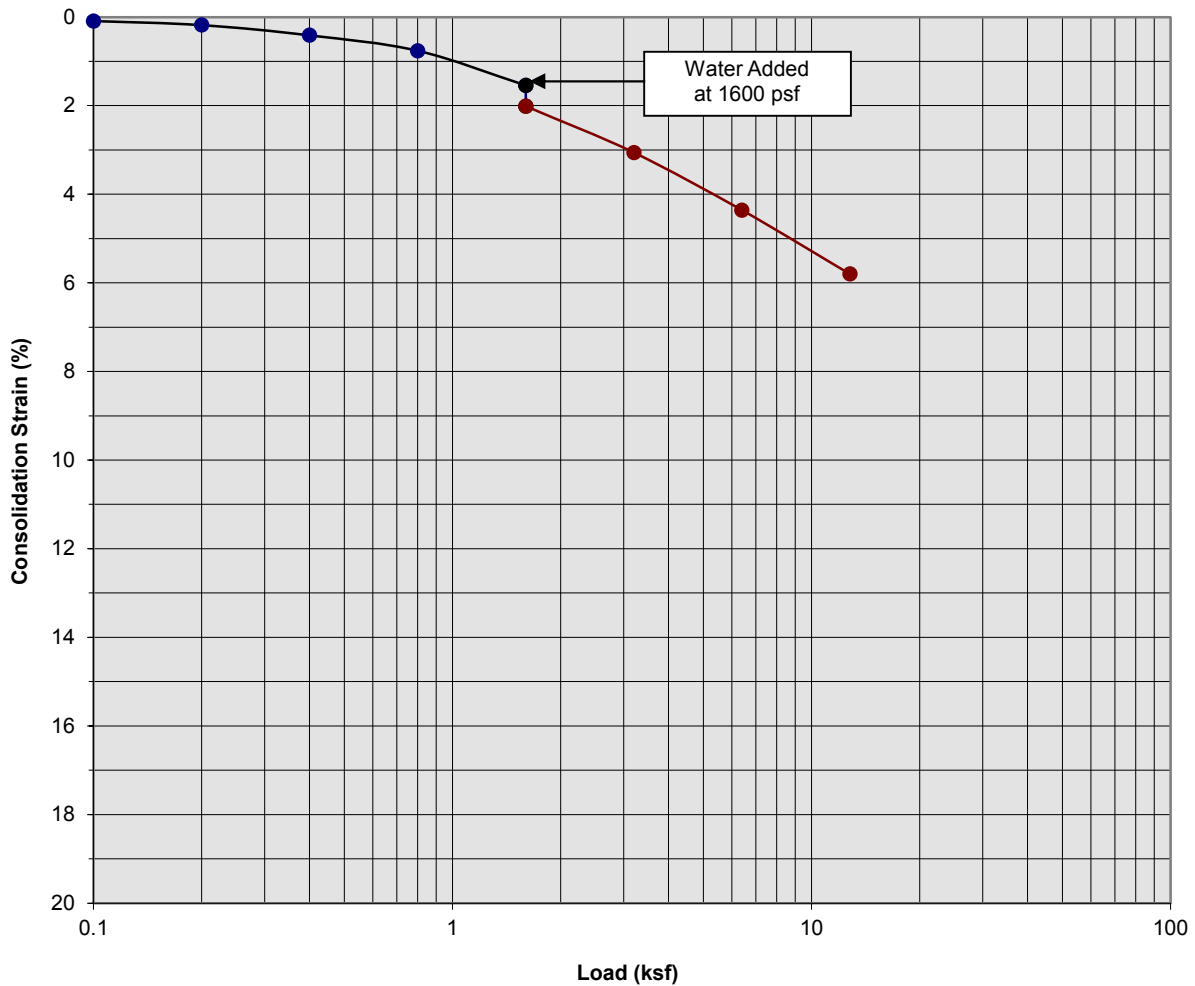

Classification: Light Brown Silty Clay, some fine to coarse Sand


Boring Number:	B-9	Initial Moisture Content (%)	10
Sample Number:	---	Final Moisture Content (%)	22
Depth (ft)	9 to 10	Initial Dry Density (pcf)	100.8
Specimen Diameter (in)	2.4	Final Dry Density (pcf)	106.2
Specimen Thickness (in)	1.0	Percent Collapse (%)	0.47

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C- 7



**SOUTHERN
 CALIFORNIA
 GEOTECHNICAL**
A California Corporation

Moisture/Density Relationship ASTM D-1557

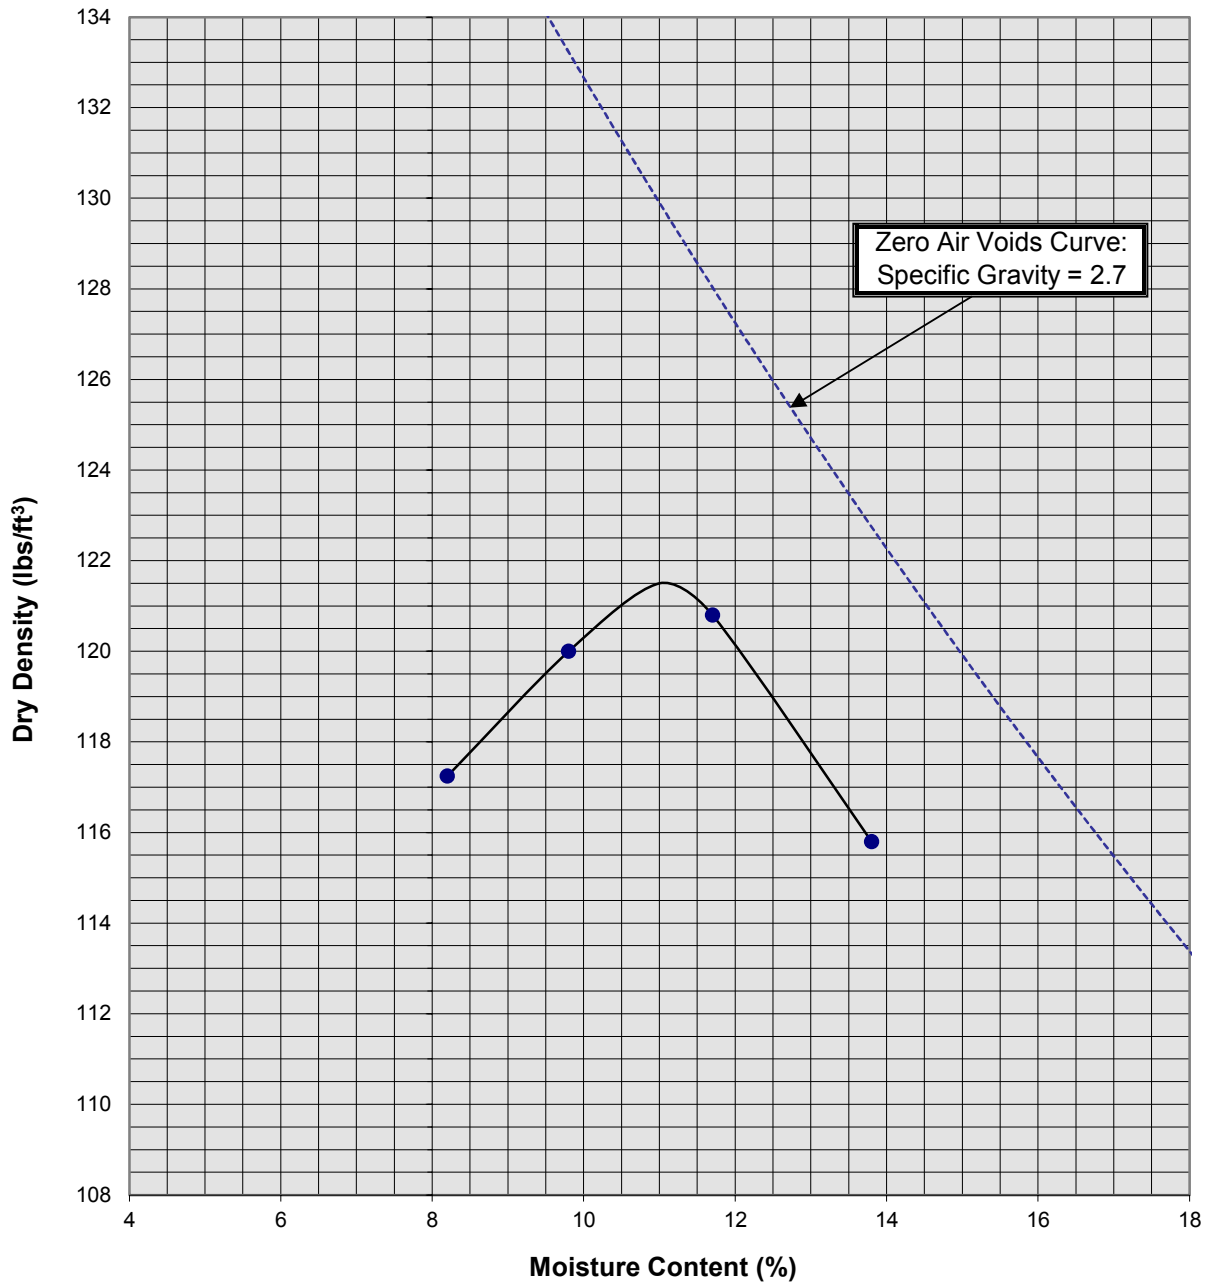

Zero Air Voids Curve:
Specific Gravity = 2.7


Soil ID Number	B-3 @ 0-5'
Optimum Moisture (%)	11
Maximum Dry Density (pcf)	121.5
Soil Classification	Light Brown Silty fine Sand to fine Sandy Silt

Proposed Commercial/Industrial Building
Perris, California
Project No. 21G206-3
PLATE C-8



SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

Moisture/Density Relationship ASTM D-1557

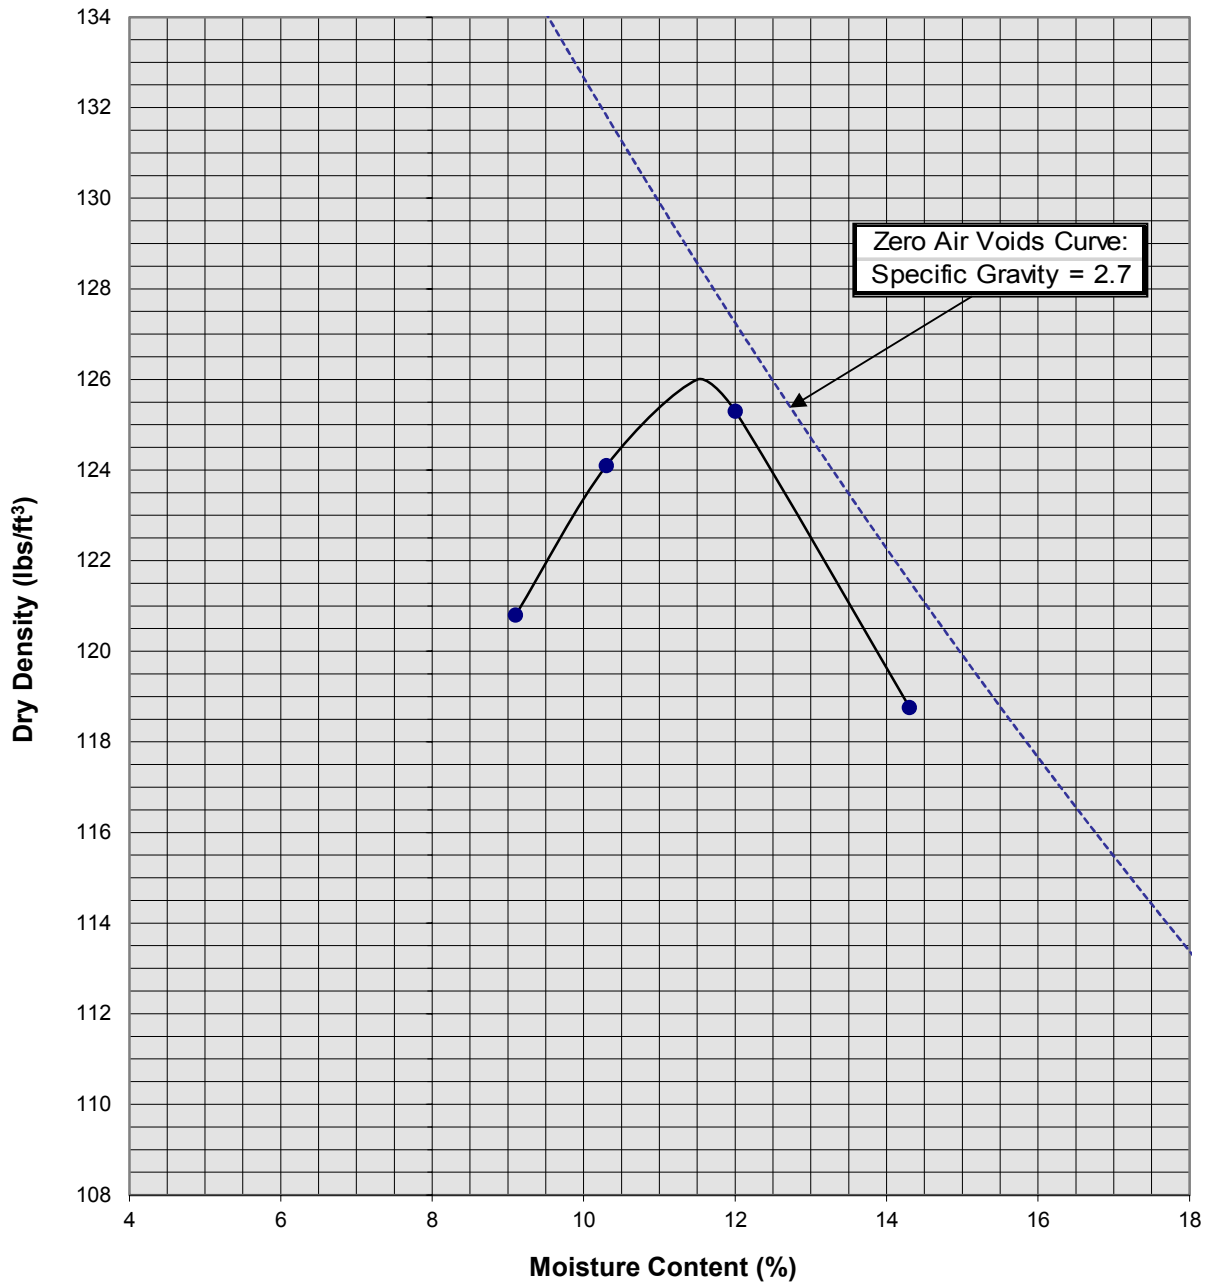

Soil ID Number	B-7 @ 0-5'
Optimum Moisture (%)	11.5
Maximum Dry Density (pcf)	126
Soil Classification	Gray Brown fine Sandy Silt, little medium Sand, little Clay

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-3
PLATE C-9



SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

APPENDIX

GRADING GUIDE SPECIFICATIONS

These grading guide specifications are intended to provide typical procedures for grading operations. They are intended to supplement the recommendations contained in the geotechnical investigation report for this project. Should the recommendations in the geotechnical investigation report conflict with the grading guide specifications, the more site specific recommendations in the geotechnical investigation report will govern.

General

- The Earthwork Contractor is responsible for the satisfactory completion of all earthwork in accordance with the plans and geotechnical reports, and in accordance with city, county, and applicable building codes.
- The Geotechnical Engineer is the representative of the Owner/Builder for the purpose of implementing the report recommendations and guidelines. These duties are not intended to relieve the Earthwork Contractor of any responsibility to perform in a workman-like manner, nor is the Geotechnical Engineer to direct the grading equipment or personnel employed by the Contractor.
- The Earthwork Contractor is required to notify the Geotechnical Engineer of the anticipated work and schedule so that testing and inspections can be provided. If necessary, work may be stopped and redone if personnel have not been scheduled in advance.
- The Earthwork Contractor is required to have suitable and sufficient equipment on the job-site to process, moisture condition, mix and compact the amount of fill being placed to the approved compaction. In addition, suitable support equipment should be available to conform with recommendations and guidelines in this report.
- Canyon cleanouts, overexcavation areas, processed ground to receive fill, key excavations, subdrains and benches should be observed by the Geotechnical Engineer prior to placement of any fill. It is the Earthwork Contractor's responsibility to notify the Geotechnical Engineer of areas that are ready for inspection.
- Excavation, filling, and subgrade preparation should be performed in a manner and sequence that will provide drainage at all times and proper control of erosion. Precipitation, springs, and seepage water encountered shall be pumped or drained to provide a suitable working surface. The Geotechnical Engineer must be informed of springs or water seepage encountered during grading or foundation construction for possible revision to the recommended construction procedures and/or installation of subdrains.

Site Preparation

- The Earthwork Contractor is responsible for all clearing, grubbing, stripping and site preparation for the project in accordance with the recommendations of the Geotechnical Engineer.
- If any materials or areas are encountered by the Earthwork Contractor which are suspected of having toxic or environmentally sensitive contamination, the Geotechnical Engineer and Owner/Builder should be notified immediately.

- Major vegetation should be stripped and disposed of off-site. This includes trees, brush, heavy grasses and any materials considered unsuitable by the Geotechnical Engineer.
- Underground structures such as basements, cesspools or septic disposal systems, mining shafts, tunnels, wells and pipelines should be removed under the inspection of the Geotechnical Engineer and recommendations provided by the Geotechnical Engineer and/or city, county or state agencies. If such structures are known or found, the Geotechnical Engineer should be notified as soon as possible so that recommendations can be formulated.
- Any topsoil, slopewash, colluvium, alluvium and rock materials which are considered unsuitable by the Geotechnical Engineer should be removed prior to fill placement.
- Remaining voids created during site clearing caused by removal of trees, foundations basements, irrigation facilities, etc., should be excavated and filled with compacted fill.
- Subsequent to clearing and removals, areas to receive fill should be scarified to a depth of 10 to 12 inches, moisture conditioned and compacted
- The moisture condition of the processed ground should be at or slightly above the optimum moisture content as determined by the Geotechnical Engineer. Depending upon field conditions, this may require air drying or watering together with mixing and/or discing.

Compacted Fills

- Soil materials imported to or excavated on the property may be utilized in the fill, provided each material has been determined to be suitable in the opinion of the Geotechnical Engineer. Unless otherwise approved by the Geotechnical Engineer, all fill materials shall be free of deleterious, organic, or frozen matter, shall contain no chemicals that may result in the material being classified as "contaminated," and shall be very low to non-expansive with a maximum expansion index (EI) of 50. The top 12 inches of the compacted fill should have a maximum particle size of 3 inches, and all underlying compacted fill material a maximum 6-inch particle size, except as noted below.
- All soils should be evaluated and tested by the Geotechnical Engineer. Materials with high expansion potential, low strength, poor gradation or containing organic materials may require removal from the site or selective placement and/or mixing to the satisfaction of the Geotechnical Engineer.
- Rock fragments or rocks less than 6 inches in their largest dimensions, or as otherwise determined by the Geotechnical Engineer, may be used in compacted fill, provided the distribution and placement is satisfactory in the opinion of the Geotechnical Engineer.
- Rock fragments or rocks greater than 12 inches should be taken off-site or placed in accordance with recommendations and in areas designated as suitable by the Geotechnical Engineer. These materials should be placed in accordance with Plate D-8 of these Grading Guide Specifications and in accordance with the following recommendations:
 - Rocks 12 inches or more in diameter should be placed in rows at least 15 feet apart, 15 feet from the edge of the fill, and 10 feet or more below subgrade. Spaces should be left between each rock fragment to provide for placement and compaction of soil around the fragments.
 - Fill materials consisting of soil meeting the minimum moisture content requirements and free of oversize material should be placed between and over the rows of rock or

concrete. Ample water and compactive effort should be applied to the fill materials as they are placed in order that all of the voids between each of the fragments are filled and compacted to the specified density.

- Subsequent rows of rocks should be placed such that they are not directly above a row placed in the previous lift of fill. A minimum 5-foot offset between rows is recommended.
- To facilitate future trenching, oversized material should not be placed within the range of foundation excavations, future utilities or other underground construction unless specifically approved by the soil engineer and the developer/owner representative.
- Fill materials approved by the Geotechnical Engineer should be placed in areas previously prepared to receive fill and in evenly placed, near horizontal layers at about 6 to 8 inches in loose thickness, or as otherwise determined by the Geotechnical Engineer for the project.
- Each layer should be moisture conditioned to optimum moisture content, or slightly above, as directed by the Geotechnical Engineer. After proper mixing and/or drying, to evenly distribute the moisture, the layers should be compacted to at least 90 percent of the maximum dry density in compliance with ASTM D-1557-78 unless otherwise indicated.
- Density and moisture content testing should be performed by the Geotechnical Engineer at random intervals and locations as determined by the Geotechnical Engineer. These tests are intended as an aid to the Earthwork Contractor, so he can evaluate his workmanship, equipment effectiveness and site conditions. The Earthwork Contractor is responsible for compaction as required by the Geotechnical Report(s) and governmental agencies.
- Fill areas unused for a period of time may require moisture conditioning, processing and recompaction prior to the start of additional filling. The Earthwork Contractor should notify the Geotechnical Engineer of his intent so that an evaluation can be made.
- Fill placed on ground sloping at a 5-to-1 inclination (horizontal-to-vertical) or steeper should be benched into bedrock or other suitable materials, as directed by the Geotechnical Engineer. Typical details of benching are illustrated on Plates D-2, D-4, and D-5.
- Cut/fill transition lots should have the cut portion overexcavated to a depth of at least 3 feet and rebuilt with fill (see Plate D-1), as determined by the Geotechnical Engineer.
- All cut lots should be inspected by the Geotechnical Engineer for fracturing and other bedrock conditions. If necessary, the pads should be overexcavated to a depth of 3 feet and rebuilt with a uniform, more cohesive soil type to impede moisture penetration.
- Cut portions of pad areas above buttresses or stabilizations should be overexcavated to a depth of 3 feet and rebuilt with uniform, more cohesive compacted fill to impede moisture penetration.
- Non-structural fill adjacent to structural fill should typically be placed in unison to provide lateral support. Backfill along walls must be placed and compacted with care to ensure that excessive unbalanced lateral pressures do not develop. The type of fill material placed adjacent to below grade walls must be properly tested and approved by the Geotechnical Engineer with consideration of the lateral earth pressure used in the design.

Foundations

- The foundation influence zone is defined as extending one foot horizontally from the outside edge of a footing, and proceeding downward at a ½ horizontal to 1 vertical (0.5:1) inclination.
- Where overexcavation beneath a footing subgrade is necessary, it should be conducted so as to encompass the entire foundation influence zone, as described above.
- Compacted fill adjacent to exterior footings should extend at least 12 inches above foundation bearing grade. Compacted fill within the interior of structures should extend to the floor subgrade elevation.

Fill Slopes

- The placement and compaction of fill described above applies to all fill slopes. Slope compaction should be accomplished by overfilling the slope, adequately compacting the fill in even layers, including the overfilled zone and cutting the slope back to expose the compacted core
- Slope compaction may also be achieved by backrolling the slope adequately every 2 to 4 vertical feet during the filling process as well as requiring the earth moving and compaction equipment to work close to the top of the slope. Upon completion of slope construction, the slope face should be compacted with a sheepsfoot connected to a sideboom and then grid rolled. This method of slope compaction should only be used if approved by the Geotechnical Engineer.
- Sandy soils lacking in adequate cohesion may be unstable for a finished slope condition and therefore should not be placed within 15 horizontal feet of the slope face.
- All fill slopes should be keyed into bedrock or other suitable material. Fill keys should be at least 15 feet wide and inclined at 2 percent into the slope. For slopes higher than 30 feet, the fill key width should be equal to one-half the height of the slope (see Plate D-5).
- All fill keys should be cleared of loose slough material prior to geotechnical inspection and should be approved by the Geotechnical Engineer and governmental agencies prior to filling.
- The cut portion of fill over cut slopes should be made first and inspected by the Geotechnical Engineer for possible stabilization requirements. The fill portion should be adequately keyed through all surficial soils and into bedrock or suitable material. Soils should be removed from the transition zone between the cut and fill portions (see Plate D-2).

Cut Slopes


- All cut slopes should be inspected by the Geotechnical Engineer to determine the need for stabilization. The Earthwork Contractor should notify the Geotechnical Engineer when slope cutting is in progress at intervals of 10 vertical feet. Failure to notify may result in a delay in recommendations.
- Cut slopes exposing loose, cohesionless sands should be reported to the Geotechnical Engineer for possible stabilization recommendations.
- All stabilization excavations should be cleared of loose slough material prior to geotechnical inspection. Stakes should be provided by the Civil Engineer to verify the location and dimensions of the key. A typical stabilization fill detail is shown on Plate D-5.

- Stabilization key excavations should be provided with subdrains. Typical subdrain details are shown on Plates D-6.


Subdrains

- Subdrains may be required in canyons and swales where fill placement is proposed. Typical subdrain details for canyons are shown on Plate D-3. Subdrains should be installed after approval of removals and before filling, as determined by the Soils Engineer.
- Plastic pipe may be used for subdrains provided it is Schedule 40 or SDR 35 or equivalent. Pipe should be protected against breakage, typically by placement in a square-cut (backhoe) trench or as recommended by the manufacturer.
- Filter material for subdrains should conform to CALTRANS Specification 68-1.025 or as approved by the Geotechnical Engineer for the specific site conditions. Clean $\frac{3}{4}$ -inch crushed rock may be used provided it is wrapped in an acceptable filter cloth and approved by the Geotechnical Engineer. Pipe diameters should be 6 inches for runs up to 500 feet and 8 inches for the downstream continuations of longer runs. Four-inch diameter pipe may be used in buttress and stabilization fills.

CUT LOT

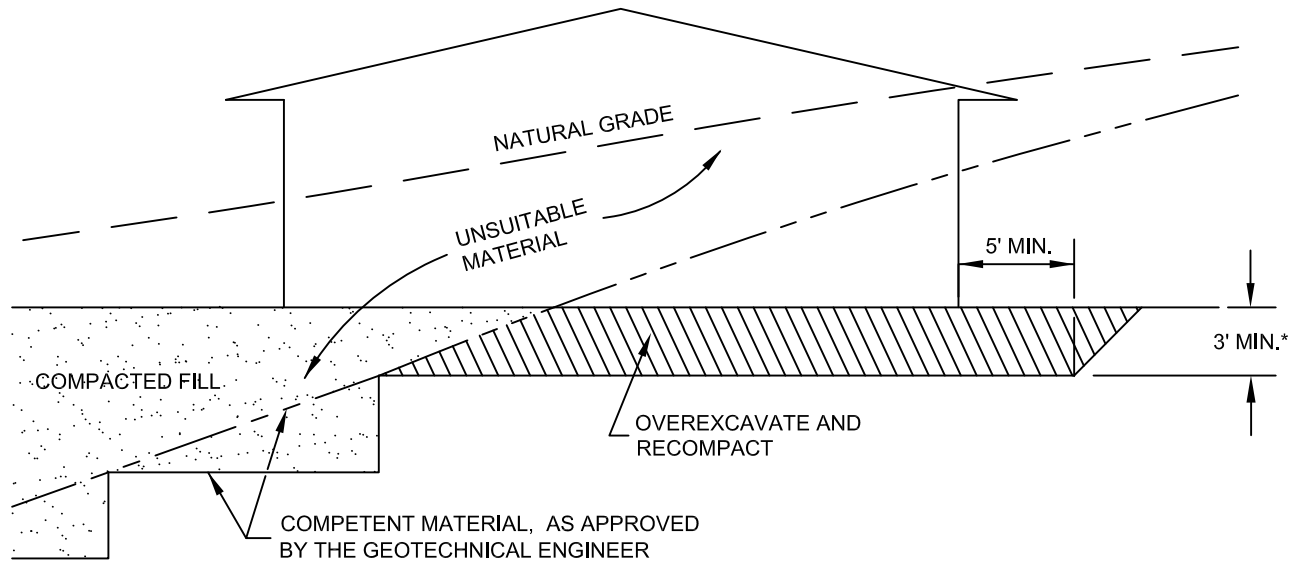


CUT/FILL LOT (TRANSITION)

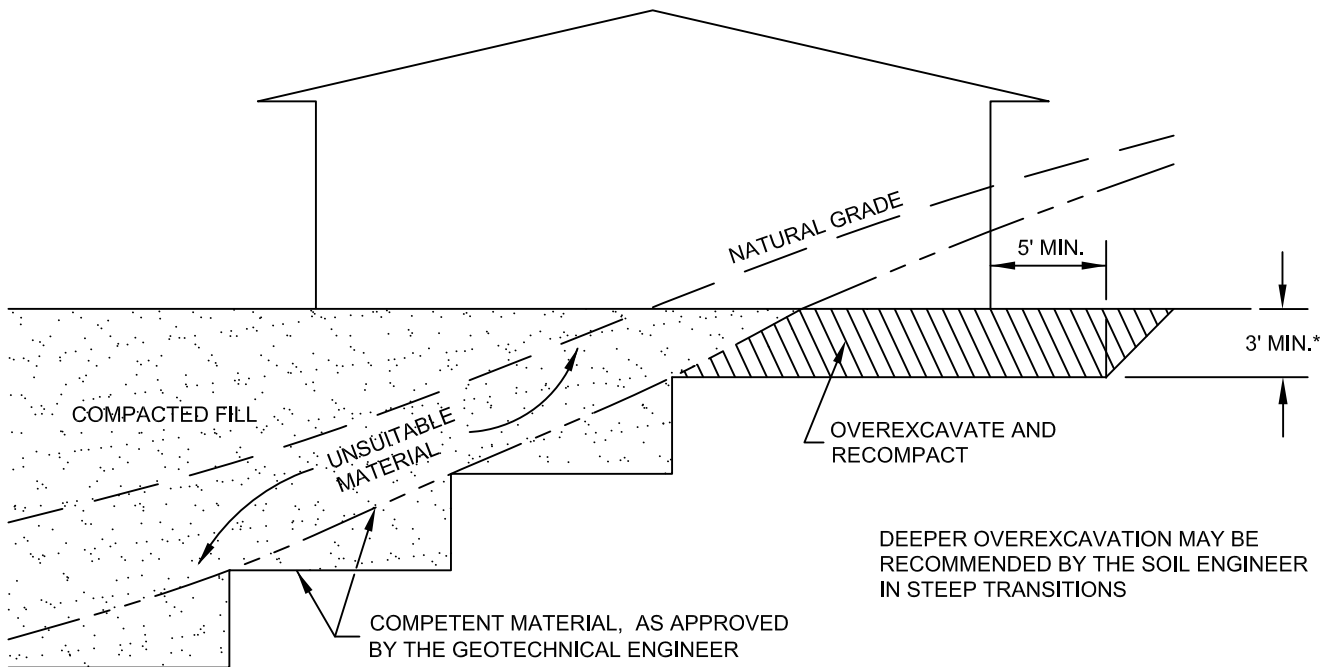


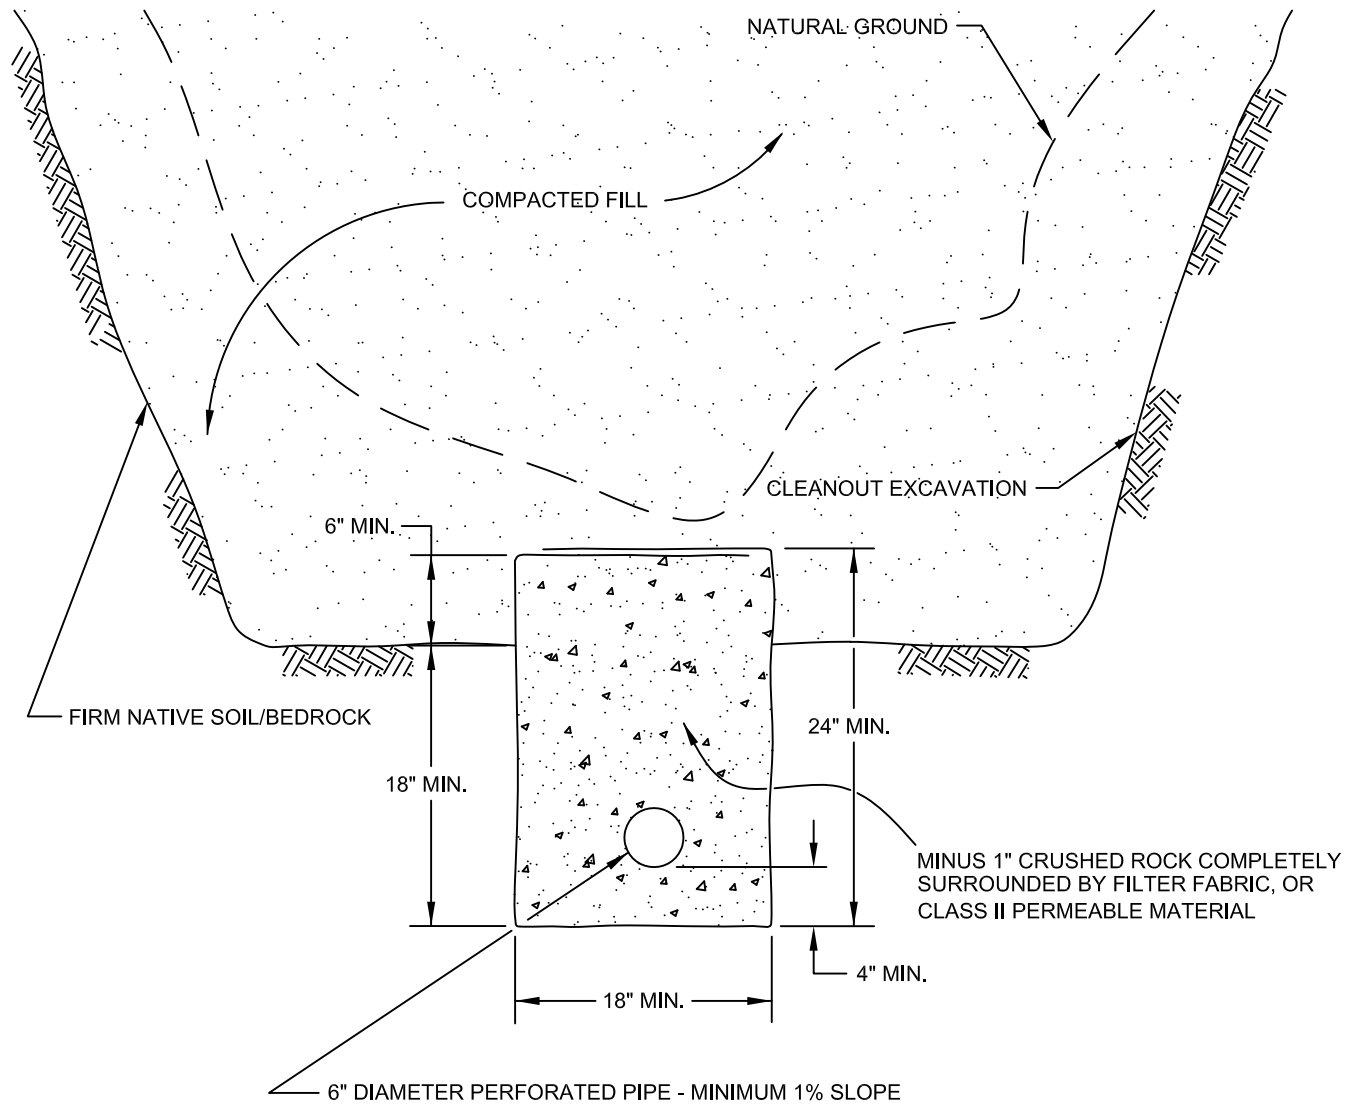
DEEPER OVEREXCAVATION MAY BE RECOMMENDED BY THE SOIL ENGINEER IN STEEP TRANSITIONS

*SEE TEXT OF REPORT FOR SPECIFIC RECOMMENDATION. ACTUAL DEPTH OF OVEREXCAVATION MAY BE GREATER.

TRANSITION LOT DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-1	

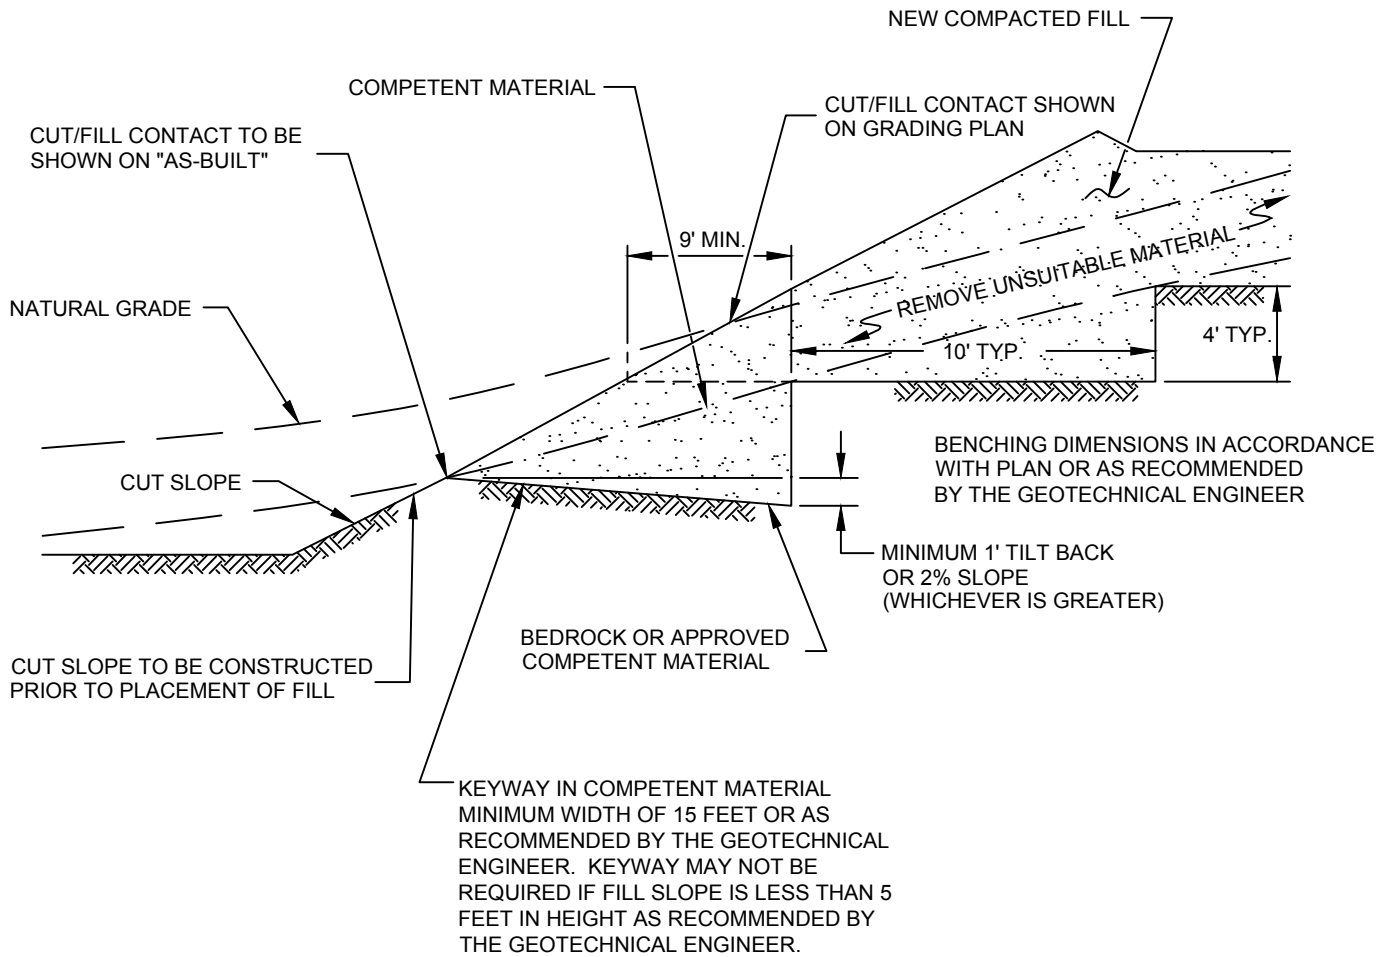


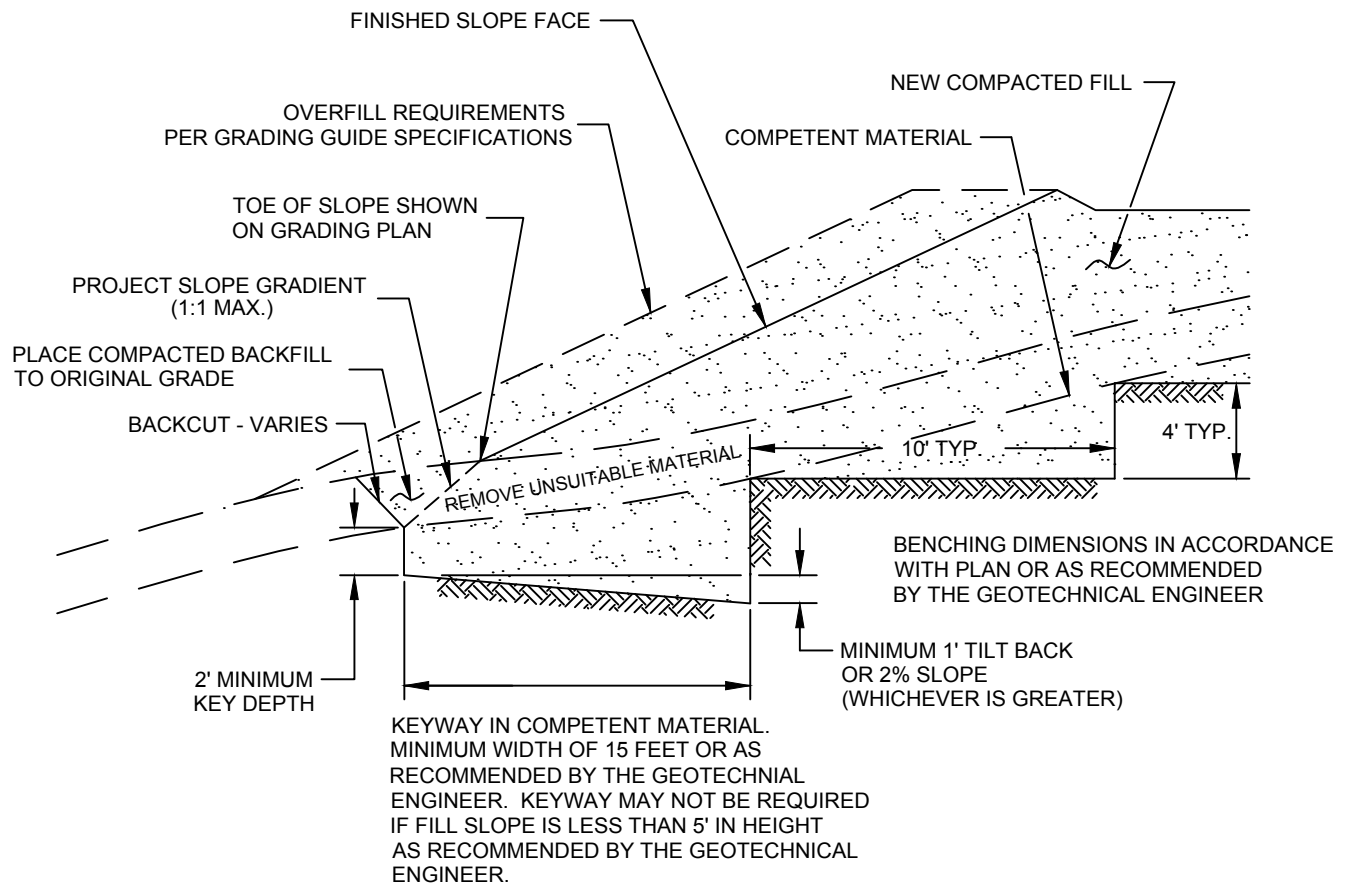
FILL ABOVE CUT SLOPE DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-2	




PIPE MATERIAL	DEPTH OF FILL OVER SUBDRAIN
ADS (CORRUGATED POLETHYLENE)	8
TRANSITE UNDERDRAIN	20
PVC OR ABS: SDR 35	35
SDR 21	100


**SCHEMATIC ONLY
NOT TO SCALE**


CANYON SUBDRAIN DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-3	




NOTE:
 BENCHING SHALL BE REQUIRED
 WHEN NATURAL SLOPES ARE
 EQUAL TO OR STEEPER THAN 5:1
 OR WHEN RECOMMENDED BY
 THE GEOTECHNICAL ENGINEER.

FILL ABOVE NATURAL SLOPE DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-4	

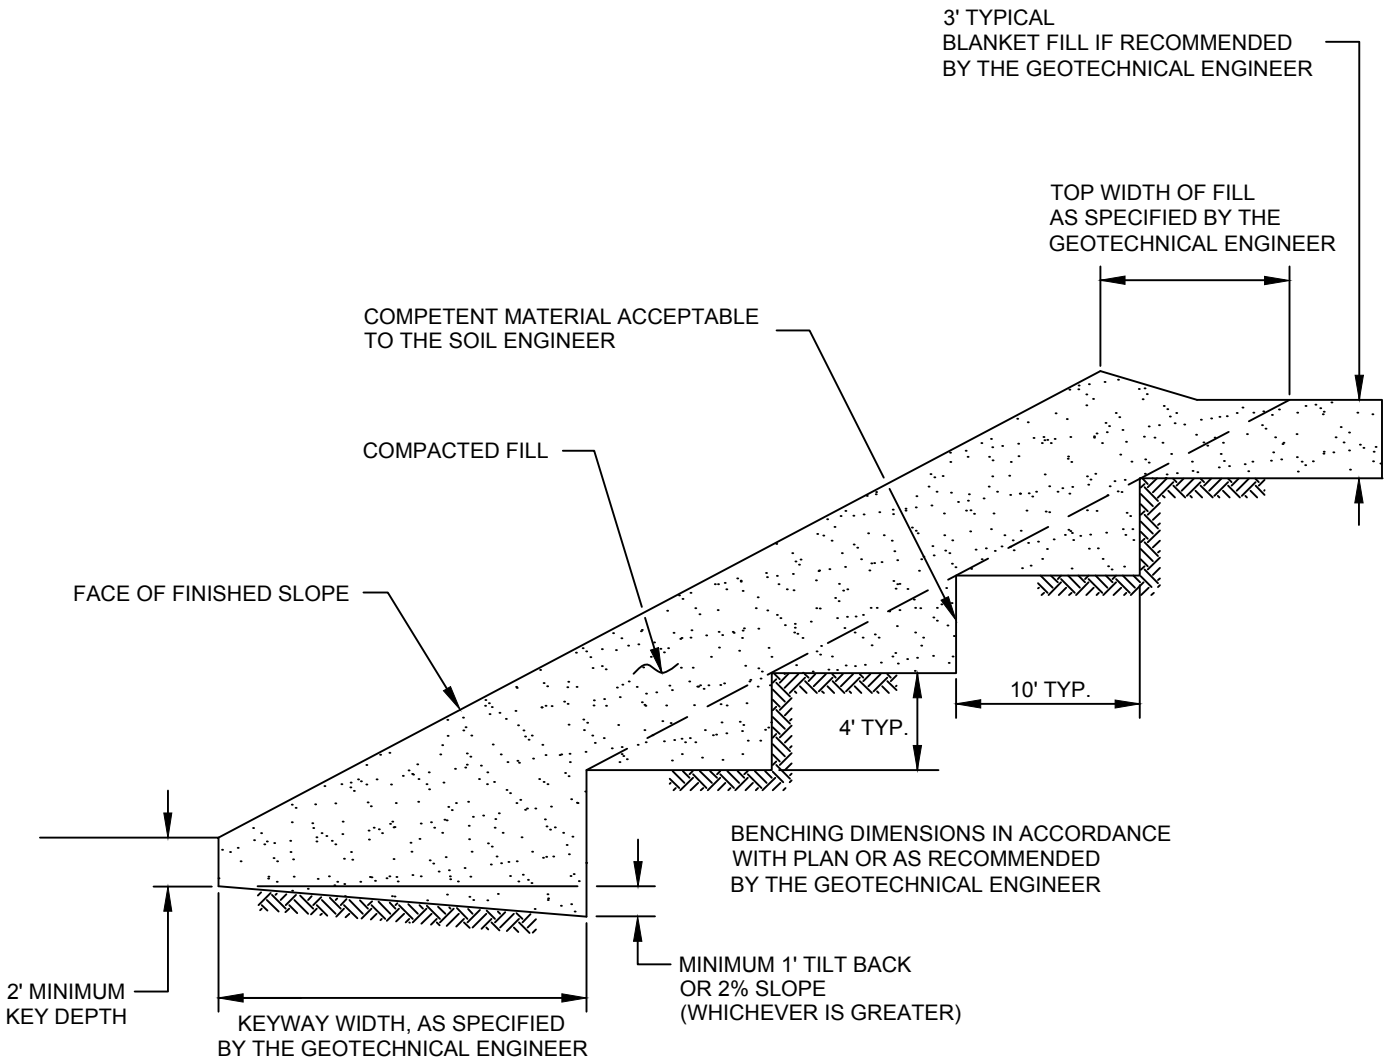

STABILIZATION FILL DETAIL	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-5	

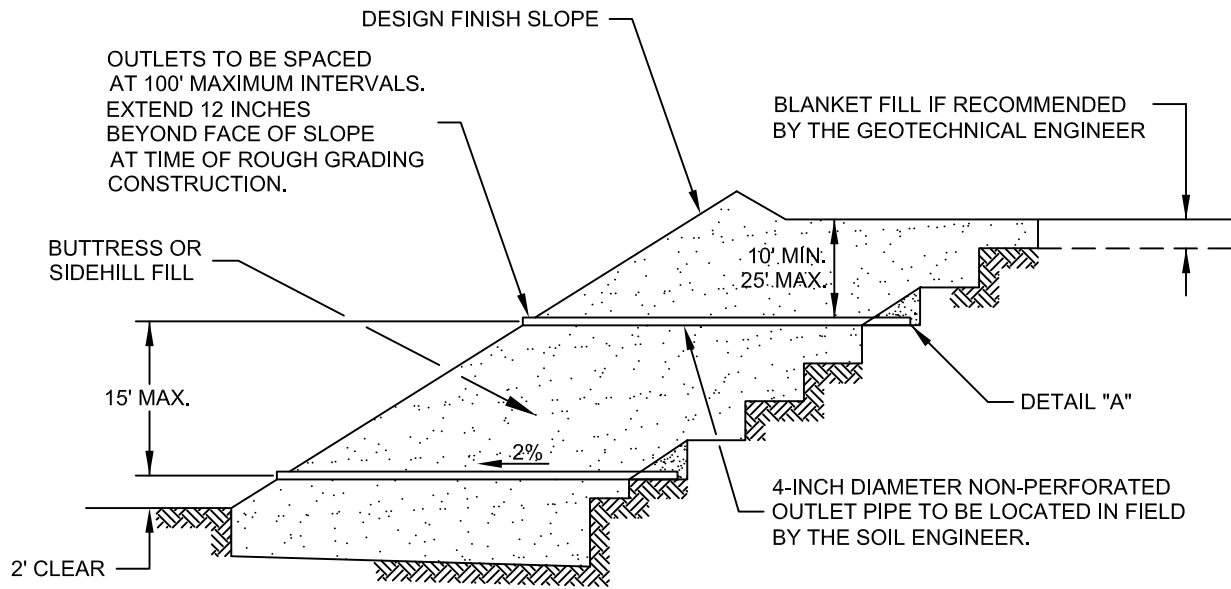


"FILTER MATERIAL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT: (CONFORMS TO EMA STD. PLAN 323)

SIEVE SIZE	PERCENTAGE PASSING
1"	100
3/4"	90-100
3/8"	40-100
NO. 4	25-40
NO. 8	18-33
NO. 30	5-15
NO. 50	0-7
NO. 200	0-3

"GRAVEL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT:

SIEVE SIZE	MAXIMUM PERCENTAGE PASSING
1 1/2"	100
NO. 4	50
NO. 200	8
SAND EQUIVALENT = MINIMUM OF 50	

OUTLET PIPE TO BE CONNECTED TO SUBDRAIN PIPE WITH TEE OR ELBOW

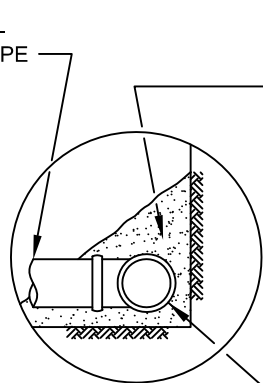

DETAIL "A"

FILTER MATERIAL - MINIMUM OF FIVE CUBIC FEET PER FOOT OF PIPE. SEE ABOVE FOR FILTER MATERIAL SPECIFICATION.


ALTERNATIVE: IN LIEU OF FILTER MATERIAL FIVE CUBIC FEET OF GRAVEL PER FOOT OF PIPE MAY BE ENCASED IN FILTER FABRIC. SEE ABOVE FOR GRAVEL SPECIFICATION.

FILTER FABRIC SHALL BE MIRAFI 140 OR EQUIVALENT. FILTER FABRIC SHALL BE LAPPED A MINIMUM OF 12 INCHES ON ALL JOINTS.

MINIMUM 4-INCH DIAMETER PVC SCH 40 OR ABS CLASS SDR 35 WITH A CRUSHING STRENGTH OF AT LEAST 1,000 POUNDS, WITH A MINIMUM OF 8 UNIFORMLY SPACED PERFORATIONS PER FOOT OF PIPE INSTALLED WITH PERFORATIONS ON BOTTOM OF PIPE. PROVIDE CAP AT UPSTREAM END OF PIPE. SLOPE AT 2 PERCENT TO OUTLET PIPE.

NOTES:

1. TRENCH FOR OUTLET PIPES TO BE BACKFILLED WITH ON-SITE SOIL.

SLOPE FILL SUBDRAINS	
GRADING GUIDE SPECIFICATIONS	
NOT TO SCALE	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: JAS CHKD: GKM	
PLATE D-6	

MINIMUM ONE FOOT THICK LAYER OF LOW PERMEABILITY SOIL IF NOT COVERED WITH AN IMPERMEABLE SURFACE


MINIMUM ONE FOOT WIDE LAYER OF FREE DRAINING MATERIAL (LESS THAN 5% PASSING THE #200 SIEVE) OR PROPERLY INSTALLED PREFABRICATED DRAINAGE COMPOSITE (MiraDRAIN 6000 OR APPROVED EQUIVALENT).

FILTER MATERIAL - MINIMUM OF TWO CUBIC FEET PER FOOT OF PIPE. SEE BELOW FOR FILTER MATERIAL SPECIFICATION.

ALTERNATIVE: IN LIEU OF FILTER MATERIAL TWO CUBIC FEET OF GRAVEL PER FOOT OF PIPE MAY BE ENCASED IN FILTER FABRIC. SEE BELOW FOR GRAVEL SPECIFICATION.

FILTER FABRIC SHALL BE MIRAFAI 140 OR EQUIVALENT. FILTER FABRIC SHALL BE LAPPED A MINIMUM OF 6 INCHES ON ALL JOINTS.

MINIMUM 4-INCH DIAMETER PVC SCH 40 OR ABS CLASS SDR 35 WITH A CRUSHING STRENGTH OF AT LEAST 1,000 POUNDS, WITH A MINIMUM OF 8 UNIFORMLY SPACED PERFORATIONS PER FOOT OF PIPE INSTALLED WITH PERFORATIONS ON BOTTOM OF PIPE. PROVIDE CAP AT UPSTREAM END OF PIPE. SLOPE AT 2 PERCENT TO OUTLET PIPE.

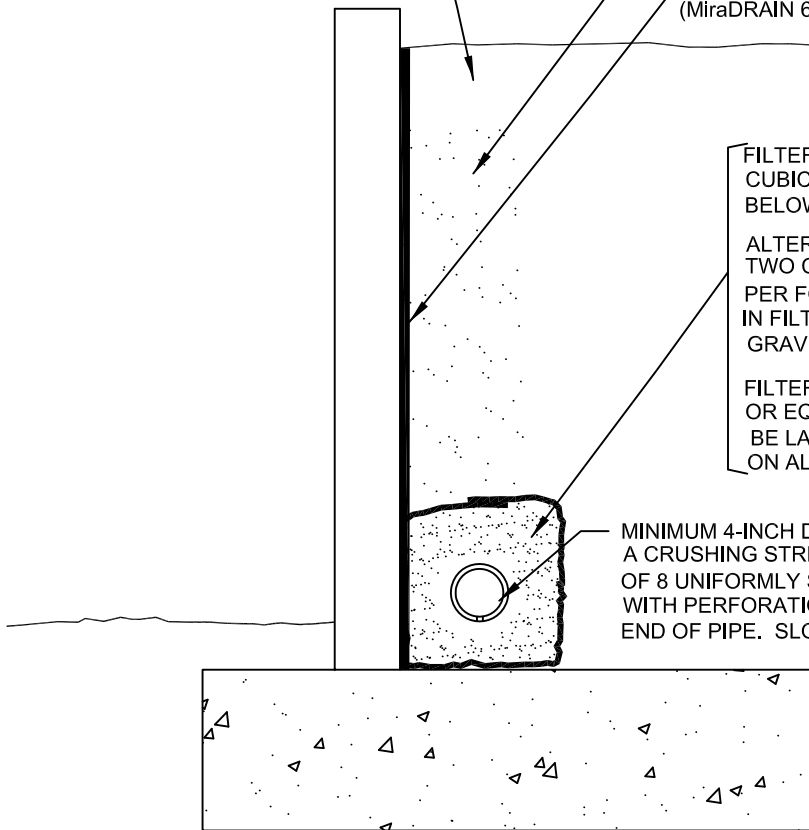

"FILTER MATERIAL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT: (CONFORMS TO EMA STD. PLAN 323)

SIEVE SIZE	PERCENTAGE PASSING
1"	100
3/4"	90-100
3/8"	40-100
NO. 4	25-40
NO. 8	18-33
NO. 30	5-15
NO. 50	0-7
NO. 200	0-3

"GRAVEL" TO MEET FOLLOWING SPECIFICATION OR APPROVED EQUIVALENT:

SIEVE SIZE	MAXIMUM PERCENTAGE PASSING
1 1/2"	100
NO. 4	50
NO. 200	8
SAND EQUIVALENT = MINIMUM OF 50	

**RETAINING WALL BACKDRAINS
GRADING GUIDE SPECIFICATIONS**



NOT TO SCALE

DRAWN: JAS
CHKD: GKM

PLATE D-7



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**

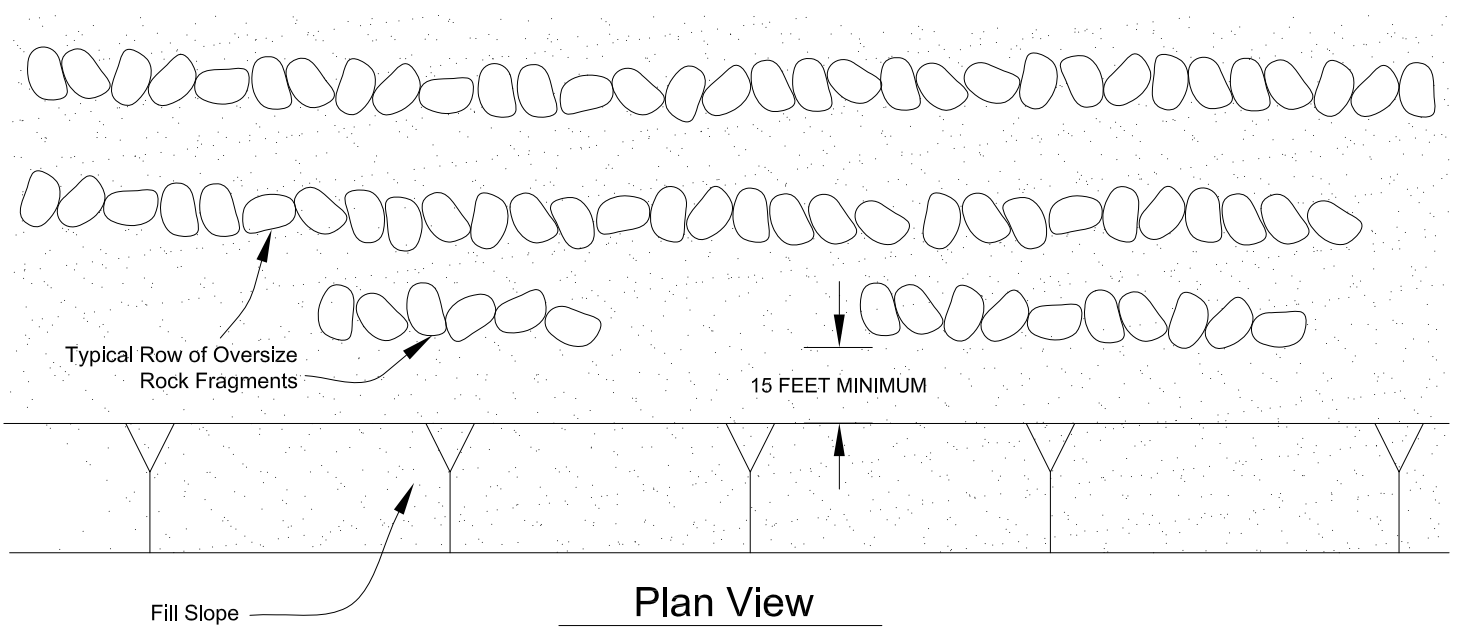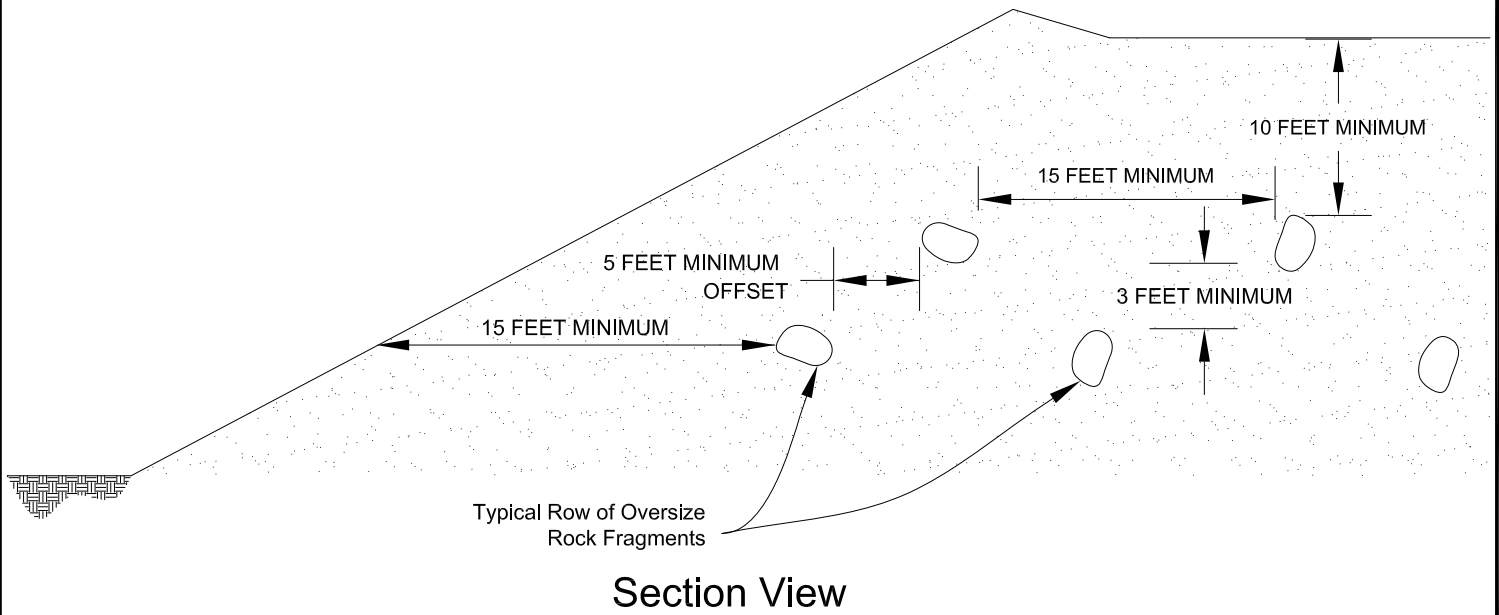

**PLACEMENT OF OVERSIZED MATERIAL
GRADING GUIDE SPECIFICATIONS**

NOT TO SCALE

DRAWN: PM
CHKD: GKM

PLATE D-8




**SOUTHERN
CALIFORNIA
GEOTECHNICAL**

APPENDIX E



Latitude, Longitude: 33.82701068, -117.21356458

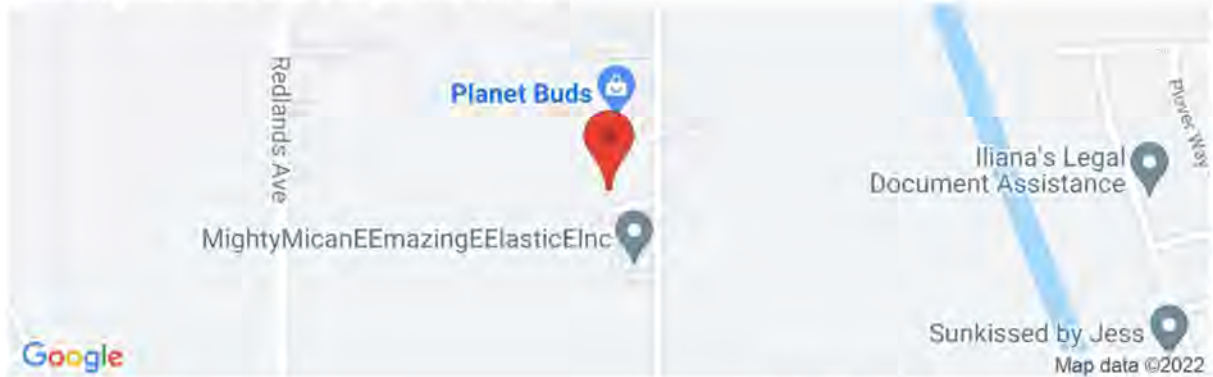

Date	1/24/2022, 2:19:44 PM
Design Code Reference Document	ASCE7-16
Risk Category	III
Site Class	D - Stiff Soil

Type	Value	Description
S _S	1.5	MCE _R ground motion. (for 0.2 second period)
S ₁	0.573	MCE _R ground motion. (for 1.0s period)
S _{MS}	1.5	Site-modified spectral acceleration value
S _{M1}	null -See Section 11.4.8	Site-modified spectral acceleration value
S _{DS}	1	Numeric seismic design value at 0.2 second SA
S _{D1}	null -See Section 11.4.8	Numeric seismic design value at 1.0 second SA

Type	Value	Description
SDC	null -See Section 11.4.8	Seismic design category
F _a	1	Site amplification factor at 0.2 second
F _v	null -See Section 11.4.8	Site amplification factor at 1.0 second
PGA	0.5	MCE _G peak ground acceleration
F _{PGA}	1.1	Site amplification factor at PGA
PGA _M	0.55	Site modified peak ground acceleration
T _L	8	Long-period transition period in seconds
S _{sRT}	1.528	Probabilistic risk-targeted ground motion. (0.2 second)
S _{sUH}	1.639	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration
S _{sD}	1.5	Factored deterministic acceleration value. (0.2 second)
S _{1RT}	0.573	Probabilistic risk-targeted ground motion. (1.0 second)
S _{1UH}	0.628	Factored uniform-hazard (2% probability of exceedance in 50 years) spectral acceleration.
S _{1D}	0.6	Factored deterministic acceleration value. (1.0 second)
PGA _d	0.5	Factored deterministic acceleration value. (Peak Ground Acceleration)
C _{RS}	0.933	Mapped value of the risk coefficient at short periods
C _{R1}	0.912	Mapped value of the risk coefficient at a period of 1 s

SOURCE: SEAOC/OSHPD Seismic Design Maps Tool
<<https://seismicmaps.org/>>



SEISMIC DESIGN PARAMETERS - 2019 CBC	
PROPOSED COMMERCIAL/INDUSTRIAL BUILDING	
PERRIS, CALIFORNIA	
DRAWN: RB CHKD: RGT SCG PROJECT 21G206-3 PLATE E-1	 SOUTHERN CALIFORNIA GEOTECHNICAL

APPENDIX

LIQUEFACTION EVALUATION

Project Name	Proposed C/I Building
Project Location	Perris, CA
Project Number	21G206-3
Engineer	JLL

Design PGA	0.550 (g)
Design Magnitude	7.01
Historic High Depth to Groundwater	15 (ft)
Depth to Groundwater at Time of Drilling	38.5 (ft)
Borehole Diameter	6 (in)

Boring No. B-2

Sample Depth (ft)	Depth to Top of Layer (ft)	Depth to Bottom of Layer (ft)	Depth to Midpoint (ft)	Uncorrected SPT N-Value	Unit Weight of Soil (pcf)	Fines Content (%)	Energy Correction	C_B	C_S	C_N	Rod Length Correction	$(N_1)_{60}$	$(N_1)_{60CS}$	Overburden Stress (σ'_o) (psf)	Eff. Overburden Stress (Hist. Water) (σ'_o) (psf)	Eff. Overburden Stress (Curr. Water) (σ'_o) (psf)	Stress Reduction Coefficient (r_d)	MSF	KS	Cyclic Resistance Ratio (M=7.5)	Cyclic Resistance Ratio (M=7.01)	Cyclic Stress Ratio Induced by Design Earthquake	Factor of Safety	Comments
							(1)	(2)	(3)	(4)	(5)	(6)	(7)				(8)	(9)	(10)	(11)	(12)	(13)		
14.5	0	15	7.5		120		1.3	1.05	1.1	1.70	0.85	0.0	0.0	900	900	900	0.98	1.02	1.04	0.06	0.06	N/A	N/A	Above Water Table
14.5	15	17	9.5	13	120	65	1.3	1.05	1.234	1.26	0.85	23.4	29.0	1140	1140	1140	0.98	1.16	1.1	0.43	0.55	0.35	1.57	Nonliquefiable
19.5	17	22	19.5	34	120		1.3	1.05	1.3	0.98	0.95	56.1	56.1	2340	2059	2340	0.93	1.21	1.01	2.00	2.00	0.38	5.28	Nonliquefiable
24.5	22	27	24.5	50	120		1.3	1.05	1.3	0.97	0.95	81.9	81.9	2940	2347	2940	0.91	1.21	0.97	2.00	2.00	0.41	4.92	Nonliquefiable
29.5	27	32	29.5	42	120		1.3	1.05	1.3	0.92	0.95	65.1	65.1	3540	2635	3540	0.88	1.21	0.93	2.00	2.00	0.42	4.72	Nonliquefiable
34.5	32	37	34.5	45	120		1.3	1.05	1.3	0.92	1	73.4	73.4	4140	2923	4140	0.85	1.21	0.9	2.00	2.00	0.43	4.62	Nonliquefiable
39.5	37	42	39.5	27	120	43	1.3	1.05	1.3	0.80	1	38.6	44.2	4740	3211	4678	0.83	1.21	0.87	2.00	2.00	0.44	4.58	Nonliquefiable
44.5	42	47	44.5	31	120		1.3	1.05	1.3	0.79	1	43.4	43.4	5340	3499	4966	0.80	1.21	0.85	2.00	2.00	0.44	4.59	Nonliquefiable
49.5	47	50	48.5	34	120		1.3	1.05	1.3	0.80	1	48.1	48.1	5820	3730	5196	0.78	1.21	0.83	2.00	2.00	0.43	4.61	Nonliquefiable

Notes:

- | | |
|---|--|
| (1) Energy Correction for N_{60} of automatic hammer to standard N_{60} | (8) Stress Reduction Coefficient calculated by Eq. 22 (Boulanger and Idriss, 2008) |
| (2) Borehole Diameter Correction (Skempton, 1986) | (9) Magnitude Scaling Factor calculated by Eqns. A.8 & A.10 (Boulanger and Idriss, 2014) |
| (3) Correction for split-spoon sampler with room for liners, but liners are absent, (Seed et al., 1984, 2001) | (10) Overburden Correction Factor calculated by Eq. 54 (Boulanger and Idriss, 2008) |
| (4) Overburden Correction, Calculated by Eq. 39 (Boulanger and Idriss, 2008) | (11) Calculated by Eq. 70 (Boulanger and Idriss, 2008) |
| (5) Rod Length Correction for Samples <10 m in depth | (12) Calculated by Eq. 72 (Boulanger and Idriss, 2008) |
| (6) N-value corrected for energy, borehole diameter, sampler with absent liners, rod length, and overburden | (13) Calculated by Eq. 25 (Boulanger and Idriss, 2008) |
| (7) N-value corrected for fines content per Eqs. 75 and 76 (Boulanger and Idriss, 2008) | |

LIQUEFACTION INDUCED SETTLEMENTS

Project Name	Proposed C/I Building
Project Location	Perris, CA
Project Number	21G206-3
Engineer	JLL

Boring No. B-2

Sample Depth (ft)	Depth to Top of Layer (ft)	Depth to Bottom of Layer (ft)	Depth to Midpoint (ft)	(N ₁) ₆₀	DN for fines cont	(N ₁) _{60-CS}	Liquefaction Factor of Safety	Limiting Shear Strain γ_{min}	Parameter F _q	Maximum Shear Strain γ_{max}	Height of Layer		Vertical Reconsolidation Strain ϵ_v	Total Deformation of Layer (in)	Comments
				(1)	(2)	(3)	(4)	(5)	(6)	(7)			(8)		
14.5	0	15	7.5	0.0	0.0	0.0	N/A	0.50	0.95	0.00	15.00		0.000	0.00	Above Water Table
14.5	15	17	9.5	23.4	5.6	29.0	1.57	0.05	-0.02	0.00	2.00		0.000	0.00	Nonliquefiable
19.5	17	22	19.5	56.1	0.0	56.1	5.28	0.00	-2.10	0.00	5.00		0.000	0.00	Nonliquefiable
24.5	22	27	24.5	81.9	0.0	81.9	4.92	0.00	-4.37	0.00	5.00		0.000	0.00	Nonliquefiable
29.5	27	32	29.5	65.1	0.0	65.1	4.72	0.00	-2.86	0.00	5.00		0.000	0.00	Nonliquefiable
34.5	32	37	34.5	73.4	0.0	73.4	4.62	0.00	-3.60	0.00	5.00		0.000	0.00	Nonliquefiable
39.5	37	42	39.5	38.6	5.6	44.2	4.58	0.00	-1.12	0.00	5.00		0.000	0.00	Nonliquefiable
44.5	42	47	44.5	43.4	0.0	43.4	4.59	0.00	-1.06	0.00	5.00		0.000	0.00	Nonliquefiable
49.5	47	50	48.5	48.1	0.0	48.1	4.61	0.00	-1.44	0.00	3.00		0.000	0.00	Nonliquefiable
Total Deformation (in)														0.00	

Notes:

- (1) (N₁)₆₀ calculated previously for the individual layer
- (2) Correction for fines content per Equation 76 (Boulanger and Idriss, 2008)
- (3) Corrected (N₁)₆₀ for fines content
- (4) Factor of Safety against Liquefaction, calculated previously for the individual layer
- (5) Calculated by Eq. 86 (Boulanger and Idriss, 2008)
- (6) Calculated by Eq. 89 (Boulanger and Idriss, 2008)
- (7) Calculated by Eqs. 90, 91, and 92 (Boulanger and Idriss, 2008)
- (8) Volumetric Strain Induced in a Liquefiable Layer, Calculated by Eq. 96 (Boulanger and Idriss, 2008)
(Strain N/A if Factor of Safety against Liquefaction > 1.3)

LIQUEFACTION EVALUATION

Project Name	Proposed C/I Building
Project Location	Perris, CA
Project Number	21G206-3
Engineer	JLL

Design PGA	0.550 (g)
Design Magnitude	7.01
Historic High Depth to Groundwater	15 (ft)
Depth to Groundwater at Time of Drilling	38 (ft)
Borehole Diameter	6 (in)

Boring No. B-4

Sample Depth (ft)	Depth to Top of Layer (ft)	Depth to Bottom of Layer (ft)	Depth to Midpoint (ft)	Uncorrected SPT N-Value	Unit Weight of Soil (pcf)	Fines Content (%)	Energy Correction	C_B	C_S	C_N	Rod Length Correction	$(N_1)_{60}$	$(N_1)_{60cs}$	Overburden Stress (σ'_0) (psf)	Eff. Overburden Stress (Hist. Water) (σ'_0) (psf)	Eff. Overburden Stress (Curr. Water) (σ'_0) (psf)	Stress Reduction Coefficient (r_d)	MSF	KS	Cyclic Resistance Ratio (M=7.5)	Cyclic Resistance Ratio (M=7.01)	Cyclic Stress Ratio Induced by Design Earthquake	Factor of Safety	Comments
							(1)	(2)	(3)	(4)	(5)	(6)	(7)				(8)	(9)	(10)	(11)	(12)	(13)		
14.5	0	15	7.5		120		1.3	1.05	1.1	1.70	0.85	0.0	0.0	900	900	900	0.98	1.02	1.04	0.06	0.06	N/A	N/A	Above Water Table
14.5	15	17	9.5	21	120		1.3	1.05	1.3	1.21	0.85	38.3	38.3	1140	1140	1140	0.98	1.21	1.1	2.00	2.00	0.35	5.73	Nonliquefiable
19.5	17	22	19.5	14	120	34	1.3	1.05	1.212	0.96	0.95	21.2	26.6	2340	2059	2340	0.93	1.14	1	0.33	0.38	0.38	1.01	Liquefiable
24.5	22	27	24.5	40	120		1.3	1.05	1.3	0.95	0.95	63.7	63.7	2940	2347	2940	0.91	1.21	0.97	2.00	2.00	0.41	4.92	Nonliquefiable
29.5	27	32	29.5	21	120	20	1.3	1.05	1.297	0.84	0.95	29.7	34.2	3540	2635	3540	0.88	1.21	0.94	0.95	1.08	0.42	2.55	Nonliquefiable
34.5	32	37	34.5	24	120		1.3	1.05	1.3	0.80	1	34.0	34.0	4140	2923	4140	0.85	1.21	0.92	0.91	1.00	0.43	2.32	Nonliquefiable
39.5	37	42	39.5	34	120		1.3	1.05	1.3	0.83	1	49.9	49.9	4740	3211	4646	0.83	1.21	0.87	2.00	2.00	0.44	4.58	Nonliquefiable
44.5	42	47	44.5	32	120		1.3	1.05	1.3	0.80	1	45.3	45.3	5340	3499	4934	0.80	1.21	0.85	2.00	2.00	0.44	4.59	Nonliquefiable
49.5	47	50	48.5	39	120		1.3	1.05	1.3	0.84	1	57.9	57.9	5820	3730	5165	0.78	1.21	0.83	2.00	2.00	0.43	4.61	Nonliquefiable

Notes:

- | | |
|---|--|
| (1) Energy Correction for N_{60} of automatic hammer to standard N_{60} | (8) Stress Reduction Coefficient calculated by Eq. 22 (Boulanger and Idriss, 2008) |
| (2) Borehole Diameter Correction (Skempton, 1986) | (9) Magnitude Scaling Factor calculated by Eqns. A.8 & A.10 (Boulanger and Idriss, 2014) |
| (3) Correction for split-spoon sampler with room for liners, but liners are absent, (Seed et al., 1984, 2001) | (10) Overburden Correction Factor calculated by Eq. 54 (Boulanger and Idriss, 2008) |
| (4) Overburden Correction, Calculated by Eq. 39 (Boulanger and Idriss, 2008) | (11) Calculated by Eq. 70 (Boulanger and Idriss, 2008) |
| (5) Rod Length Correction for Samples <10 m in depth | (12) Calculated by Eq. 72 (Boulanger and Idriss, 2008) |
| (6) N-value corrected for energy, borehole diameter, sampler with absent liners, rod length, and overburden | (13) Calculated by Eq. 25 (Boulanger and Idriss, 2008) |
| (7) N-value corrected for fines content per Eqs. 75 and 76 (Boulanger and Idriss, 2008) | |

LIQUEFACTION INDUCED SETTLEMENTS

Project Name	Proposed C/I Building
Project Location	Perris, CA
Project Number	21G206-3
Engineer	JLL

Boring No. B-4

Sample Depth (ft)	Depth to Top of Layer (ft)	Depth to Bottom of Layer (ft)	Depth to Midpoint (ft)	(N ₁) ₆₀	DN for fines cont	(N ₁) _{60-cs}	Liquefaction Factor of Safety	Limiting Shear Strain γ_{min}	Parameter F _q	Maximum Shear Strain γ_{max}	Height of Layer		Vertical Reconsolidation Strain ϵ_v		Total Deformation of Layer (in)	Comments
				(1)	(2)	(3)	(4)	(5)	(6)	(7)			(8)			
14.5	0	15	7.5	0.0	0.0	0.0	N/A	0.50	0.95	0.00	15.00		0.000		0.00	Above Water Table
14.5	15	17	9.5	38.3	0.0	38.3	5.73	0.01	-0.68	0.00	2.00		0.000		0.00	Nonliquefiable
19.5	17	22	19.5	21.2	5.5	26.6	1.01	0.07	0.13	0.03	5.00		0.008		0.46	Liquefiable
24.5	22	27	24.5	63.7	0.0	63.7	4.92	0.00	-2.75	0.00	5.00		0.000		0.00	Nonliquefiable
29.5	27	32	29.5	29.7	4.5	34.2	2.55	0.02	-0.38	0.00	5.00		0.000		0.00	Nonliquefiable
34.5	32	37	34.5	34.0	0.0	34.0	2.32	0.03	-0.36	0.00	5.00		0.000		0.00	Nonliquefiable
39.5	37	42	39.5	49.9	0.0	49.9	4.58	0.00	-1.58	0.00	5.00		0.000		0.00	Nonliquefiable
44.5	42	47	44.5	45.3	0.0	45.3	4.59	0.00	-1.21	0.00	5.00		0.000		0.00	Nonliquefiable
49.5	47	50	48.5	57.9	0.0	57.9	4.61	0.00	-2.25	0.00	3.00		0.000		0.00	Nonliquefiable
Total Deformation (in)															0.46	

Notes:

- (1) (N₁)₆₀ calculated previously for the individual layer
- (2) Correction for fines content per Equation 76 (Boulanger and Idriss, 2008)
- (3) Corrected (N₁)₆₀ for fines content
- (4) Factor of Safety against Liquefaction, calculated previously for the individual layer
- (5) Calculated by Eq. 86 (Boulanger and Idriss, 2008)
- (6) Calculated by Eq. 89 (Boulanger and Idriss, 2008)
- (7) Calculated by Eqs. 90, 91, and 92 (Boulanger and Idriss, 2008)
- (8) Volumetric Strain Induced in a Liquefiable Layer, Calculated by Eq. 96 (Boulanger and Idriss, 2008)
(Strain N/A if Factor of Safety against Liquefaction > 1.3)

February 22, 2022

First Industrial Realty Trust, Inc.
898 N. Pacific Coast Highway. STE 175
El Segundo, CA 90245



**SOUTHERN
CALIFORNIA
GEOTECHNICAL**
A California Corporation

Attention: Mr. Matt Pioli
Investment Officer

Project No.: **21G206-4**

Subject: **Results of Additional Infiltration Testing**
Proposed Commercial/Industrial Building
West Side of Wilson Avenue, 820± feet South of East Rider Street
Perris, California

References: 1) Geotechnical Investigation, Proposed Commercial/Industrial Building, West Side of Wilson Avenue, 820± feet South of East Rider Street, Perris, California, prepared for First Industrial Realty Trust, Inc. by Southern California Geotechnical, Inc. (SCG), SCG Project No. 21G206-3.

2) Results of Infiltration Testing, Proposed Commercial/Industrial Building, Wilson Avenue, 970± feet South of Rider Street, Perris, California, prepared for First Industrial Realty Trust, Inc. by SCG, SCG Project No. 21G206-2.

Mr. Pioli:

In accordance with your request, we have conducted infiltration testing at the subject site. We are pleased to present this report summarizing the results of the infiltration testing and our design recommendations.

Scope of Services

The scope of services performed for this project was in general accordance with Change Order No. 21G206-CO, dated January 13, 2022. The scope of services included site reconnaissance, subsurface exploration, field testing, and engineering analysis to determine the infiltration rates of the on-site soils at the tested locations. The infiltration testing was performed in general accordance with ASTM Test Method D-3385-03, Standard Test Method for Infiltration Rate of Soils in Field Using Double Ring Infiltrometer.

Site and Project Description

The subject site is located on the west side of Wilson Avenue, 820± feet south of the intersection of Wilson Avenue and East Rider Street in Perris, California. The site is bounded to the north by a demolished single-family residence (SFR), to the east by Wilson Street, and to the south and west by vacant lots. The general location of the site is illustrated on the Site Location Map, included as Plate 1 of this report.

The site consists of four (4) rectangular parcels, totaling 9.46± acres in size. Based on our visit to the site and review of Google Earth aerial photographs, the eastern portion of the northernmost parcel is currently developed with a single-story SFR, and is used as a medical recreational facility. The north-central parcel is vacant and undeveloped. The south-central and southernmost parcels are each developed with a single-story duplex home and a metal-framed canopy. The existing structures are assumed to be supported on shallow foundation systems, with concrete slab-on-grade floors. Ground surface throughout the parcels generally consists of exposed soil with sparse to dense native grass and weed growth, and occasional medium-to-large trees. Asphaltic concrete pavements with isolated areas of concrete flatwork and medium sized-trees surround the existing medical recreational facility in the northernmost parcel. Abundant scattered debris are located within the western portion of this parcel. In addition, ground surface cover throughout the central parcel consists mainly of open-graded gravel, with small regions of moderate native grass and weed growth.

Detailed topographic information was not available at the time of this report. Based on elevations obtained from Google Earth and visual observations made at the time of the subsurface investigation, the site is relatively flat, with an overall gradient of less than 1± percent.

Proposed Development

The most current conceptual site plan, identified as A1—3PA prepared by RGA, was provided to our office by the client. The plan indicates that the new development will consist of one (1) new commercial/industrial building, 182,925± ft² in size, located in the eastern portion of the subject site. Dock-high doors and a truck court will be constructed on the west side of the proposed building. The new building is expected to be surrounded by asphaltic concrete (AC) pavements in the parking and drive areas and Portland cement concrete (PCC) pavements in the loading dock area. Several landscaped planters and concrete flatwork are also expected to be included throughout the site.

We understand that the proposed development will include on-site storm water infiltration. The type, location and depth of a proposed infiltration system has not been provided. Based on our experience with similar projects, the infiltration system is expected to consist of below-grade chambers located in the western portion of the site. The bottom of the infiltration system is expected to be 10± feet below the existing site grades.

Previous Studies

Geotechnical Investigation

SCG previously performed a geotechnical investigation at the subject site. The results of this investigation were presented in Reference 1. As part of this study, nine (9) borings (identified as Boring Nos. B-1 through B-9) were advanced to depths of 15 to 50± feet below the existing site grades. The previous boring locations are depicted on the Infiltration Test Location Plan included as Plate 2 of this report.

Artificial fill soils were encountered at the ground surface at all of the boring locations, with the exception of Boring No. B-5, extending to depths of 2½ to 5½± feet below the existing site grades. The fill soils generally consist of loose to medium dense sandy silts and silty sands with varying clay and fine gravel content, and stiff to very stiff sandy clays and clayey silts. Additional soils classified as possible fill were encountered at the ground surface at Boring No. B-5 and beneath the artificial fill soils at Boring Nos. B-1 and B-6, extending to depths of 4½ to 8± feet. The possible fill soils consist of loose to medium dense sandy silts and silty sands. Native alluvial soils were encountered beneath the fill and possible fill soils at all of the boring locations, extending to at least the maximum depth explored of 50± feet. The alluvial soils generally consist of medium dense to dense silty sands, clayey sands and sandy silts, and very stiff to hard sandy clays and silty clays.

Infiltration Report

SCG previously performed infiltration testing at the subject site. The results of the previous infiltration testing were presented in Reference 2. The previously proposed infiltration system for the subject site consisted of one (1) below-grade chamber system and one (1) detention basin, both located in the northeastern portion of the site. The infiltration systems were expected to extend to a depth of 8± feet below the existing site grades. The infiltration testing for this study consisted of two (2) backhoe-excavated trenches, extending to a depth of 8± feet below existing site grades. The approximate infiltration test locations (identified as Infiltration Test Nos. I-1 and I-2) are depicted on the Infiltration Test Location Plan included as Plate 2 of this report.

Artificial fill soils were encountered at the ground surface at both infiltration boring locations, extending to a depth of 1½± feet below the existing site grades. The artificial fill soils consist of loose to medium dense silty fine to coarse sands with traces of clay and fine gravel. Native alluvial soils were encountered beneath the fill at both infiltration test locations, extending to at least the maximum depth explored of 8± feet. The alluvium generally consists of medium dense to dense sandy silts with varying clay content and clayey sands, and very stiff sandy clays.

Based on the previous infiltration testing performed at the subject site, SCG recommended an infiltration rate of 0.6 inches per hour be used for the previously proposed chamber system design, and a rate of 0.4 inches per hour for the previously proposed detention system design.

Groundwater

Free water was encountered during drilling at Boring Nos. B-2 and B-4 at depths of 38 to 38½± feet below the ground surface. The static groundwater table was considered to have been present at a depth of 38 to 38½± feet below the existing site grades at the time of the previous subsurface exploration.

As part of our research, we reviewed available groundwater data in order to determine the historic high groundwater level for the site. The primary reference used to determine the historic groundwater depths in this area is the Western Municipal Water District and the San Bernardino Valley Water Conservation District Cooperative Well Measuring Program. The high water level from the nearest well is the following:

State Well ID	Approximate Distance from Subject Site	High Water Level MSL (feet)
04S/03W-10M01	< 2640 feet	1,424.00

Based on topographic information obtained from Google Earth, the elevation at the subject site ranges from 1439± feet msl to 1444± feet msl. The elevation of the high water level in the well is 1424± feet msl. Based on this well data, the depth of the high water level at the subject site, measured from the lowest elevation at the subject site, is 15± feet below the existing site grades. Therefore, a groundwater depth of 15± feet is considered to be conservative with respect to the more recent site conditions.

Subsurface Exploration

Scope of Exploration

The subsurface exploration for the infiltration testing consisted of two (2) backhoe-excavated trenches, extending to a depth of 10± feet below existing site grades. The trenches were logged during excavation by a member of our staff. The approximate locations of the infiltration trenches (identified as Infiltration Test Nos. I-3 and I-4) are indicated on the Infiltration Test Location Plan, enclosed as Plate 2 of this report.

Geotechnical Conditions

Artificial fill soils were encountered at the ground surface at Infiltration Test No. I-3, extending to a depth of 4± feet below the existing site grades. The fill soils generally consisted of medium dense silty fine to medium sands with traces of clay. The fill soils possess a disturbed and mottled appearance, resulting in their classification as artificial fill. A 2-inch-thick open-graded gravel layer was encountered at the ground surface at Infiltration Test No. I-4. Native alluvium was encountered beneath the open-graded gravel and fill soils at both of the trench locations, extending to at least the maximum depth explored of 10± feet. The alluvial soils generally consist of very dense silty fine to medium sands to fine to medium sandy silts, and dense fine to medium sandy silts with little clay content. Some of these soils possess slight cementation with varying calcareous nodules and veining. The Trench Logs, which illustrate the conditions encountered at each of the trenches, are included with this report.

Infiltration Testing

We understand that the results of the testing will be used to prepare a preliminary design for the storm water infiltration system that will be used at the subject site. As previously mentioned, the infiltration testing was performed in general accordance with ASTM Test Method D-3385-03, Standard Test Method for Infiltration Rate of Soils in Field Using Double Ring Infiltrometer.

Two stainless steel infiltration rings were used for the infiltration testing. The outer infiltration ring is 2 feet in diameter and 20 inches in height. The inner infiltration ring is 1 foot in diameter and 20 inches in height. At the test locations, the outer ring was driven 3± inches into the soil at the base of each trench. The inner ring was centered inside the outer ring and subsequently driven 3± inches into the soil at the base of the trench. The rings were driven into the soil using

a ten-pound sledge hammer. The soil surrounding the wall of the infiltration rings was only slightly disturbed during the driving process.

Infiltration Testing Procedure

The infiltration testing consisted of filling the inner ring and the annular space (the space between the inner and outer rings) with water, approximately 3 to 4 inches above the soil. To prevent the flow of water from one ring to the other, the water level in both the inner ring and the annular space between the rings was maintained using constant-head float valves. The volume of water that was added to maintain a constant head in the inner ring and the annular space during each time interval was determined and recorded. A cap was placed over the rings to minimize the evaporation of water during the tests.

Based on the observed infiltration rate at each test location, the volumetric measurements were made at increments of 15 minutes for Infiltration Test Nos. I-3 and I-4. The water volume measurements are presented on the spreadsheets enclosed with this report. The infiltration rates for each of the timed intervals are also tabulated on these spreadsheets.

The infiltration rates for the infiltration tests are calculated in centimeters per hour and then converted to inches per hour. The rates are summarized below:

<u>Infiltration Test No.</u>	<u>Depth (feet)</u>	<u>Soil Description</u>	<u>Infiltration Rate (inches/hour)</u>
I-1	10	Light Brown Silty fine to medium Sand to fine to medium Sandy Silt, trace coarse Sand, little Clay, little Calcareous nodules/veining	0.8
I-2	10	Light Brown fine to medium Sandy Silt, little Clay	0.9

Laboratory Testing

Moisture Content

The moisture contents for the recovered soil samples within the trenches were determined in accordance with ASTM D-2216 and are expressed as a percentage of the dry weight. These test results are presented on the Trench Logs.

Grain Size Analysis

The grain size distribution of selected soils collected from the base of each infiltration test location have been determined using a range of wire mesh screens. These tests were performed in general accordance with ASTM D-422 and/or ASTM D-1140. The weight of the portion of the sample retained on each screen is recorded and the percentage finer or coarser of the total weight is calculated. The results of these tests are presented on Plates C-1 and C-2 of this report.

Design Recommendations

Two (2) infiltration tests were performed at the subject site. As noted above, the calculated infiltration rates at the infiltration test locations range from 0.8 to 0.9 inches per hour. **Based on the results of infiltration testing, we recommend an infiltration rate of 0.8 inches per hour be used for the design of the proposed infiltration system located in the western region of the subject site, if the bottom of the infiltration system extends to a depth of 10± feet below the existing site grades.**

The design of storm water disposal systems should be performed by the project civil engineer, in accordance with the County of Riverside guidelines. It is recommended any such systems be designed and constructed to facilitate removal of silt and clay, or other deleterious materials from any water that may enter the system. The presence of such materials would decrease the flow rates through the system. It should be noted that the recommended infiltration rates are based on infiltration testing at two (2) discrete locations and that the overall infiltration rates of the proposed infiltration systems could vary considerably.

Infiltration Rate Considerations

The infiltration rates presented herein was determined in accordance with the Riverside County guidelines and are considered valid only for the time and place of the actual test. Varying subsurface conditions will exist in other areas of the site, which could alter the recommended infiltration rates presented above. The infiltration rates will decline over time between maintenance cycles as silt or clay particles accumulate on the BMP surface. The infiltration rate is highly dependent upon a number of factors, including density, silt and clay content, grainsize distribution throughout the range of particle sizes, and particle shape. Small changes in these factors can cause large changes in the infiltration rates.

Infiltration rates are based on unsaturated flow. As water is introduced into soils by infiltration, the soils become saturated and the wetting front advances from the unsaturated zone to the saturated zone. Once the soils become saturated, infiltration rates become zero, and water can only move through soils by hydraulic conductivity at a rate determined by pressure head and soil permeability. Changes in soil moisture content will affect the infiltration rate. Infiltration rates should be expected to decrease until the soils become saturated. Soil permeability values will then govern groundwater movement. Permeability values may be on the order of 10 to 20 times less than infiltration rates. The system designer should incorporate adequate factors of safety and allow for overflow design into appropriate traditional storm drain systems, which would transport storm water off-site.

Construction Considerations

The infiltration rates presented in this report are specific to the tested locations and tested depths. Infiltration rates can be significantly reduced if the soils are exposed to excessive disturbance or compaction during construction. Compaction of the soils at the bottom of the infiltration system can significantly reduce the infiltration ability of the chamber system. Therefore, the subgrade soils within the proposed infiltration system areas should not be over-excavated, undercut or compacted in any significant manner. **It is recommended that a note to this effect be added to the project plans and/or specifications.**

We recommend that a representative from the geotechnical engineer be on-site during the construction of the proposed infiltration system to identify the soil classification at the base of each system. It should be confirmed that the soils at the base of the proposed infiltration system correspond with those presented in this report to ensure that the performance of the system will be consistent with the rates reported herein.

We recommend that scrapers and other rubber-tired heavy equipment not be operated near the infiltration systems bottom, or at levels lower than 2 feet above the bottom of the system, particularly within basins. As such, the bottom 24 inches of the infiltration system should be excavated with non-rubber-tired equipment, such as excavators.

Infiltration Chamber Maintenance

The proposed project may include an infiltration chamber. Water flowing into chambers will carry some level of sediment. This layer has the potential to significantly reduce the infiltration rate of the chamber subgrade soils. Therefore, a formal chamber maintenance program should be established to ensure that these silt and clay deposits are removed from the chamber on a regular basis.

Location of Infiltration System

The use of on-site storm water infiltration systems carries a risk of creating adverse geotechnical conditions. Increasing the moisture content of the soil can cause the soil to lose internal shear strength and increase its compressibility, resulting in a change in the designed engineering properties. Overlying structures and pavements in the infiltration area could potentially be damaged due to saturation of the subgrade soils. **The proposed infiltration system for this site should be located at least 25 feet away from any structures, including retaining walls.** Even with this provision of locating the infiltration system at least 25 feet from the building(s), it is possible that infiltrating water into the subsurface soils could have an adverse effect on the proposed or existing structures. It should also be noted that utility trenches which happen to collect storm water can also serve as conduits to transmit storm water toward the structure, depending on the slope of the utility trench. Therefore, consideration should also be given to the proposed locations of underground utilities which may pass near the proposed infiltration system.

The infiltration system designer should also give special consideration to the effect that the proposed infiltration systems may have on nearby subterranean structures, open excavations, or descending slopes. In particular, infiltration systems should not be located near the crest of descending slopes, particularly where the slopes are comprised of granular soils. Such systems will require specialized design and analysis to evaluate the potential for slope instability, piping failures and other phenomena that typically apply to earthen dam design. This type of analysis is beyond the scope of this infiltration test report, but these factors should be considered by the infiltration system designer when locating the infiltration systems.

General Comments

This report has been prepared as an instrument of service for use by the client in order to aid in the evaluation of this property and to assist the architects and engineers in the design and preparation of the project plans and specifications. This report may be provided to the contractor(s) and other design consultants to disclose information relative to the project.

However, this report is not intended to be utilized as a specification in and of itself, without appropriate interpretation by the project architect, structural engineer, and/or civil engineer. The design of the proposed storm water infiltration system is the responsibility of the civil engineer. The role of the geotechnical engineer is limited to determination of infiltration rate only. By using the design infiltration rate contained herein, the civil engineer agrees to indemnify, defend, and hold harmless the geotechnical engineer for all aspects of the design and performance of the proposed storm water infiltration system. The reproduction and distribution of this report must be authorized by the client and Southern California Geotechnical, Inc. Furthermore, any reliance on this report by an unauthorized third party is at such party's sole risk, and we accept no responsibility for damage or loss which may occur.

The analysis of this site was based on a subsurface profile interpolated from limited discrete soil samples. While the materials encountered in the project area are considered to be representative of the total area, some variations should be expected between boring locations and testing depths. If the conditions encountered during construction vary significantly from those detailed herein, we should be contacted immediately to determine if the conditions alter the recommendations contained herein.

This report has been based on assumed or provided characteristics of the proposed development. It is recommended that the owner, client, architect, structural engineer, and civil engineer carefully review these assumptions to ensure that they are consistent with the characteristics of the proposed development. If discrepancies exist, they should be brought to our attention to verify that they do not affect the conclusions and recommendations contained herein. We also recommend that the project plans and specifications be submitted to our office for review to verify that our recommendations have been correctly interpreted. The analysis, conclusions, and recommendations contained within this report have been promulgated in accordance with generally accepted professional geotechnical engineering practice. No other warranty is implied or expressed.

Closure

We sincerely appreciate the opportunity to be of service on this project. We look forward to providing additional consulting services during the course of the project. If we may be of further assistance in any manner, please contact our office.

Respectfully Submitted,

SOUTHERN CALIFORNIA GEOTECHNICAL, INC.



Ryan Bremer
Staff Geologist




Robert G. Trazo, GE 2655
Principal Engineer



Distribution: (1) Addressee


Enclosures: Plate 1 - Site Location Map
Plate 2 - Infiltration Test Location Plan
Trench Log Legend and Logs (4 pages)
Infiltration Test Results Spreadsheets (2 pages)
Grain Size Distribution Graphs (2 pages)

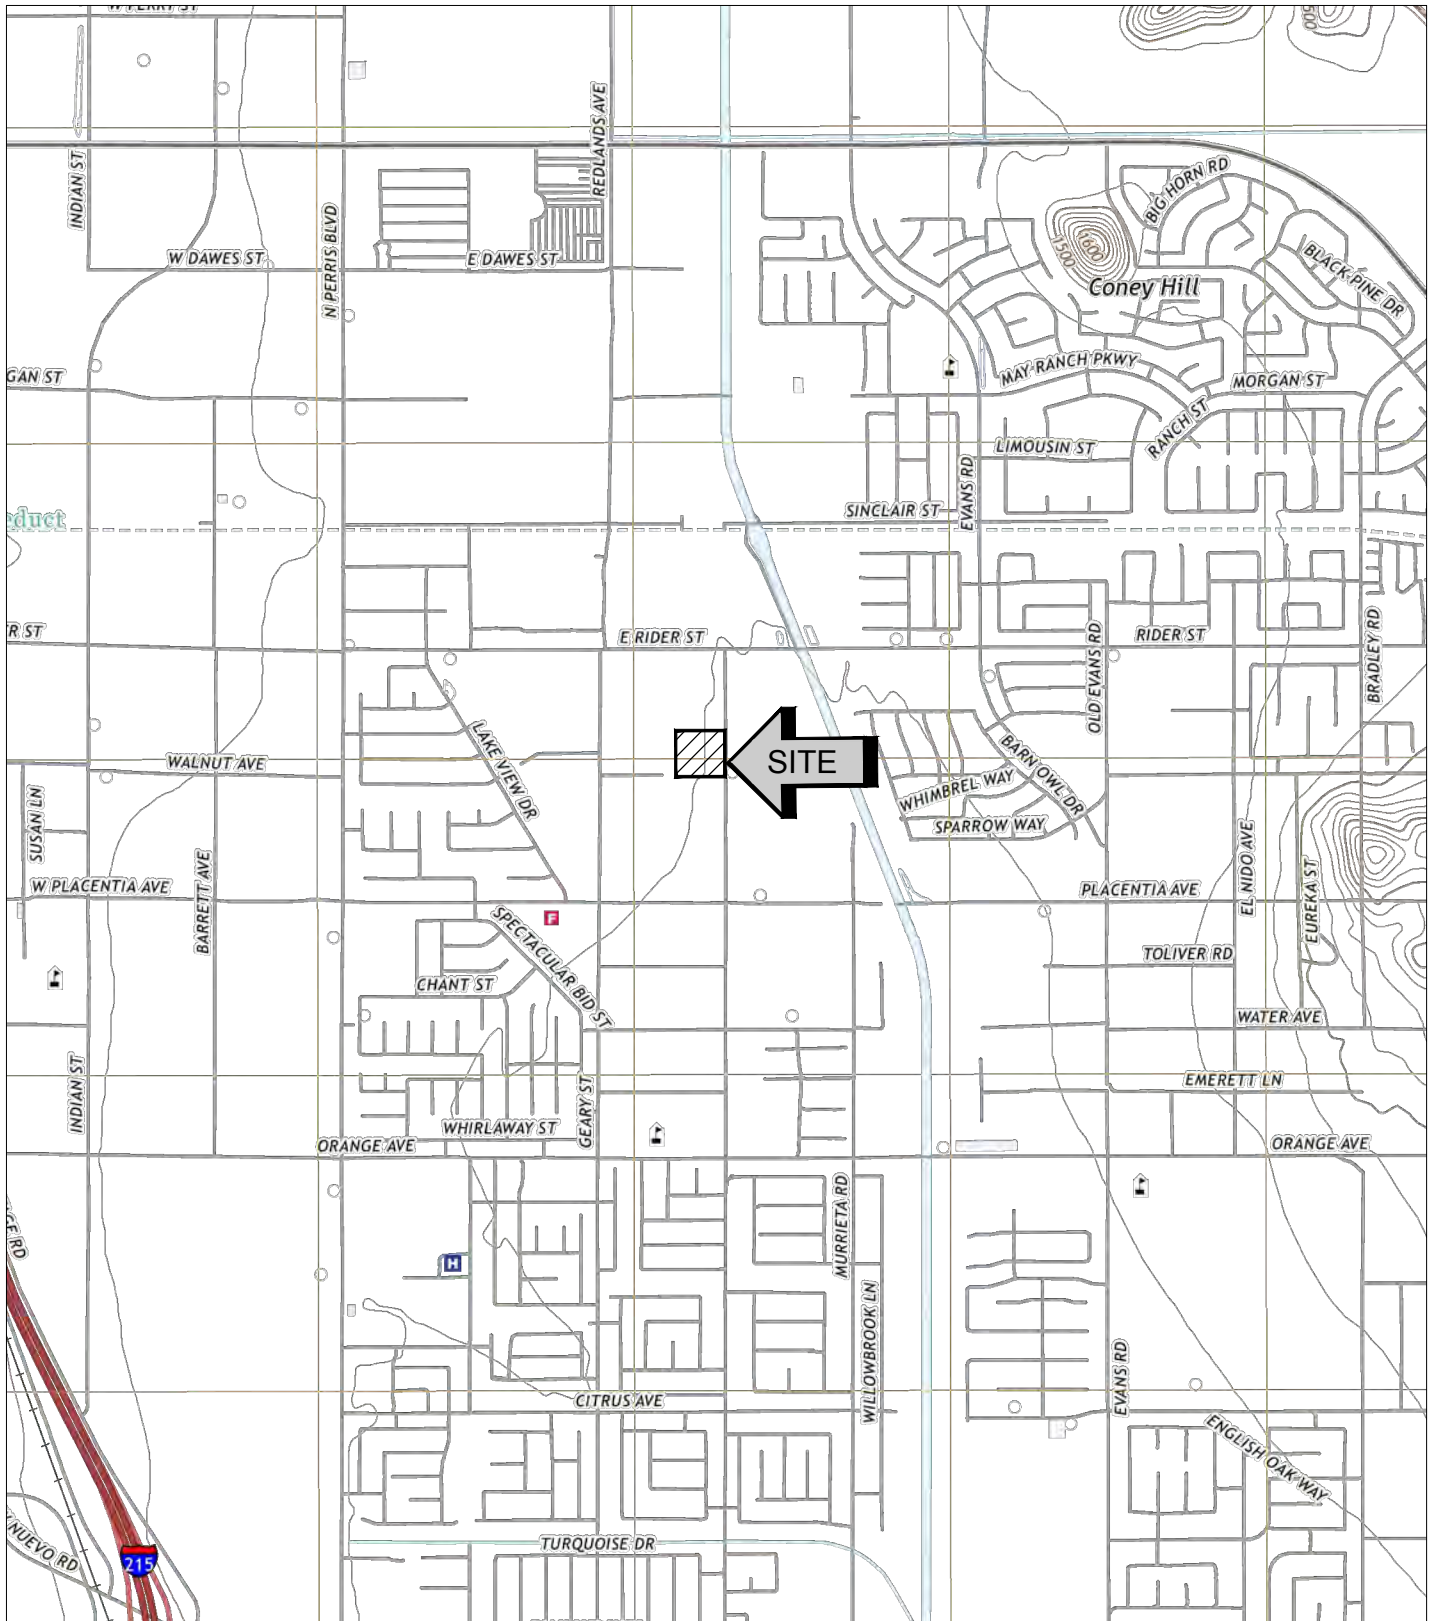



SOURCE: USGS TOPOGRAPHIC MAP OF THE PERRIS QUADRANGLE, RIVERSIDE COUNTY, CALIFORNIA, 2018.






SITE LOCATION MAP	
PROPOSED COMMERCIAL/INDUSTRIAL BUILDING	
PERRIS, CALIFORNIA	
SCALE: 1" = 2000'	 SOUTHERN CALIFORNIA GEOTECHNICAL
DRAWN: RB	
CHKD: RGT	
SCG PROJECT 21G206-4	
PLATE 1	

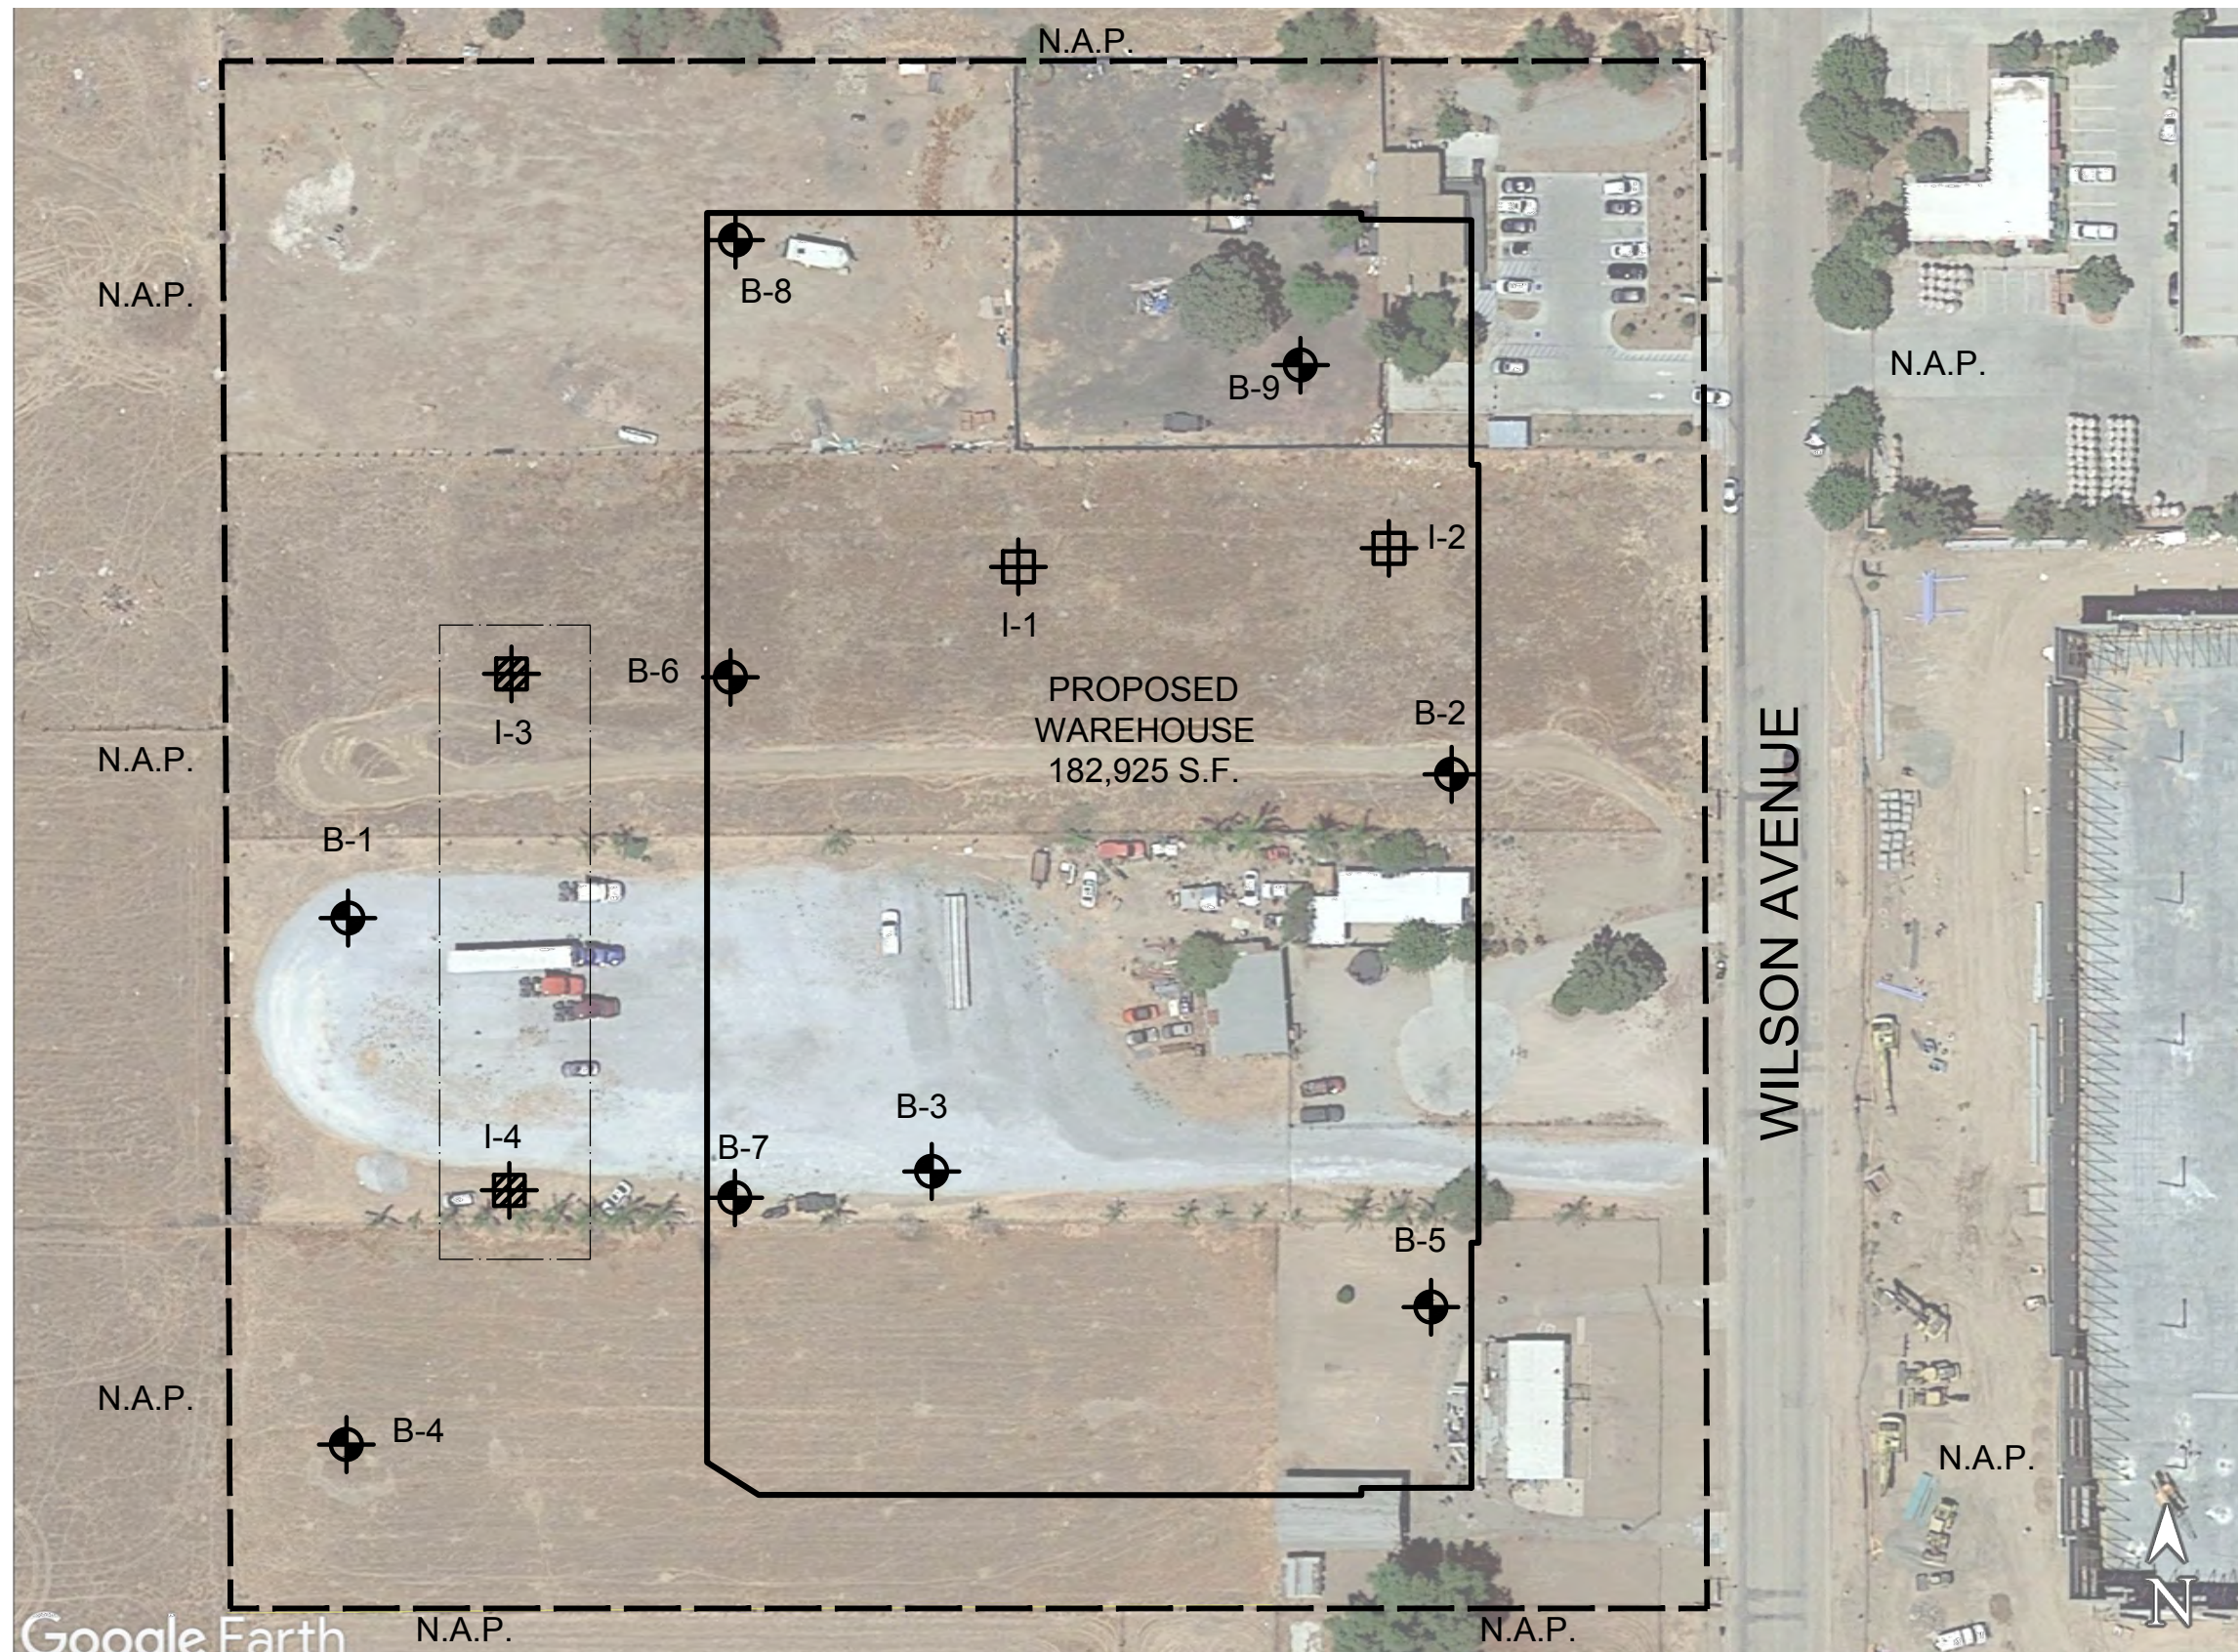

GEOTECHNICAL LEGEND

-  APPROXIMATE INFILTRATION TEST LOCATION
-  PREVIOUS BORING LOCATION (SCG PROJECT NO. 21G206-3)









-  PREVIOUS INFILTRATION TEST LOCATION (SCG PROJECT NO. 21G206-2)
-  APPROXIMATE INFILTRATION SYSTEM LOCATION
-  PROPERTY LINE



NOTE: AIR PHOTO OBTAINED FROM GOOGLE EARTH
SITE PLAN PROVIDED BY RGA.

INFILTRATION TEST LOCATION PLAN	
PROPOSED COMMERCIAL/INDUSTRIAL BUILDING PERRIS, CALIFORNIA	
SCALE: 1" = 80'	
DRAWN: RB CHKD: RGT	
SCG PROJECT 21G206-4	
PLATE 2	SOUTHERN CALIFORNIA GEOTECHNICAL

TRENCH LOG LEGEND

SAMPLE TYPE	GRAPHICAL SYMBOL	SAMPLE DESCRIPTION
AUGER		SAMPLE COLLECTED FROM AUGER CUTTINGS, NO FIELD MEASUREMENT OF SOIL STRENGTH. (DISTURBED)
CORE		ROCK CORE SAMPLE: TYPICALLY TAKEN WITH A DIAMOND-TIPPED CORE BARREL. TYPICALLY USED ONLY IN HIGHLY CONSOLIDATED BEDROCK.
GRAB		SOIL SAMPLE TAKEN WITH NO SPECIALIZED EQUIPMENT, SUCH AS FROM A STOCKPILE OR THE GROUND SURFACE. (DISTURBED)
CS		CALIFORNIA SAMPLER: 2-1/2 INCH I.D. SPLIT BARREL SAMPLER, LINED WITH 1-INCH HIGH BRASS RINGS. DRIVEN WITH SPT HAMMER. (RELATIVELY UNDISTURBED)
NSR		NO RECOVERY: THE SAMPLING ATTEMPT DID NOT RESULT IN RECOVERY OF ANY SIGNIFICANT SOIL OR ROCK MATERIAL.
SPT		STANDARD PENETRATION TEST: SAMPLER IS A 1.4 INCH INSIDE DIAMETER SPLIT BARREL, DRIVEN 18 INCHES WITH THE SPT HAMMER. (DISTURBED)
SH		SHELBY TUBE: TAKEN WITH A THIN WALL SAMPLE TUBE, PUSHED INTO THE SOIL AND THEN EXTRACTED. (UNDISTURBED)
VANE		VANE SHEAR TEST: SOIL STRENGTH OBTAINED USING A 4 BLADED SHEAR DEVICE. TYPICALLY USED IN SOFT CLAYS-NO SAMPLE RECOVERED.

COLUMN DESCRIPTIONS

DEPTH:

Distance in feet below the ground surface.

SAMPLE:

Sample Type as depicted above.

BLOW COUNT:

Number of blows required to advance the sampler 12 inches using a 140 lb hammer with a 30-inch drop. 50/3" indicates penetration refusal (>50 blows) at 3 inches. WH indicates that the weight of the hammer was sufficient to push the sampler 6 inches or more.

POCKET PEN.:

Approximate shear strength of a cohesive soil sample as measured by pocket penetrometer.

GRAPHIC LOG:

Graphic Soil Symbol as depicted on the following page.

DRY DENSITY:

Dry density of an undisturbed or relatively undisturbed sample in lbs/ft³.

MOISTURE CONTENT:

Moisture content of a soil sample, expressed as a percentage of the dry weight.

LIQUID LIMIT:

The moisture content above which a soil behaves as a liquid.

PLASTIC LIMIT:

The moisture content above which a soil behaves as a plastic.

PASSING #200 SIEVE:

The percentage of the sample finer than the #200 standard sieve.

UNCONFINED SHEAR:

The shear strength of a cohesive soil sample, as measured in the unconfined state.

SOIL CLASSIFICATION CHART

MAJOR DIVISIONS			SYMBOLS		TYPICAL DESCRIPTIONS	
			GRAPH	LETTER		
<p>COARSE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS LARGER THAN NO. 200 SIEVE SIZE</p>	<p>GRAVEL AND GRAVELLY SOILS</p>	<p>CLEAN GRAVELS</p> <p>(LITTLE OR NO FINES)</p>		GW	WELL-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES	
		<p>MORE THAN 50% OF COARSE FRACTION RETAINED ON NO. 4 SIEVE</p>	<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GP	POORLY-GRADED GRAVELS, GRAVEL - SAND MIXTURES, LITTLE OR NO FINES
			<p>GRAVELS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		GM	SILTY GRAVELS, GRAVEL - SAND - SILT MIXTURES
		<p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>	<p>CLEAN SANDS</p> <p>(LITTLE OR NO FINES)</p>		SW	WELL-GRADED SANDS, GRAVELLY SANDS, LITTLE OR NO FINES
	<p>MORE THAN 50% OF COARSE FRACTION PASSING ON NO. 4 SIEVE</p>		<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SP	POORLY-GRADED SANDS, GRAVELLY SAND, LITTLE OR NO FINES
		<p>SANDS WITH FINES</p> <p>(APPRECIABLE AMOUNT OF FINES)</p>		SM	SILTY SANDS, SAND - SILT MIXTURES	
	<p>FINE GRAINED SOILS</p> <p>MORE THAN 50% OF MATERIAL IS SMALLER THAN NO. 200 SIEVE SIZE</p>	<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT LESS THAN 50</p>		ML	INORGANIC SILTS AND VERY FINE SANDS, ROCK FLOUR, SILTY OR CLAYEY FINE SANDS OR CLAYEY SILTS WITH SLIGHT PLASTICITY	
				CL	INORGANIC CLAYS OF LOW TO MEDIUM PLASTICITY, GRAVELLY CLAYS, SANDY CLAYS, SILTY CLAYS, LEAN CLAYS	
				OL	ORGANIC SILTS AND ORGANIC SILTY CLAYS OF LOW PLASTICITY	
		<p>SILTS AND CLAYS</p> <p>LIQUID LIMIT GREATER THAN 50</p>		MH	INORGANIC SILTS, MICACEOUS OR DIATOMACEOUS FINE SAND OR SILTY SOILS	
			CH	INORGANIC CLAYS OF HIGH PLASTICITY		
			OH	ORGANIC CLAYS OF MEDIUM TO HIGH PLASTICITY, ORGANIC SILTS		
<p>HIGHLY ORGANIC SOILS</p>				PT	PEAT, HUMUS, SWAMP SOILS WITH HIGH ORGANIC CONTENTS	

NOTE: DUAL SYMBOLS ARE USED TO INDICATE BORDERLINE SOIL CLASSIFICATIONS



JOB NO.: 21G206-4 EXCAVATION DATE: 1/19/22 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building EXCAVATION METHOD: Backhoe CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Caleb Brackett READING TAKEN: At Completion

FIELD RESULTS					DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)	GRAPHIC LOG		DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
SURFACE ELEVATION: MSL												
					FILL: Red Brown Silty fine to medium Sand, trace Clay, trace fine root fibers, loose-damp							
5					ALLUVIUM: Light Brown Silty fine to medium Sand to fine to medium Sandy Silt, trace coarse Sand, little Clay, little Calcareous veining, very dense-damp							
10						6			42			
					Trench Terminated at 10'							

TBL_21G206-4 (TRENCHES).GPJ_SOCALGEO.GDT_2/22/22



JOB NO.: 21G206-4 EXCAVATION DATE: 1/19/22 WATER DEPTH: Dry
 PROJECT: Proposed Commercial/Industrial Building EXCAVATION METHOD: Backhoe CAVE DEPTH: ---
 LOCATION: Perris, California LOGGED BY: Caleb Brackett READING TAKEN: At Completion

FIELD RESULTS				GRAPHIC LOG	DESCRIPTION	LABORATORY RESULTS						COMMENTS
DEPTH (FEET)	SAMPLE	BLOW COUNT	POCKET PEN. (TSF)			DRY DENSITY (PCF)	MOISTURE CONTENT (%)	LIQUID LIMIT	PLASTIC LIMIT	PASSING #200 SIEVE (%)	ORGANIC CONTENT (%)	
					SURFACE ELEVATION: MSL <u>PAVEMENT</u> : 2± inches of open-graded Gravel <u>ALLUVIUM</u> : Light Brown fine to medium Sandy Silt, little Clay, dense-damp to moist							
5												
10					Trench Terminated at 10'		11			63		

TBL_21G206-4 (TRENCHES).GPJ_SOCALGEO.GDT 2/22/22

INFILTRATION CALCULATIONS

Project Name	Proposed Commercial/Industrial Building
Project Location	Perris, California
Project Number	21G206-4
Engineer	Caleb Brackett

Infiltration Test No I-3

Constants			
	Diameter (ft)	Area (ft ²)	Area (cm ²)
Inner	1	0.785	730
Anlr. Space	2	2.356	2189

*Note: The infiltration rate was calculated based on current time interval

Test Interval		Time (hr)	Interval Elapsed (min)	Flow Readings				Infiltration Rates			
				Inner Ring (ml)	Ring Flow (cm ³)	Annular Ring (ml)	Space Flow (cm ³)	Inner Ring* (cm/hr)	Annular Space* (cm/hr)	Inner Ring* (in/hr)	Annular Space* (in/hr)
1	Initial	10:47 AM	15	0	800	0	2400	4.39	4.39	1.73	1.73
	Final	11:02 AM	15	800		2400					
2	Initial	11:02 AM	15	0	450	0	1400	2.47	2.56	0.97	1.01
	Final	11:17 AM	30	450		1400					
3	Initial	11:17 AM	15	0	400	0	1600	2.19	2.92	0.86	1.15
	Final	11:32 AM	45	400		1600					
4	Initial	11:32 AM	15	0	400	0	1400	2.19	2.56	0.86	1.01
	Final	11:47 AM	60	400		1400					
5	Initial	11:47 AM	15	0	350	0	1300	1.92	2.38	0.76	0.94
	Final	12:02 PM	75	350		1300					
6	Initial	12:02 PM	15	0	350	0	1600	1.92	2.92	0.76	1.15
	Final	12:17 PM	90	350		1600					

INFILTRATION CALCULATIONS

Project Name	Proposed Commercial/Industrial Building
Project Location	Perris, California
Project Number	21G206-4
Engineer	Caleb Brackett


Infiltration Test No I-4

Constants			
	Diameter (ft)	Area (ft ²)	Area (cm ²)
Inner	1	0.785	730
Anlr. Space	2	2.356	2189

*Note: The infiltration rate was calculated based on current time interval

Test Interval		Time (hr)	Interval Elapsed (min)	Flow Readings				Infiltration Rates			
				Inner Ring (ml)	Ring Flow (cm ³)	Annular Ring (ml)	Space Flow (cm ³)	Inner Ring* (cm/hr)	Annular Space* (cm/hr)	Inner Ring* (in/hr)	Annular Space* (in/hr)
1	Initial	8:46 AM	15	0	950	0	2400	5.21	4.39	2.05	1.73
	Final	9:01 AM	15	950		2400					
2	Initial	9:01 AM	15	0	850	0	1400	4.66	2.56	1.83	1.01
	Final	9:16 AM	30	850		1400					
3	Initial	9:16 AM	15	0	650	0	1600	3.56	2.92	1.40	1.15
	Final	9:31 AM	45	650		1600					
4	Initial	9:31 AM	15	0	600	0	1400	3.29	2.56	1.30	1.01
	Final	9:46 AM	60	600		1400					
5	Initial	9:46 AM	15	0	400	0	1300	2.19	2.38	0.86	0.94
	Final	10:01 AM	75	400		1300					
6	Initial	10:01 AM	15	0	450	0	1600	2.47	2.92	0.97	1.15
	Final	10:16 AM	90	450		1600					
7	Initial	10:16 AM	15	0	400	0	1350	2.19	2.47	0.86	0.97
	Final	10:31 AM	105	400		1350					

Grain Size Distribution

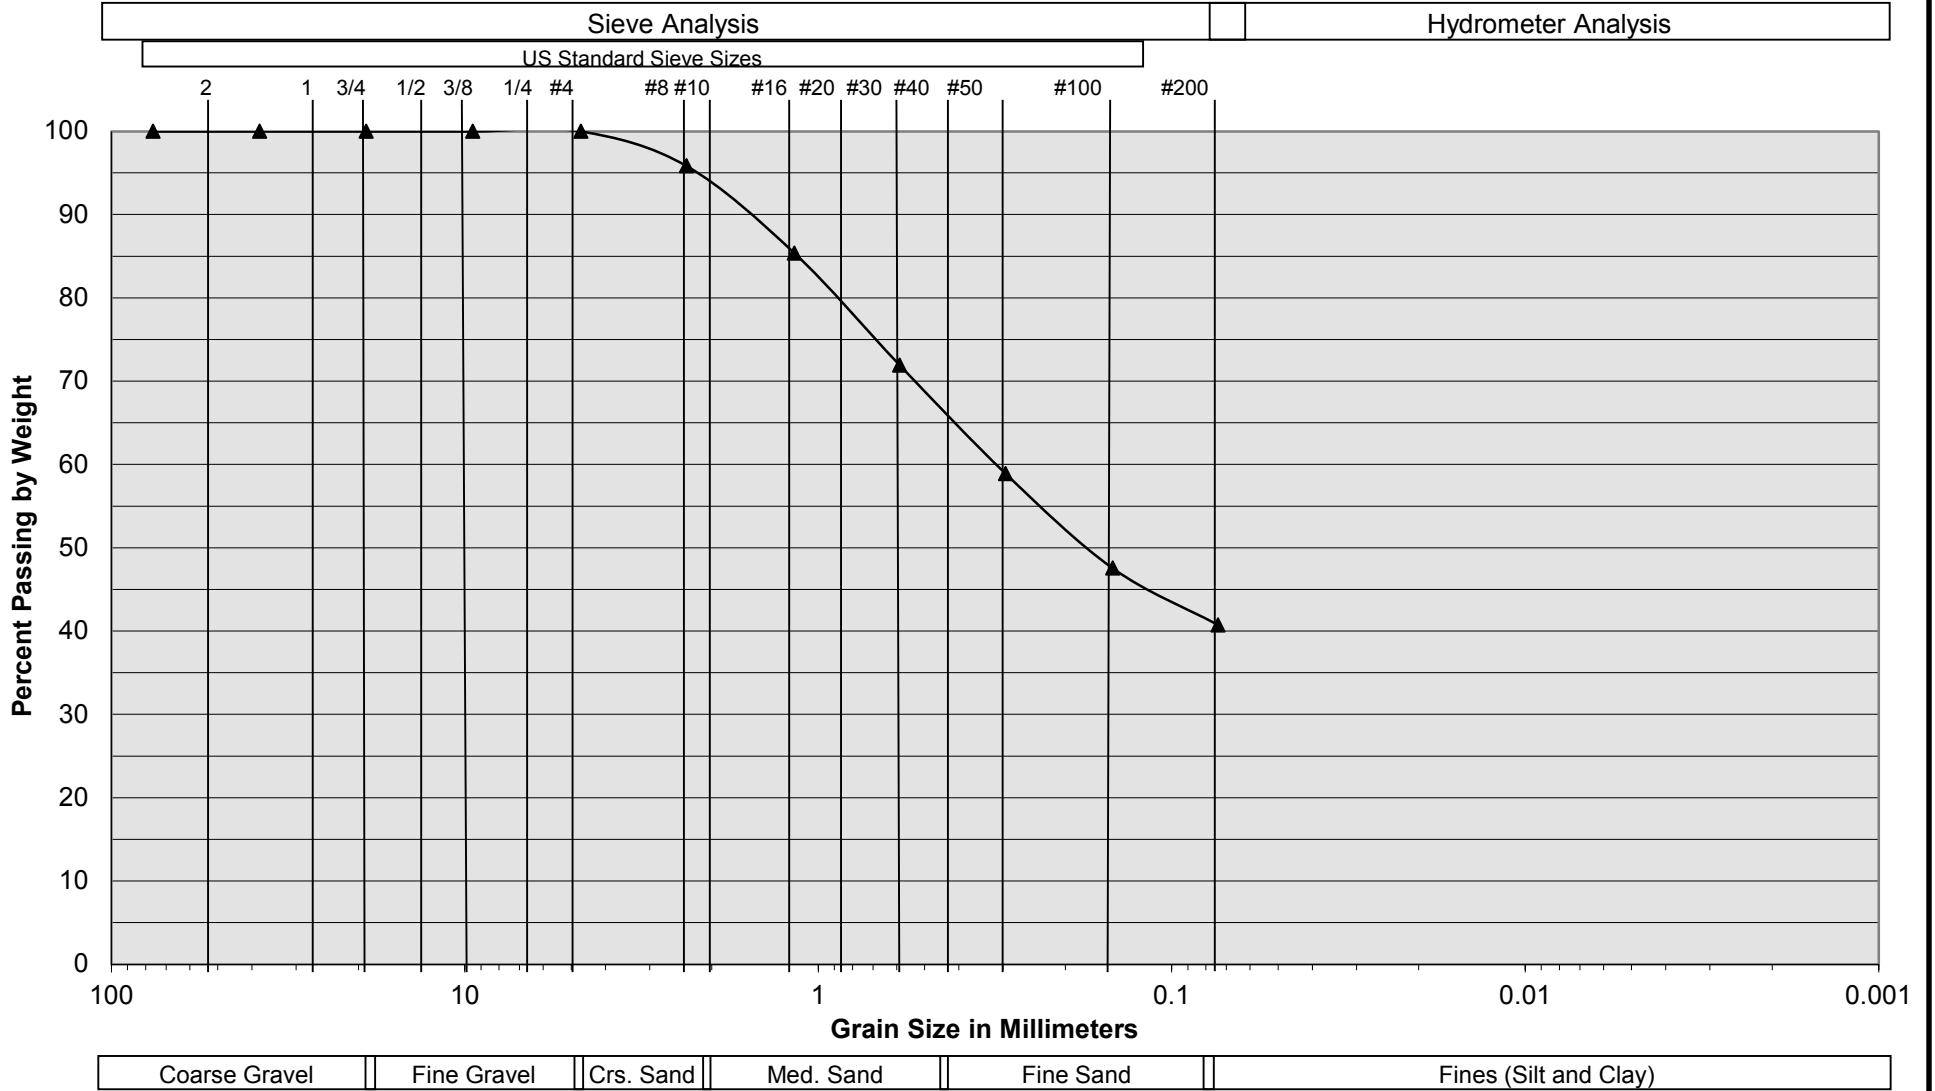


Sample Description	I-3 @ 9-10'
Soil Classification	ALLUVIUM: Light Brown Silty fine to medium Sand to fine to medium Sandy Silt, trace coarse Sand, little Clay

Proposed Commercial/Industrial Building
 Perris, California
 Project No. 21G206-4
PLATE C- 1




SOUTHERN CALIFORNIA GEOTECHNICAL
A California Corporation

Grain Size Distribution

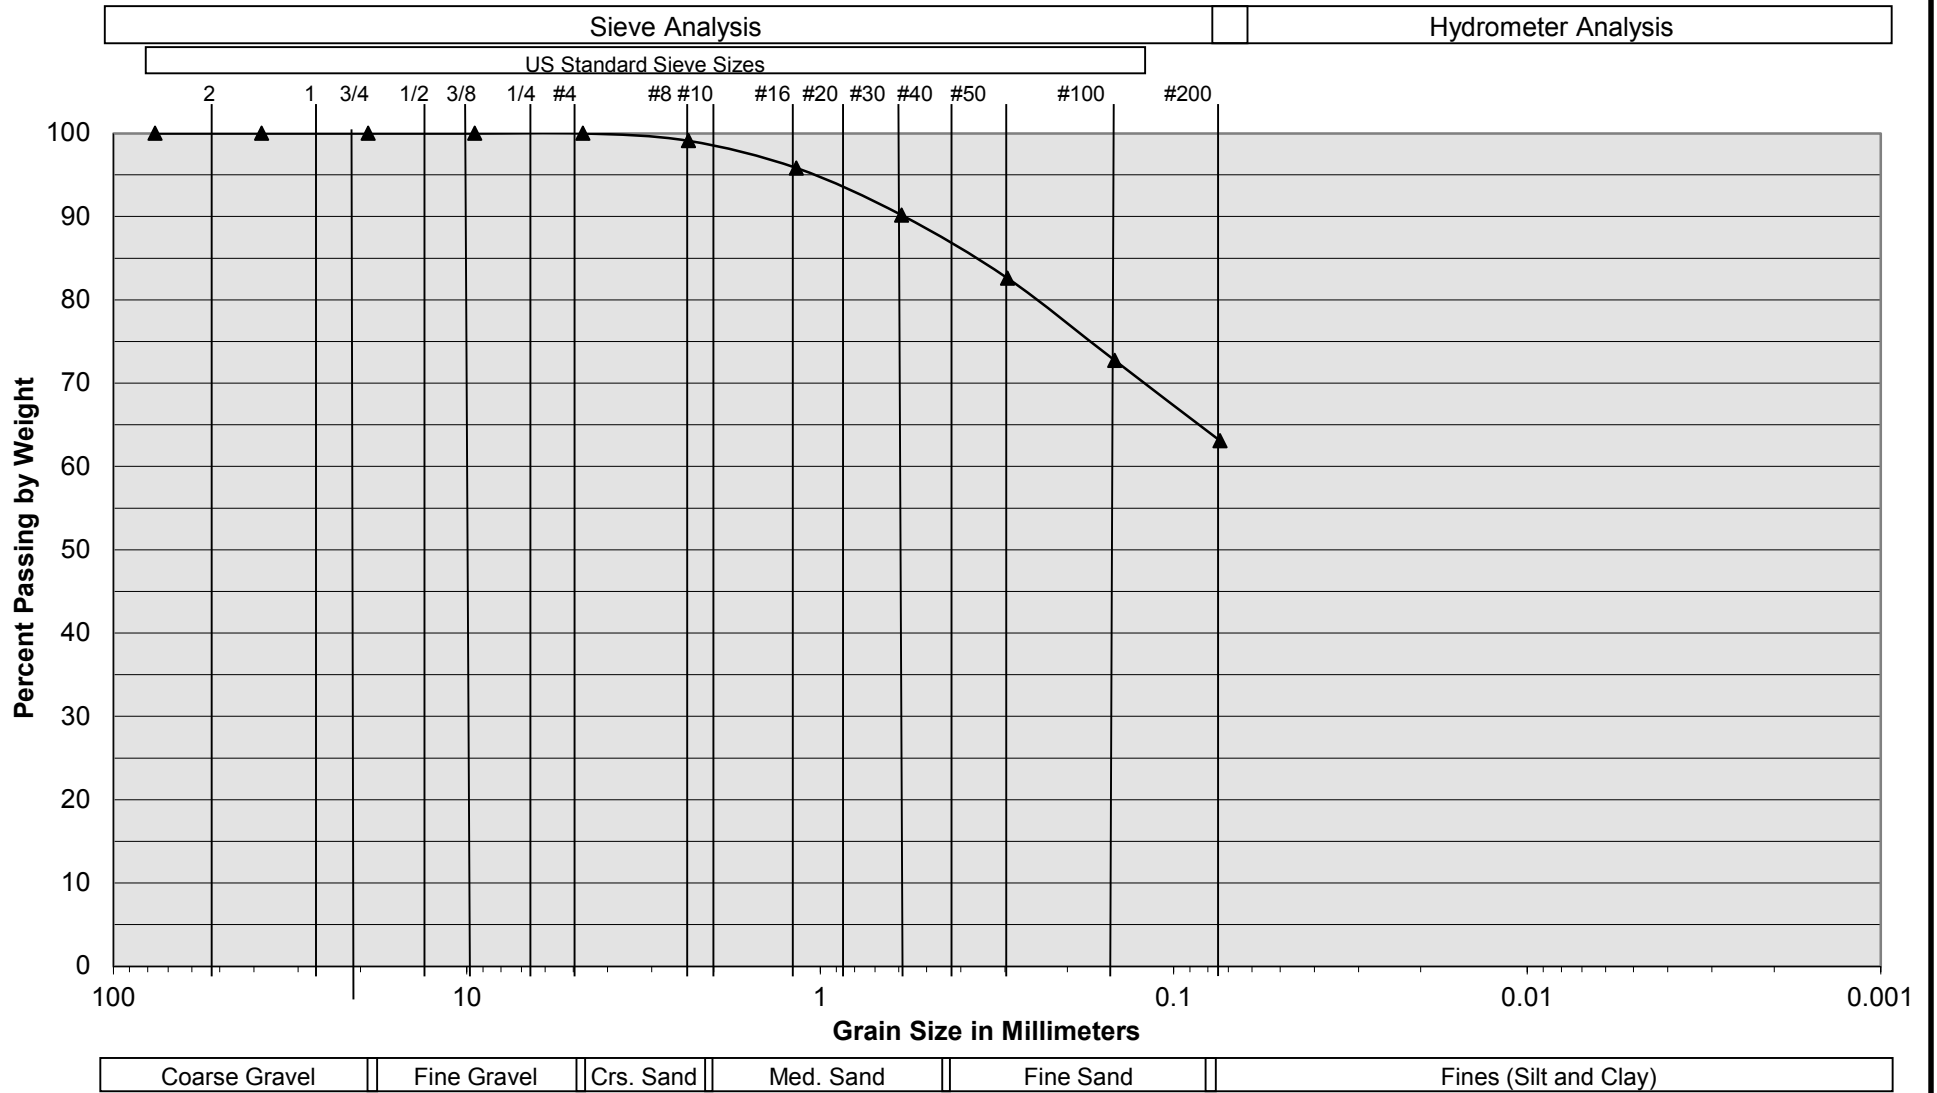

Sample Description	I-4 @ 9-10'
Soil Classification	ALLUVIUM: Light Brown fine to medium Sandy Silt, little Clay

Proposed Commercial/Industrial Building Perris, California Project No. 21G206-4 PLATE C- 2		 SOUTHERN CALIFORNIA GEOTECHNICAL <i>A California Corporation</i>
--	--	--

Appendix 4: Historical Site Conditions

Phase I Environmental Site Assessment or Other Information on Past Site Use

Not Applicable


Appendix 5: LID Infeasibility

LID Technical Infeasibility Analysis

Not Applicable

Appendix 6: BMP Design Details

BMP Sizing, Design Details and other Supporting Documentation

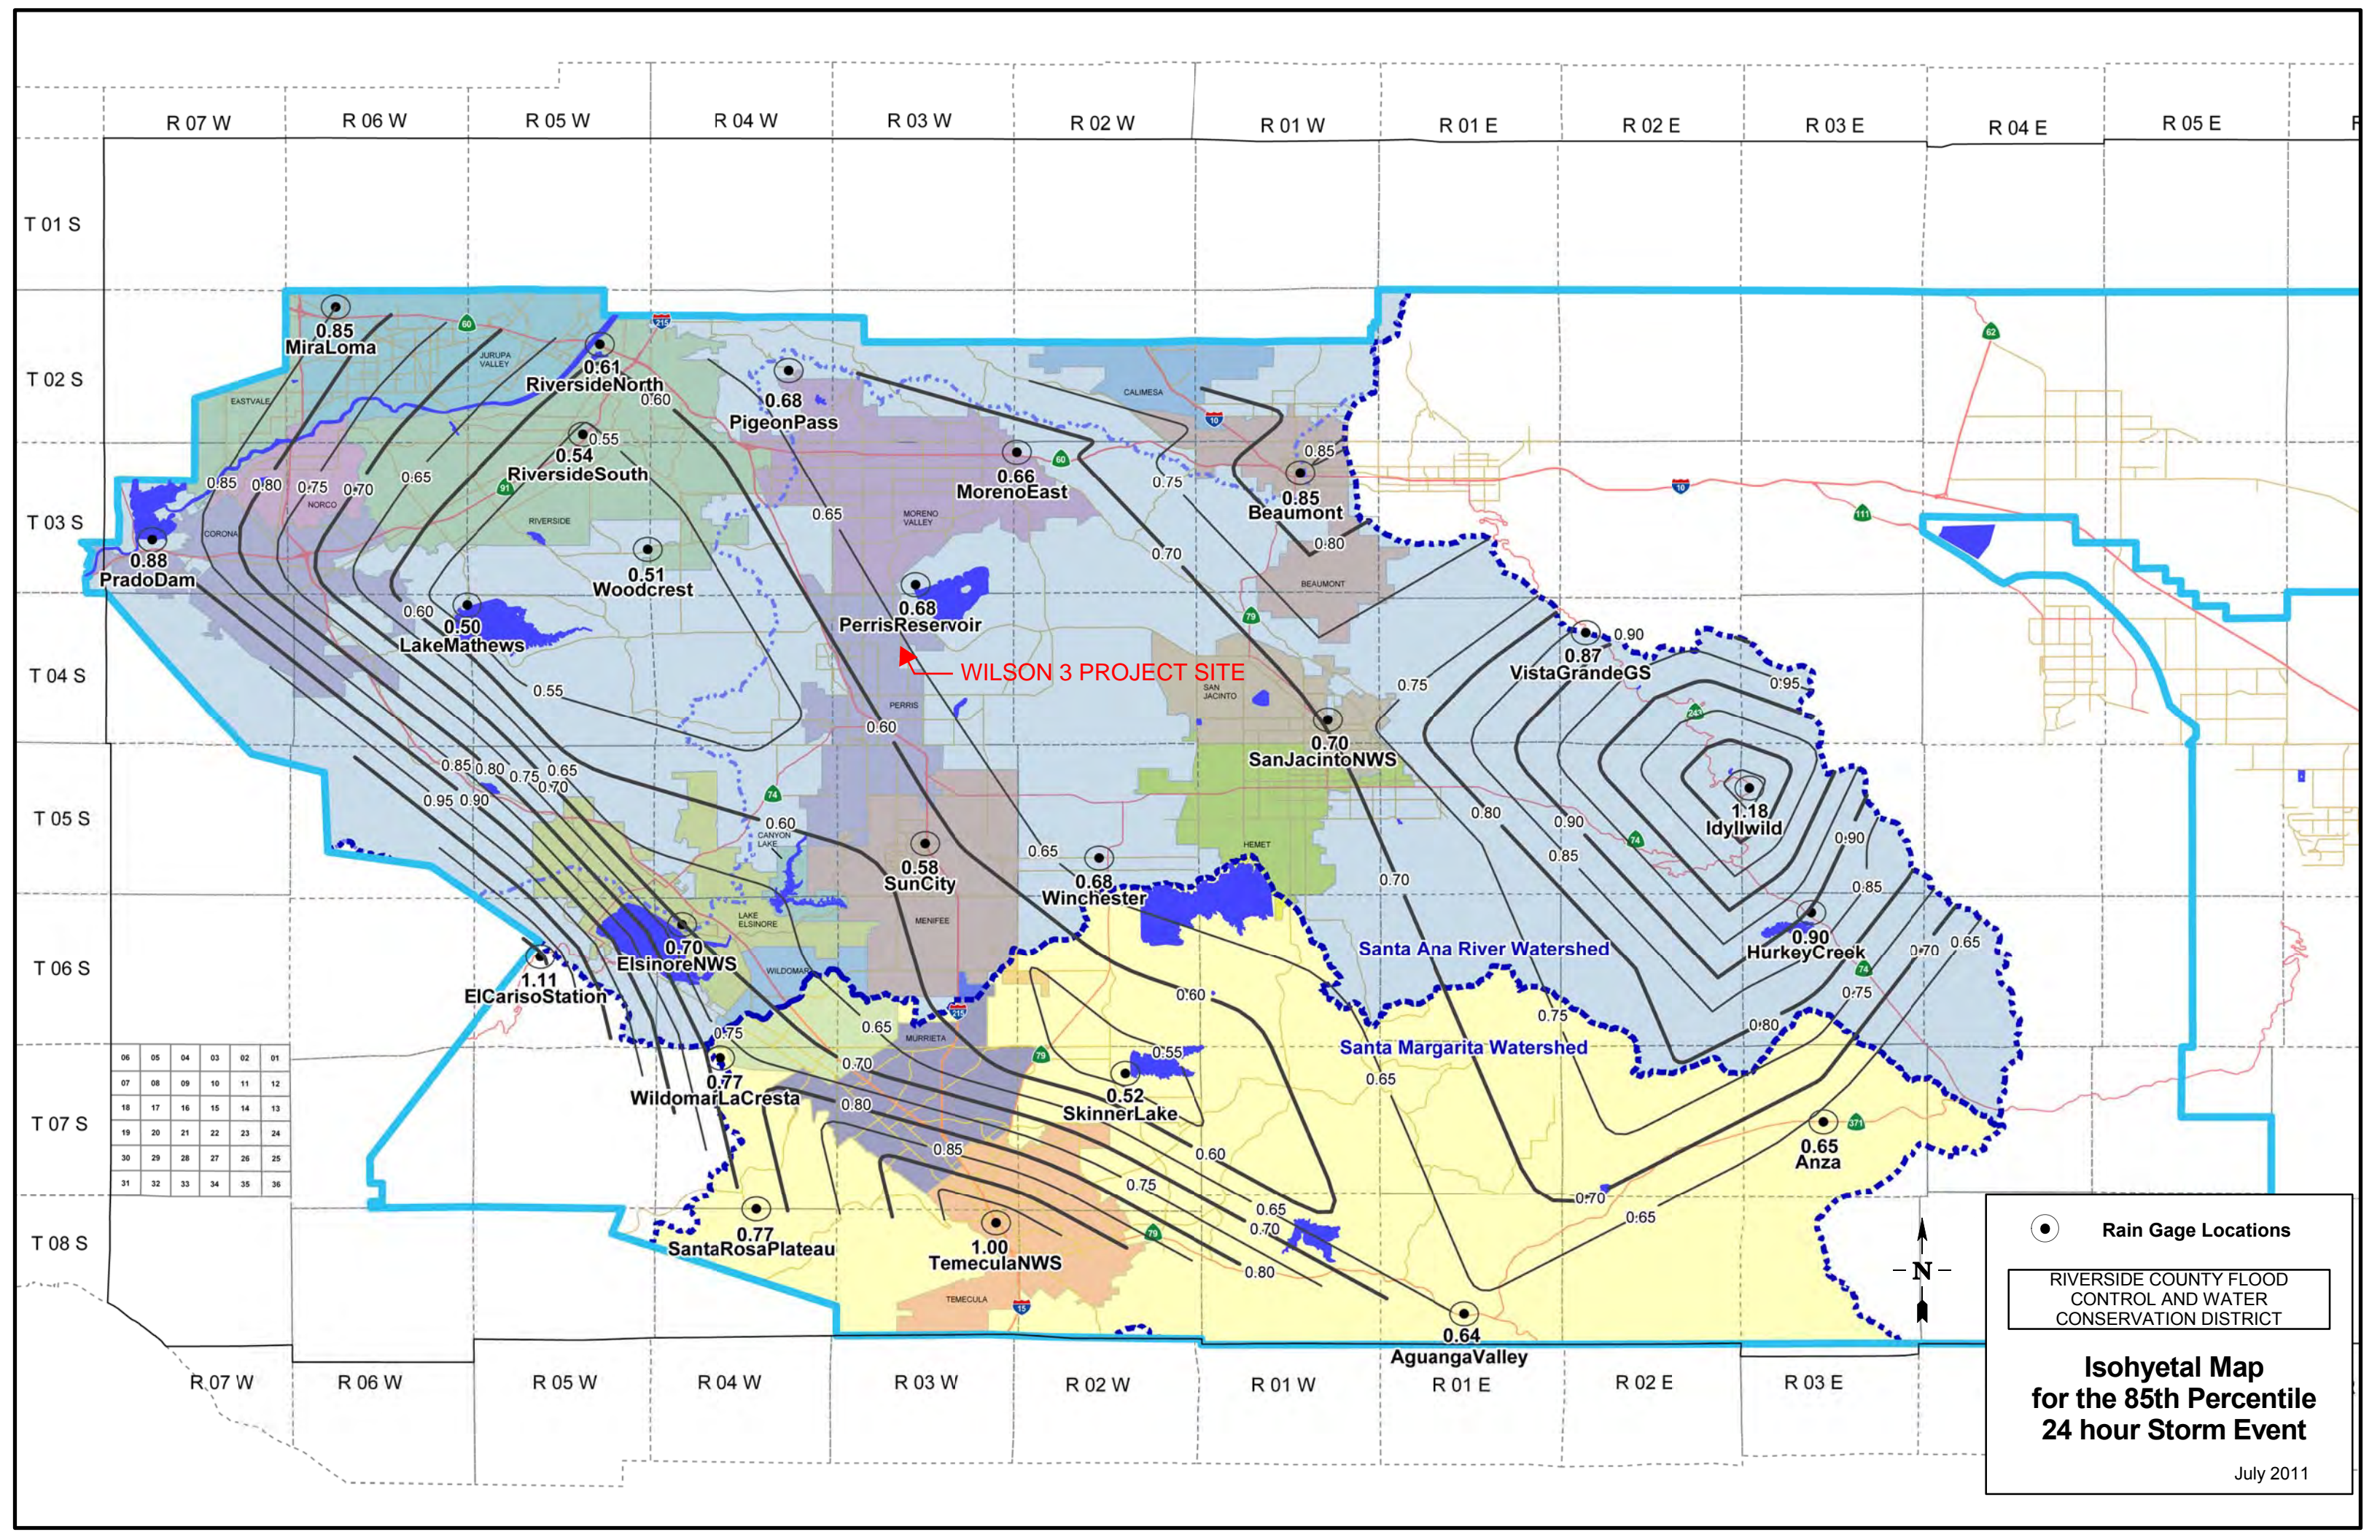

WILSON 3 PROJECT SITE

06	05	04	03	02	01
07	08	09	10	11	12
18	17	16	15	14	13
19	20	21	22	23	24
30	29	28	27	26	25
31	32	33	34	35	36

Rain Gage Locations

RIVERSIDE COUNTY FLOOD CONTROL AND WATER CONSERVATION DISTRICT

Isohyetal Map for the 85th Percentile 24 hour Storm Event

July 2011

Santa Ana Watershed - BMP Design Volume, V_{BMP}

(Rev. 10-2011)

Legend:



Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name **Albert A. Webb Associates**

Date **5/27/2022**

Designed by **RSB**

Case No **P22-00017**

Company Project Number/Name

FIR Wilson 3

BMP Identification

BMP NAME / ID **BMP-A**

Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

85th Percentile, 24-hour Rainfall Depth,
from the Isohyetal Map in Handbook Appendix E

$D_{85} =$ **0.65** inches

Drainage Management Area Tabulation


Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type	Effective Imperivous Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Storm Depth (in)	Design Capture Volume, V_{BMP} (cubic feet)	Proposed Volume on Plans (cubic feet)
L-A	28,055	Ornamental Landscaping	0.1	0.11	3098.9			
H-A	179,185	Concrete or Asphalt	1	0.89	159833			
R-A	188,337	Roofs	1	0.89	167996.6			
SR-A	18,039	Ornamental Landscaping	0.1	0.11	1992.6			
	413616	Total			332921.1	0.65	18033.2	18064

Notes:

The "Proposed Volume on Plans" comes from the Contech detention system sizing worksheet.

For design assistance, drawings,
and pricing send completed worksheet to:
dyods@contech-cpi.com

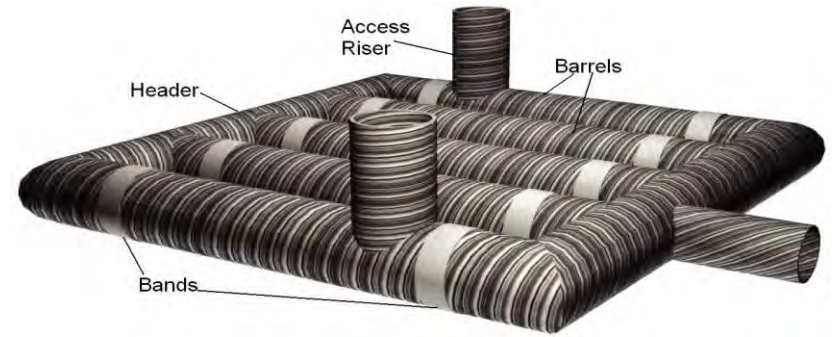

Project Summary


Date:	9/13/2022
Project Name:	FIR Wilson 3
City / County:	Perris
State:	CA
Designed By:	RSB
Company:	Albert A. Webb Associates
Telephone:	(951) 686-1070

Enter Information in
Blue Cells

Corrugated Metal Pipe Calculator

Storage Volume Required (cf):	18,033
Limiting Width (ft):	25.00
Invert Depth Below Asphalt (ft):	12.21
Solid or Perforated Pipe:	Perforated
Shape Or Diameter (in):	120
Number Of Headers:	2
Spacing between Barrels (ft):	3.00
Stone Width Around Perimeter of System (ft):	2
Depth A: Porous Stone Above Pipe (in):	0
Depth C: Porous Stone Below Pipe (in):	6
Stone Porosity (0 to 40%):	0


78.54 ft² Pipe Area

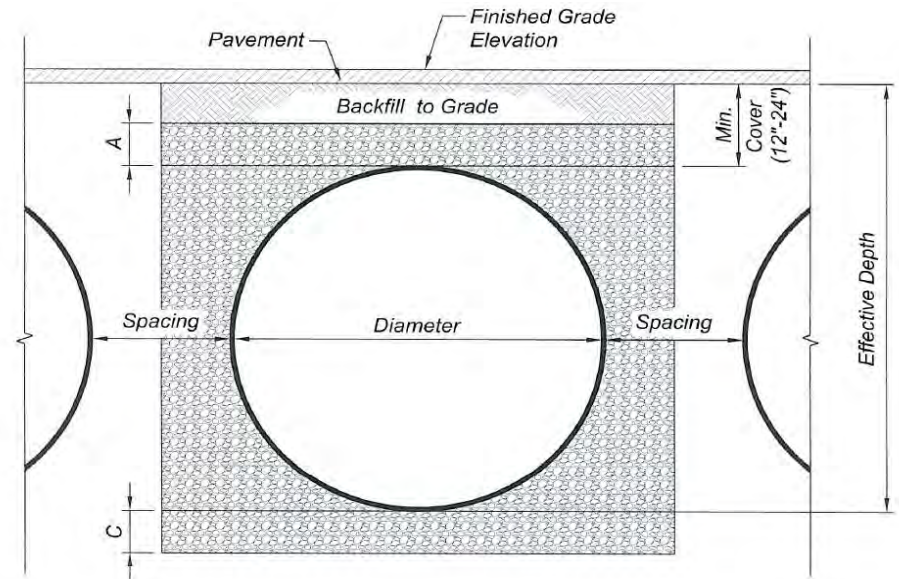

System Sizing

Pipe Storage:	18,064 cf	
Porous Stone Storage:	0 cf	
Total Storage Provided:	18,064 cf	100.2% Of Required Storage
Number of Barrels:	1 barrels	
Length per Barrel:	210.0 ft	
Length Per Header:	10.0 ft	
Rectangular Footprint (W x L):	14. ft x 234. ft	

System Layout

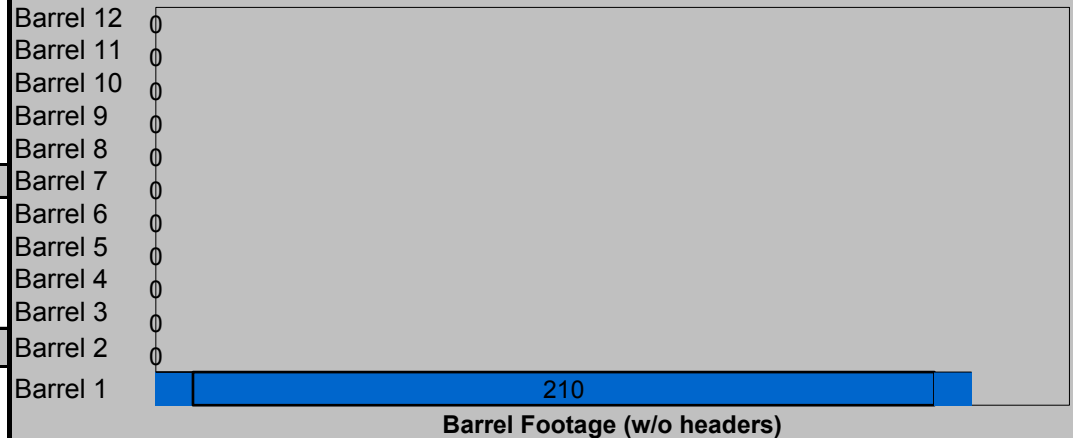

CONTECH Materials

Total CMP Footage:	230 ft
Approximate Total Pieces:	13 pcs
Approximate Coupling Bands:	12 bands
Approximate Truckloads:	7 trucks

Construction Quantities**

Total Excavation:	1482 cy
Porous Stone Backfill For Storage:	605 cy stone
Backfill to Grade Excluding Stone:	208 cy fill

**Construction quantities are approximate and should be verified upon final design

Santa Ana Watershed - BMP Design Flow Rate, Q_{BMP}

(Rev. 10-2011)

Legend:

Required Entries

Calculated Cells

*(Note this worksheet shall **only** be used in conjunction with BMP designs from the **LID BMP Design Handbook**)*

Company Name **Albert A. Webb Associates**

Date **5/27/2022**

Designed by **RSB**

Case No **P22-00017**

Company Project Number/Name **FIR Wilson 3**

BMP Identification

BMP NAME / ID **Contech Filterra Bioscape Unit (BMP-A)**

Must match Name/ID used on BMP Design Calculation Sheet

Design Rainfall Depth

Design Rainfall Intensity

I = **0.20** in/hr

Drainage Management Area Tabulation

Insert additional rows if needed to accommodate all DMAs draining to the BMP

DMA Type/ID	DMA Area (square feet)	Post-Project Surface Type <i>(use pull-down menu)</i>	Effective Imperivous Fraction, I_f	DMA Runoff Factor	DMA Areas x Runoff Factor	Design Rainfall Intensity (in/hr)	Design Flow Rate (cfs)	Proposed Flow Rate (cfs)
L-A	28,055	Ornamental Landscaping	0.1	0.11	3098.9			
H-A	179,185	Concrete or Asphalt	1	0.892	159833			
R-A	188,337	Roofs	1	0.892	167996.6			
SR-A	18,039	Ornamental Landscaping	0.1	0.110458	1992.6			
413616		Total			332921.1	0.20	1.5	1.6

Notes:

The Contech Filterra Bioscape will be sized to handle the full BMP volume. The unit will be designed to handle the pump outlet flow rate instead of the Q_{bmp} rate above. The design flow rate will be based on the pump rate from the proposed stormwater lift station.

Pump Rate Calculation

$$\frac{V_{BMP}}{t_{drain}} = Area * i = Q_{pump}$$


$$\frac{V_{BMP}}{t_{drain}} = Q_{pump}$$

$$Q_{pump} = \frac{ft^3}{hr} * \frac{1 hr}{3600 sec} * \frac{449 gpm}{1 \frac{ft^3}{sec}}$$

$$Q_{pump} = \frac{18,033 ft^3}{24 hr} * \frac{449 gpm}{3600 \frac{ft^3}{hr}} = 93 gpm$$


$$Q_{pump} = 94 gpm$$

THIS IS A SCHEMATIC LAYOUT ONLY. ACTUAL CONFIGURATION WILL VARY BASED ON THE SITE SPECIFIC CONSIDERATIONS. REFER TO FLOWKIT DRAWINGS FOR ADDITIONAL DETAILS.

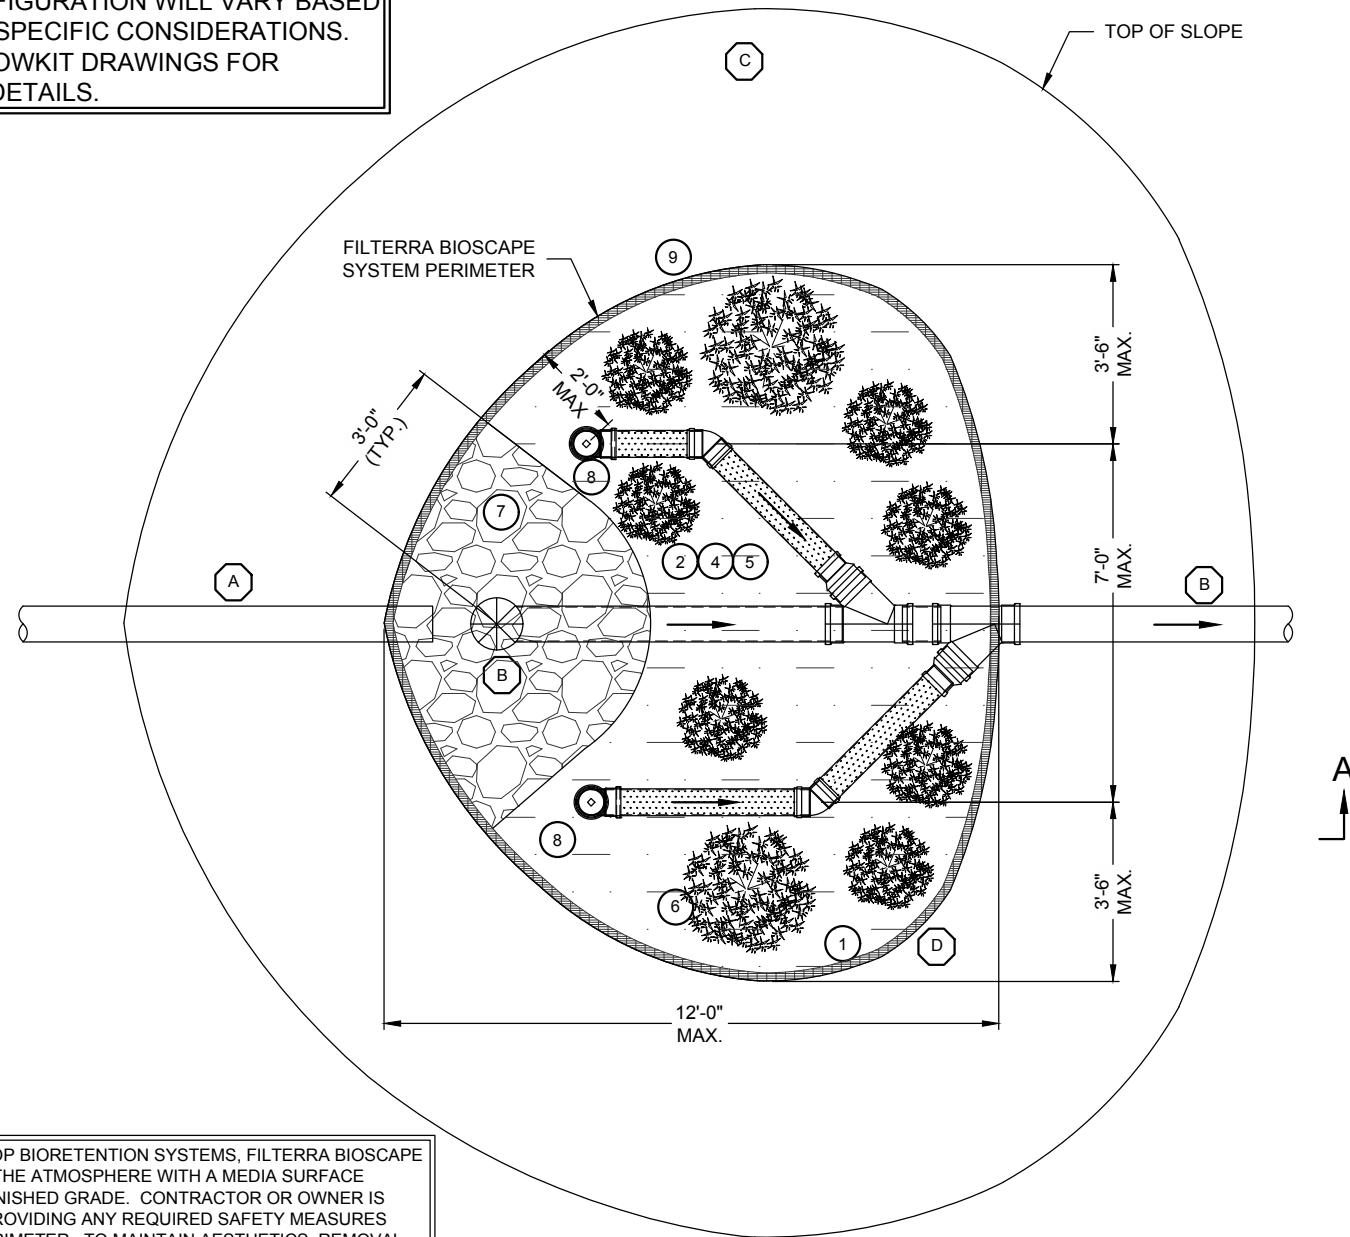

PLAN VIEW

AS WITH ALL OPEN TOP BIORETENTION SYSTEMS, FILTERRA BIOSCAPE SYSTEM IS OPEN TO THE ATMOSPHERE WITH A MEDIA SURFACE RECESSED BELOW FINISHED GRADE. CONTRACTOR OR OWNER IS RESPONSIBLE FOR PROVIDING ANY REQUIRED SAFETY MEASURES AROUND SYSTEM PERIMETER. TO MAINTAIN AESTHETICS, REMOVAL OF HEAVY STORMWATER DEBRIS MAY BE NECESSARY BETWEEN REGULAR FILTERRA SYSTEM MAINTENANCE EVENTS.

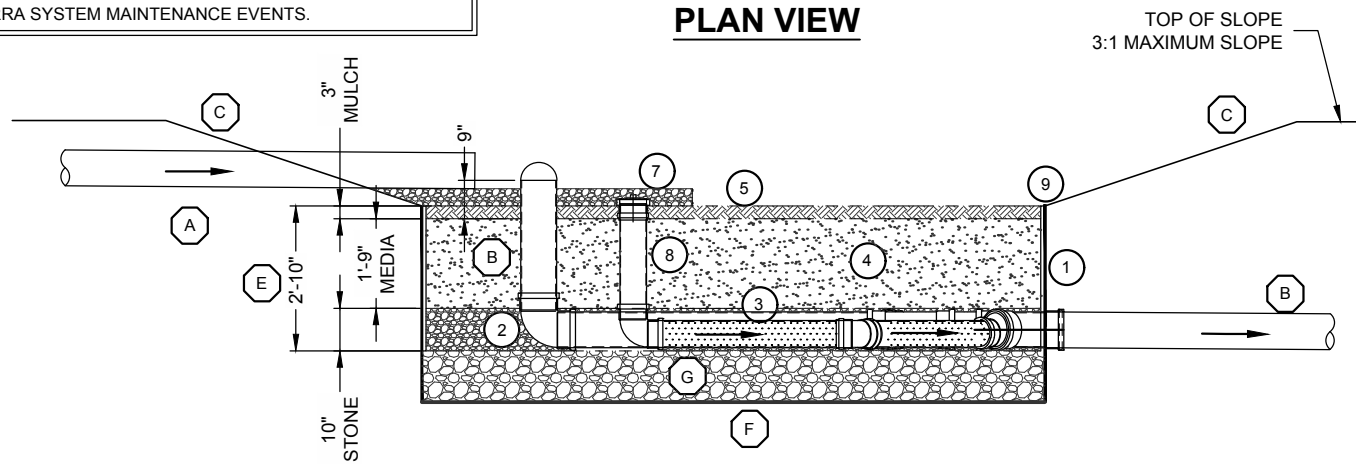

SECTION A-A VIEW

BILL OF MATERIALS

COUNT	DESCRIPTION	INSTALLED BY
X	FILTERRA SURFACE AREA (SF)	CONTRACTOR
X	MULCH VOLUME (CY)	CONTRACTOR
XX	FILTERRA MEDIA VOLUME (CY)	CONTRACTOR
X	1/2" #4 ROUND AGGREGATE UNDERDRAIN STONE (CY)	CONTRACTOR
X	ENERGY DISSIPATION ROCK (CY)	CONTRACTOR
X	EROSION CONTROL (LF)	CONTRACTOR
X	FILTERRA FLOWKIT	CONTRACTOR

PLANTING SCHEDULE

*NOTE: PLANTS PROVIDED BY OTHERS

QUANTITY	FILTERRA BIOSCAPE SYSTEM PLANT PALETTE

GENERAL NOTES

- CONTRACTOR SHALL CONTACT CONTECH TO COORDINATE DELIVERY AND SUPERVISION OF PLACEMENT OF FILTERRA BIOSCAPE SYSTEM COMPONENTS (ACTIVATION). CONTRACTOR SHALL COMPLETE ITEMS IN THE LIST OF CONTRACTOR INSTALLATION RESPONSIBILITIES LISTED ON THIS DETAIL BEFORE CONTECH'S REPRESENTATIVE ATTENDS AND SUPERVISES THE ACTIVATION OF THE BIOSCAPE SYSTEM.
- PERFORM FILTERRA BIOSCAPE SYSTEM EXCAVATION ONLY AFTER ALL THE CONTRIBUTING DRAINAGE AREAS ARE PERMANENTLY STABILIZED. DO NOT CONSTRUCT FILTERRA BIOSCAPE SYSTEM IN AN AREA USED AS EROSION AND SEDIMENT CONTROL FACILITIES. DO NOT STOCKPILE MATERIALS NOR STORE EQUIPMENT IN THIS AREA.
- USE METHODS OF EXCAVATION THAT MINIMIZE COMPACTION OF THE UNDERLYING SOIL UNLESS THE SYSTEM IS TO BE LINED.
- CONTRACTOR SHALL COORDINATE WITH CONTECH BEFORE THE FILTERRA BIOSCAPE SYSTEM AREA IS EXCAVATED TO MINIMIZE TIME BETWEEN EXCAVATION AND DELIVERY AND ACTIVATION OF THE FILTERRA BIOSCAPE SYSTEM. ANY STANDING WATER THAT ACCUMULATES IN THE EXCAVATED AREA MUST BE REMOVED BY THE CONTRACTOR BEFORE CONTECH CAN PROVIDE ACTIVATION OF THE FILTERRA BIOSCAPE SYSTEM. ANY ADDITIONAL EXCAVATION WILL BE THE RESPONSIBILITY OF THE CONTRACTOR. EXCAVATION DIMENSIONS SHOULD BE PROVIDED TO CONTECH IN THE ACTIVATION REQUEST CHECKLIST.
- CONTRACTOR SHALL PROVIDE ACCESS TO THE EXCAVATED AREA(S) FOR USE DURING THE ACTIVATION OF THE FILTERRA BIOSCAPE SYSTEM(S). ACCESS SHALL NOT PROHIBIT LIGHT DUTY EQUIPMENT THAT MAY BE USED TO INSTALL THE COMPONENTS (STONE, MEDIA, ETC). THE CONTRACTOR SHALL BE RESPONSIBLE FOR ANY RE-STABILIZATION THAT MAY BE REQUIRED AFTER THE FILTERRA BIOSCAPE SYSTEM ACTIVATION.
- CONTECH AND/OR ITS REPRESENTATIVES MUST BE SCHEDULED TO BE ON SITE FOR THE LIST ENTITLED CONTRACTOR ACTIVATION RESPONSIBILITIES.

CONTRACTOR SITE PREPARATION RESPONSIBILITIES AS DENOTED BY (X) ON THIS DETAIL:

- (A) CONTRACTOR SHALL INSTALL PIPE OR SWALE THAT CONVEYS INFLUENT FLOWS AS WELL AS ANY REQUIRED INLET AND OUTLET STRUCTURES.
- (B) CONTRACTOR SHALL PROVIDE BYPASS PIPE AND RISER OR OTHER STRUCTURE AS SHOWN ON PLANS. THE BYPASS PIPE SHALL BE INSTALLED WITH WYE(S), OR OTHER PIPE FITTINGS, AND WITH REDUCER COUPLING(S) FOR CONNECTION OF UNDERDRAIN PIPE, PER PLANS. PIPES SHALL BE INSTALLED TO PROMOTE POSITIVE FLOW FROM THE FILTERRA BIOSCAPE SYSTEM.
- (C) IF REQUIRED, CONTRACTOR TO PROVIDE SHOULDER ACCORDING TO DIMENSION AND SLOPE SHOWN ON PLANS OR AS DESIGNED BY ENGINEER OF RECORD. SLOPE FROM SHOULDER TO FILTERRA BIOSCAPE SYSTEM SURFACE AREA SHALL NOT EXCEED 3:1. SOD IS REQUIRED TO STABILIZE SIDE SLOPES OR ADJACENT GRADE.
- (D) CONTRACTOR TO EXCAVATE MEDIA AREA CORRESPONDING TO THE SIZE OF THE FILTERRA BIOSCAPE SYSTEM SURFACE AREA AS SHOWN ON DETAIL AND ON PLAN SHEETS.
- (E) CONTRACTOR SHALL EXCAVATE VERTICALLY FROM BOTTOM OF UNDERDRAIN STONE, OR DRAINAGE STONE, IF REQUIRED, TO ELEVATION OF MULCH AS SHOWN ON THIS DETAIL.
- (F) CONTRACTOR TO PROVIDE AND INSTALL ANY GEOTEXTILE OR IMPERMEABLE LINER FOR BOTTOM OF THE FILTERRA BIOSCAPE SYSTEM IF REQUIRED PER THE PLANS.
- (G) CONTRACTOR TO PROVIDE AND INSTALL ANY ADDITIONAL DRAINAGE STONE BELOW THE FILTERRA BIOSCAPE SYSTEM AS CALLED OUT ON THE PLANS.

CONTRACTOR ACTIVATION RESPONSIBILITIES AS DENOTED BY (#) ON THIS DETAIL:

- (1) PLACE GEOTEXTILE FABRIC ALONG THE PERIMETER OF THE FILTERRA BIOSCAPE SYSTEM EXCAVATION.
- (2) PLACE 10" OF UNDERDRAIN STONE - 2" UNDER THE PIPING, 6" AROUND THE PIPING AND 2" ABOVE THE PIPING USING LIGHT DUTY EQUIPMENT ONLY.
- (3) PLACE 6" UNDERDRAIN PIPING UNLESS OTHERWISE APPROVED BY CONTECH, ASSOCIATED PIPING AND FITTINGS/ELBOWS TO CONNECT TO THE PIPING/FITTING(S) THAT IS PROVIDED BY CONTRACTOR (SEE CONTRACTOR INSTALLATION RESPONSIBILITIES THIS DETAIL).
- (4) PLACE 21" FILTERRA MEDIA USING LIGHT DUTY EQUIPMENT ONLY. DO NOT COMPACT MEDIA.
- (5) PLACE 3" DOUBLE SHREDDED HARDWOOD MULCH OVER ENTIRE FILTERRA BIOSCAPE SYSTEM SURFACE AREA USING LIGHT DUTY EQUIPMENT ONLY. DO NOT COMPACT MULCH.
- (6) PROVIDE AND PLANT VEGETATION AS INDICATED IN TABLE ON THIS DETAIL OR ON SITE PLANS.
- (7) PLACE ENERGY DISSIPATION ROCK APRON AS DESIGNED AND INDICATED ON THIS DETAIL OR PER ENGINEER OF RECORD PLANS.
- (8) PLACE CLEANOUT ADAPTER, PLUG AND PIPING.
- (9) PLACE ADDITIONAL EROSION CONTROL AROUND FILTERRA BIOSCAPE SYSTEM (IF REQUIRED).

I:\COMMON\CAD\TREATMENT\64 FILTERRA\40 STANDARD DRAWINGS\FTBS - BIOSCAPE SYSTEM (BOXLESS)\DWG\FILTERRA BIOSCAPE SUPERVISED SYSTEM - STD DETAIL.DWG 5/21/2020 8:57 AM



June 2020

GENERAL USE LEVEL DESIGNATION FOR BASIC (TSS), ENHANCED, PHOSPHORUS & OIL TREATMENT

For

CONTECH Engineered Solutions Filterra®

Ecology's Decision:

Based on Contech's submissions, including the Final Technical Evaluation Reports, dated August 2019, March 2014, December 2009, and additional information provided to Ecology dated October 9, 2009, Ecology hereby issues the following use level designations:

1. A General Use Level Designation for Basic, Enhanced, Phosphorus, and Oil Treatment for the Filterra® system constructed with a minimum media thickness of 21 inches (1.75 feet), at the following water quality design hydraulic loading rates:

Treatment	Infiltration Rate (in/hr) for use in Sizing
Basic	175
Phosphorus	100
Oil	50
Enhanced	175

2. The Filterra is not appropriate for oil spill-control purposes.
3. Ecology approves Filterra systems for treatment at the hydraulic loading rates listed above, and sized based on the water quality design flow rate for an off-line system. Calculate the water quality design flow rates using the following procedures:

- Western Washington: for treatment installed upstream of detention or retention, the water quality design flow rate is the peak 15-minute flow rate as calculated using the latest version of the Western Washington Hydrology Model or other Ecology-approved continuous runoff model.
- Eastern Washington: For treatment installed upstream of detention or retention, the water quality design flow rate is the peak 15-minute flow rate as calculated using one of the three flow rate based methods described in Chapter 2.7.6 of the Stormwater Management Manual for Eastern Washington (SWMMEW) or local manual.
- Entire State: For treatment installed downstream of detention, the water quality design flow rate is the full 2-year release rate of the detention facility.

4. This General Use Level Designation has no expiration date, but Ecology may revoke or amend the designation, and is subject to the conditions specified below.

Ecology's Conditions of Use:

Filtterra systems shall comply with these conditions shall comply with the following conditions:

1. Design, assemble, install, operate, and maintain the Filtterra systems in accordance with applicable Contech Filtterra manuals and this Ecology Decision.
2. The minimum size filter surface-area for use in Washington is determined by using the design water quality flow rate (as determined in this Ecology Decision, Item 3, above) and the Infiltration Rate from the table above (use the lowest applicable Infiltration Rate depending on the level of treatment required). Calculate the required area by dividing the water quality design flow rate (cu-ft/sec) by the Infiltration Rate (converted to ft/sec) to obtain required surface area (sq-ft) of the Filtterra unit.
3. Each site plan must undergo Contech Filtterra review before Ecology can approve the unit for site installation. This will ensure that design parameters including site grading and slope are appropriate for use of a Filtterra unit.
4. Filtterra media shall conform to the specifications submitted to and approved by Ecology and shall be sourced from Contech Engineered Solutions, LLC with no substitutions.
5. Maintenance includes removing trash, degraded mulch, and accumulated debris from the filter surface and replacing the mulch layer. Use inspections to determine the site-specific maintenance schedules and requirements. Follow maintenance procedures given in the most recent version of the Filtterra Operation and Maintenance Manual.
6. Maintenance: The required maintenance interval for stormwater treatment devices is often dependent upon the degree of pollutant loading from a particular drainage basin. Therefore, Ecology does not endorse or recommend a "one size fits all" maintenance cycle for a particular model/size of manufactured treatment device.
 - Contech designs Filtterra systems for a target maintenance interval of 6 months in the Pacific Northwest. Maintenance includes removing and replacing the mulch layer above the media along with accumulated sediment, trash, and captured organic materials therein, evaluating plant health, and pruning the plant if deemed necessary.
 - Conduct maintenance following manufacturer's guidelines.
7. Filtterra systems come in standard sizes.
8. Install the Filtterra in such a manner that flows exceeding the maximum Filtterra operating rate are conveyed around the Filtterra mulch and media and will not resuspend captured sediment.
9. Discharges from the Filtterra units shall not cause or contribute to water quality standards violations in receiving waters.

Approved Alternate Configurations

Filtterra Internal Bypass - Pipe (FTIB-P)

1. The Filtterra® Internal Bypass – Pipe allows for piped-in flow from area drains, grated inlets, trench drains, and/or roof drains. Design capture flows and peak flows enter the structure through an internal slotted pipe. Filtterra® inverted the slotted pipe to allow design flows to drop through to a series of splash plates that then disperse the design flows over the top surface of the Filtterra® planter area. Higher flows continue to bypass the slotted pipe and convey out the structure.
2. To select a FTIB-P unit, the designer must determine the size of the standard unit using the sizing guidance described above.

Filtterra Internal Bypass – Curb (FTIB-C)

1. The Filtterra® Internal Bypass –Curb model (FTIB-C) incorporates a curb inlet, biofiltration treatment chamber, and internal high flow bypass in one single structure. Filtterra® designed the FTIB-C model for use in a “Sag” or “Sump” condition and will accept flows from both directions along a gutter line. An internal flume tray weir component directs treatment flows entering the unit through the curb inlet to the biofiltration treatment chamber. Flows in excess of the water quality treatment flow rise above the flume tray weir and discharge through a standpipe orifice; providing bypass of untreated peak flows. Americast manufactures the FTIB-C model in a variety of sizes and configurations and you may use the unit on a continuous grade when a single structure providing both treatment and high flow bypass is preferred. The FTIB-C model can also incorporate a separate junction box chamber to allow larger diameter discharge pipe connections to the structure.
2. To select a FTIB-C unit, the designer must determine the size of the standard unit using the sizing guidance described above.

Filtterra® Shallow

1. The Filtterra Shallow provides additional flexibility for design engineers and designers in situations where various elevation constraints prevent application of a standard Filtterra configuration. Engineers can design this system up to six inches shallower than any of the previous Filtterra unit configurations noted above.
2. Ecology requires that the Filtterra Shallow provide a media contact time equivalent to that of the standard unit. This means that with a smaller depth of media, the surface area must increase.
3. To select a Filtterra Shallow System unit, the designer must first identify the size of the standard unit using the modeling guidance described above.
4. Once the size of the standard Filtterra unit is established using the sizing technique described above, use information from the following table to select the appropriate size Filtterra Shallow System unit.

Shallow Unit Basic, Enhanced, Phosphorus, and Oil Treatment Sizing

Standard Depth	Equivalent Shallow Depth
4x4	4x6 or 6x4
4x6 or 6x4	6x6
4x8 or 8x4	6x8 or 8x6
6x6	6x10 or 10x6
6x8 or 8x6	6x12 or 12x6
6x10 or 10x6	13x7

Notes:

1. Shallow Depth Boxes are less than the standard depth of 3.5 feet but no less than 3.0 feet deep (TC to INV).

Applicant: Contech Engineered Solutions, LLC.

Applicant's Address: 11815 NE Glenn Widing Drive
Portland, OR 97220

Application Documents:

- State of Washington Department of Ecology Application for Conditional Use Designation, Americast (September 2006)
- Quality Assurance Project Plan Filterra® Bioretention Filtration System Performance Monitoring, Americast (April 2008)
- Quality Assurance Project Plan Addendum Filterra® Bioretention Filtration System Performance Monitoring, Americast (June 2008)
- Draft Technical Evaluation Report Filterra® Bioretention Filtration System Performance Monitoring, Americast (August 2009)
- Final Technical Evaluation Report Filterra® Bioretention Filtration System Performance Monitoring, Americast (December 2009)
- Technical Evaluation Report Appendices Filterra® Bioretention Filtration System Performance Monitoring, Americast, (August 2009)
- Memorandum to Department of Ecology Dated October 9, 2009 from Americast, Inc. and Herrera Environmental Consultants
- Quality Assurance Project Plan Filterra® Bioretention System Phosphorus treatment and Supplemental Basic and Enhanced Treatment Performance Monitoring, Americast (November 2011)
- Filterra® letter August 24, 2012 regarding sizing for the Filterra® Shallow System.
- University of Virginia Engineering Department Memo by Joanna Crowe Curran, Ph. D dated March 16, 2013 concerning capacity analysis of Filterra® internal weir inlet tray.
- Terraphase Engineering letter to Jodi Mills, P.E. dated April 2, 2013 regarding Terrafume Hydraulic Test, Filterra® Bioretention System and attachments.
- Technical Evaluation Report, Filterra® System Phosphorus Treatment and Supplemental Basic Treatment Performance Monitoring. March 27th, 2014.
- State of Washington Department of Ecology Application for Conditional Use Level Designation, Contech Engineered Solutions (May 2015)

- Quality Assurance Project Plan Filterra® Bioretention System, Contech Engineered Solutions (May 2015)
- Filterra Bioretention System Armco Avenue General Use Level Designation Technical Evaluation Report, Contech Engineered Solutions (August 2019)

Applicant's Use Level Request:

General Level Use Designation for Basic (175 in/hr), Enhanced (175 in/hr), Phosphorus (100 in/hr), and Oil Treatment (50 in/hr).

Applicant's Performance Claims:

Field-testing and laboratory testing show that the Filterra® unit is promising as a stormwater treatment best management practice and can meet Ecology's performance goals for basic, enhanced, phosphorus, and oil treatment.

Findings of Fact:

Field Testing 2015-2019

1. Contech completed field testing of a 4 ft. x 4 ft. Filterra® unit at one site in Hillsboro, Oregon from September 2015 to July 2019. Throughout the monitoring period a total of 24 individual storm events were sampled, of which 23 qualified for TAPE sampling criteria.
2. Contech encountered several unanticipated events and challenges that prevented them from collecting continuous flow and rainfall data. An analysis of the flow data from the sampled events, including both the qualifying and non-qualifying events, demonstrated the system treated over 99 % of the influent flows. Peak flows during these events ranged from 25 % to 250 % of the design flow rate of 29 gallons per minute.
3. Of the 23 TAPE qualified sample events, 13 met requirements for TSS analysis. Influent concentrations ranged from 20.8 mg/L to 83 mg/L, with a mean concentration of 46.3 mg/L. The UCL95 mean effluent concentration was 15.9 mg/L, meeting the 20 mg/L performance goal for Basic Treatment.
4. All 23 TAPE qualified sample events met requirements for dissolved zinc analysis. Influent concentrations range from 0.0384 mg/L to 0.2680 mg/L, with a mean concentration of 0.0807 mg/L. The LCL 95 mean percent removal was 62.9 %, meeting the 60 % performance goal for Enhanced Treatment.
5. Thirteen of the 23 TAPE qualified sample events met requirements for dissolved copper analysis. Influent concentrations ranged from 0.00543 mg/L to 0.01660 mg/L, with a mean concentration of 0.0103 mg/L. The LCL 95 mean percent removal was 41.2 %, meeting the 30 % performance goal for Enhanced Treatment.
6. Total zinc concentrations were analyzed for all 24 sample events. Influent EMCs for total zinc ranged from 0.048 mg/L to 5.290 mg/L with a median of 0.162 mg/L. Corresponding effluent EMCs for total zinc ranged from 0.015 mg/L to 0.067 mg/L with a median of

0.029 mg/L. Total event loadings for the study for total zinc were 316.85 g at the influent and 12.92 g at the effluent sampling location, resulting in a summation of loads removal efficiency of 95.9 %.

7. Total copper concentrations were analyzed for all 24 sample events. Influent EMCs for total copper ranged from 0.003 mg/L to 35.600 mg/L with a median value of 0.043 mg/L. Corresponding effluent EMCs for total copper ranged from 0.002 mg/L to 0.015 mg/L with a median of 0.004 mg/L. Total event loadings for total copper for the study were 1,810.06 g at the influent and 1.90 g at the effluent sampling location, resulting in a summation of loads removal efficiency of 99.9 %.

Field Testing 2013

1. Filterra completed field-testing of a 6.5 ft x 4 ft. unit at one site in Bellingham, Washington. Continuous flow and rainfall data collected from January 1, 2013 through July 23, 2013 indicated that 59 storm events occurred. Water quality data was obtained from 22 storm events. Not all the sampled storms produced information that met TAPE criteria for storm and/or water quality data.
2. The system treated 98.9 % of the total 8-month runoff volume during the testing period. Consequently, the system achieved the goal of treating 91 % of the volume from the site. Stormwater runoff bypassed Filterra treatment during four of the 59 storm events.
3. Of the 22 sampled events, 18 qualified for TSS analysis (influent TSS concentrations ranged from 25 to 138 mg/L). The data were segregated into sample pairs with influent concentration greater than and less than 100 mg/L. The UCL95 mean effluent concentration for the data with influent less than 100 mg/L was 5.2 mg/L, below the 20-mg/L threshold. Although the TAPE guidelines do not require an evaluation of TSS removal efficiency for influent concentrations below 100 mg/L, the mean TSS removal for these samples was 90.1 %. Average removal of influent TSS concentrations greater than 100 mg/L (three events) was 85 %. In addition, the system consistently exhibited TSS removal greater than 80 % at flow rates equivalent to a 100 in/hr infiltration rate and was observed at 150 in/hr.
4. Ten of the 22 sampled events qualified for TP analysis. Americast augmented the dataset using two sample pairs from previous monitoring at the site. Influent TP concentrations ranged from 0.11 to 0.52 mg/L. The mean TP removal for these twelve events was 72.6 %. The LCL95 mean percent removal was 66.0, well above the TAPE requirement of 50 %. Treatment above 50 % was evident at 100 in/hr infiltration rate and as high as 150 in/hr. Consequently, the Filterra test system met the TAPE Phosphorus Treatment goal at 100 in/hr. Influent ortho-P concentrations ranged from 0.005 to 0.012 mg/L; effluent ortho-P concentrations ranged from 0.005 to 0.013 mg/L. The reporting limit/resolution for the ortho-P test method is 0.01 mg/L, therefore the influent and effluent ortho-P concentrations were both at and near non-detect concentrations.

Field Testing 2008-2009

1. Filtterra completed field-testing at two sites at the Port of Tacoma. Continuous flow and rainfall data collected during the 2008-2009 monitoring period indicated that 89 storm events occurred. The monitoring obtained water quality data from 27 storm events. Not all the sampled storms produced information that met TAPE criteria for storm and/or water quality data.
2. During the testing at the Port of Tacoma, 98.96 to 99.89 % of the annual influent runoff volume passed through the POT1 and POT2 test systems respectively. Stormwater runoff bypassed the POT1 test system during nine storm events and bypassed the POT2 test system during one storm event. Bypass volumes ranged from 0.13 % to 15.3% of the influent storm volume. Both test systems achieved the 91 % water quality treatment-goal over the 1-year monitoring period.
3. Consultants observed infiltration rates as high as 133 in/hr during the various storms. Filtterra did not provide any paired data that identified percent removal of TSS, metals, oil, or phosphorus at an instantaneous observed flow rate.
4. The maximum storm average hydraulic loading rate associated with water quality data is <40 in/hr, with the majority of flow rates < 25 in/hr. The average instantaneous hydraulic loading rate ranged from 8.6 to 53 in/hr.
5. The field data showed a removal rate greater than 80 % for TSS with an influent concentration greater than 20 mg/L at an average instantaneous hydraulic loading rate up to 53 in/hr (average influent concentration of 28.8 mg/L, average effluent concentration of 4.3 mg/L).
6. The field data showed a removal rate generally greater than 54 % for dissolved zinc at an average instantaneous hydraulic loading rate up to 60 in/hr and an average influent concentration of 0.266 mg/L (average effluent concentration of 0.115 mg/L).
7. The field data showed a removal rate generally greater than 40 % for dissolved copper at an average instantaneous hydraulic loading rate up to 35 in/hr and an average influent concentration of 0.0070 mg/L (average effluent concentration of 0.0036 mg/L).
8. The field data showed an average removal rate of 93 % for total petroleum hydrocarbon (TPH) at an average instantaneous hydraulic loading rate up to 53 in/hr and an average influent concentration of 52 mg/L (average effluent concentration of 2.3 mg/L). The data also shows achievement of less than 15 mg/L TPH for grab samples. Filtterra provided limited visible sheen data due to access limitations at the outlet monitoring location.
9. The field data showed low percentage removals of total phosphorus at all storm flows at an average influent concentration of 0.189 mg/L (average effluent concentration of 0.171 mg/L). We may relate the relatively poor treatment performance of the Filtterra system at this location to influent characteristics for total phosphorus that are unique to the Port of Tacoma site. It appears that the Filtterra system will not meet the 50 % removal performance goal when the majority of phosphorus in the runoff is expected to be in the dissolved form.

Laboratory Testing

1. Filterra performed laboratory testing on a scaled down version of the Filterra unit. The lab data showed an average removal from 83-91 % for TSS with influents ranging from 21 to 320 mg/L, 82-84 % for total copper with influents ranging from 0.94 to 2.3 mg/L, and 50-61 % for orthophosphate with influents ranging from 2.46 to 14.37 mg/L.
2. Filterra conducted permeability tests on the soil media.
3. Lab scale testing using Sil-Co-Sil 106 showed removals ranging from 70.1 % to 95.5 % with a median removal of 90.7 %, for influent concentrations ranging from 8.3 to 260 mg/L. Filterra ran these laboratory tests at an infiltration rate of 50 in/hr.
4. Supplemental lab testing conducted in September 2009 using Sil-Co-Sil 106 showed an average removal of 90.6 %. These laboratory tests were run at infiltration rates ranging from 25 to 150 in/hr for influent concentrations ranging from 41.6 to 252.5 mg/L. Regression analysis results indicate that the Filterra system's TSS removal performance is independent of influent concentration in the concentration range evaluated at hydraulic loading rates of up to 150 in/hr.

Contact Information:

Applicant: Jeremiah Lehman
Contech Engineered Solutions, LLC.
11815 Glenn Widing Dr
Portland, OR 97220
(503) 258-3136
jlehman@conteches.com

Applicant's Website: <http://www.conteches.com>

Ecology web link: <http://www.ecy.wa.gov/programs/wq/stormwater/newtech/index.html>

Ecology: Douglas C. Howie, P.E.
Department of Ecology
Water Quality Program
(360) 407-6444
douglas.howie@ecy.wa.gov



Date	Revision
December 2009	GULD for Basic, Enhanced, and Oil granted, CULD for Phosphorus
September 2011	Extended CULD for Phosphorus Treatment
September 2012	Revised design storm discussion, added Shallow System.
January 2013	Revised format to match Ecology standards, changed Filterra contact information
February 2013	Added FTIB-P system
March 2013	Added FTIB-C system
April 2013	Modified requirements for identifying appropriate size of unit

June 2013	Modified description of FTIB-C alternate configuration
March 2014	GULD awarded for Phosphorus Treatment. GULD updated for a higher flow-rate for Basic Treatment.
June 2014	Revised sizing calculation methods
March 2015	Revised Contact Information
June 2015	CULD for Basic and Enhanced at 100 in/hr infiltration rate
September 2019	GULD for Basic and Enhanced at 175 in/hr infiltration rate
February 2020	Revised sizing language to note sizing based on off-line calculations
June 2020	Added Phosphorus to Filterra Shallow sizing table

Appendix 7: Hydromodification

Supporting Detail Relating to Hydrologic Conditions of Concern

Riverside County WAP Hydromodification Geodatabase
approved April 20, 2017

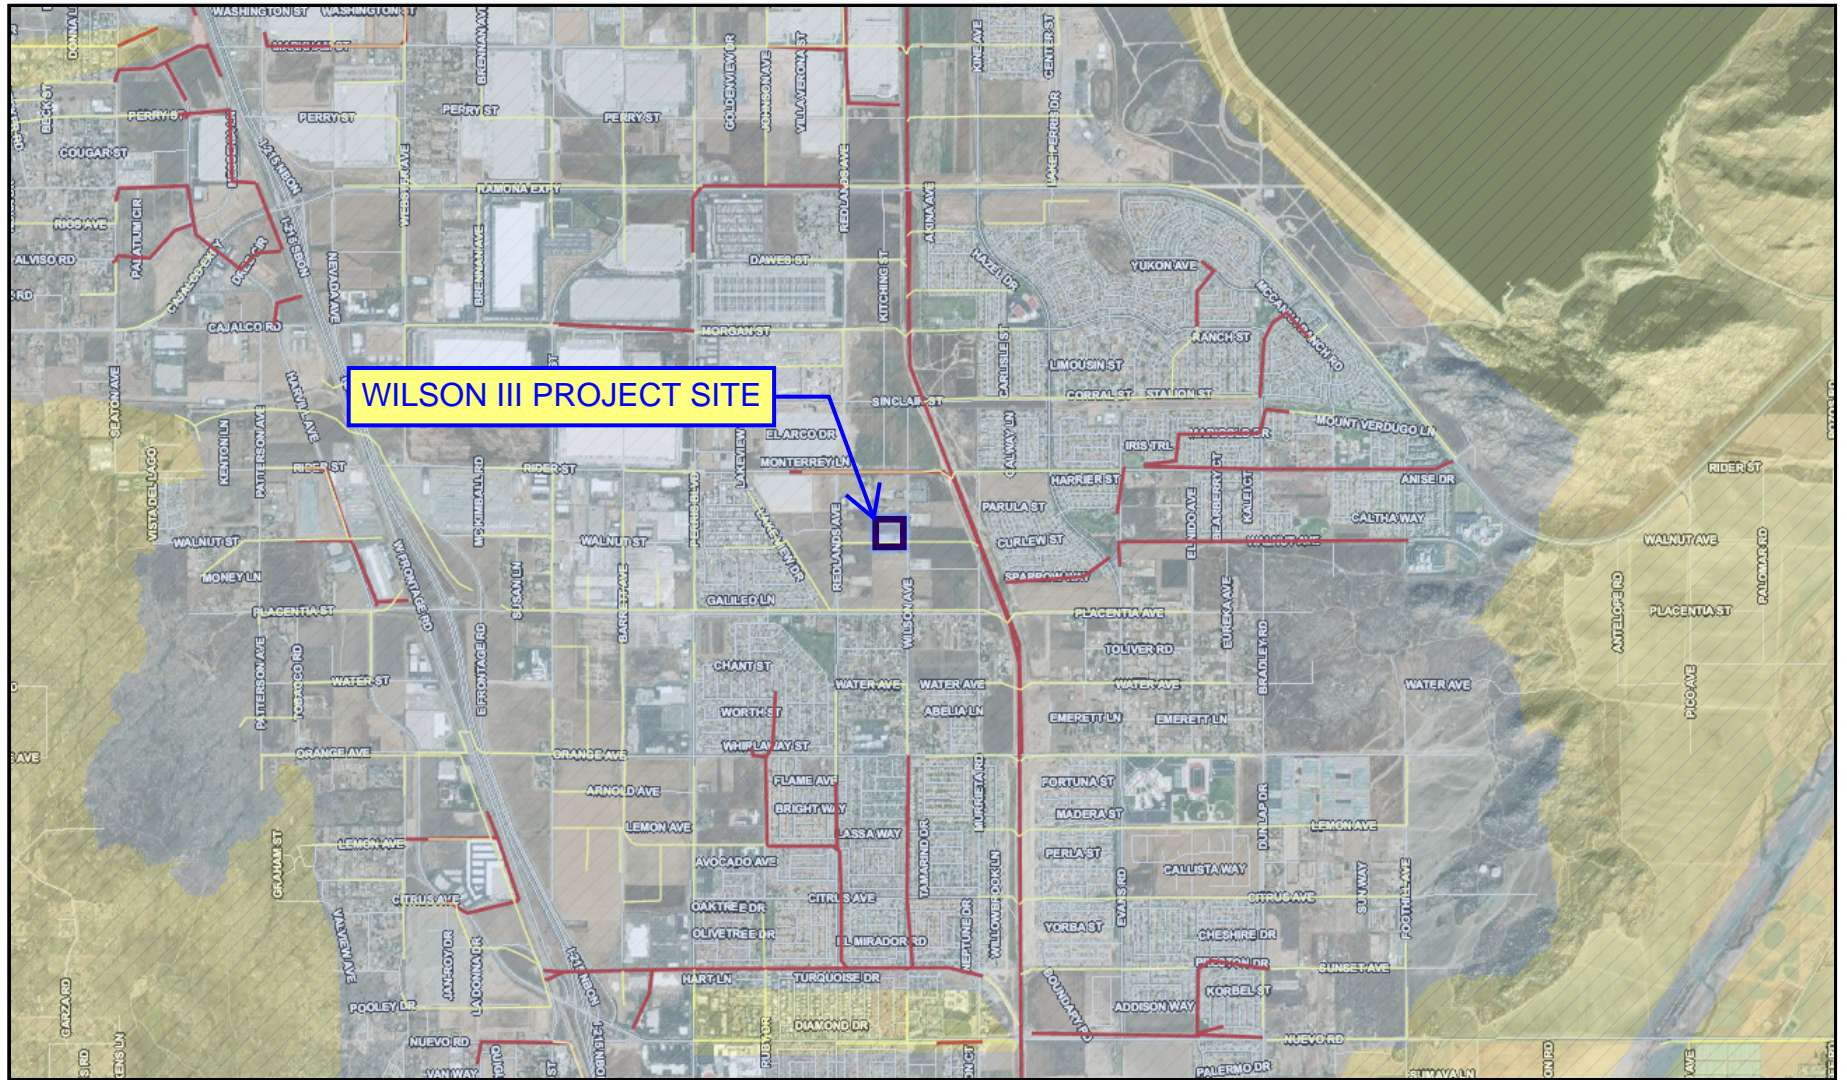

Appendix 8: Source Control

Pollutant Sources/Source Control Checklist

To be included in FWQMP

Appendix 9: O&M

Operation and Maintenance Plan and Documentation of Finance, Maintenance and Recording Mechanisms

To be included in FWQMP

Appendix 10: Educational Materials

BMP Fact Sheets, Maintenance Guidelines and Other End-User BMP Information

To be included in FWQMP